


NEW RIVER COMMUNITY AND TECHNICAL COLLEGE - ADVANCED TECHNOLOGY CENTER RENOVATION



CONCEPTUAL RENDERING

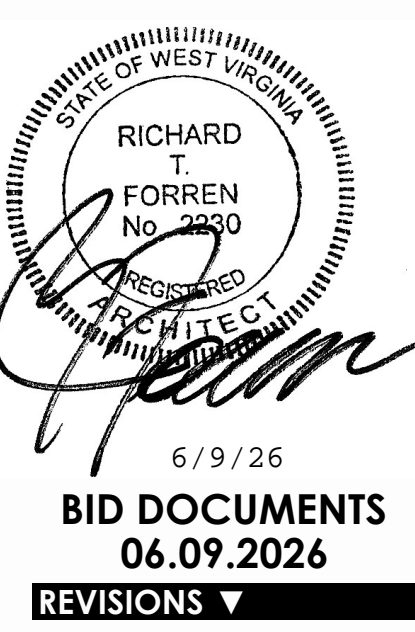

BID ITEM: BUILDING EXTERIOR UPGRADES AND PAINTING

- REPLACEMENT OF METAL PANEL FROM 0'-0" TO 7'-6". SEE ELEVATIONS FOR TYPE AND PROFILE.
- REPLACEMENT OF TRANSLUCENT PANELS ON EAST & WEST FACADES. SEE ELEVATIONS FOR EXACT HEIGHT AND LOCATIONS.
- INSTALL NEW OVERHEAD DOORS. SEE SCHEDULE.
- CLEAN (AS NECESSARY) AND PAINT ALL EXISTING BOLLARDS SAFETY YELLOW.
- PAINT EXTERIOR OF BUILDING IN ITS ENTIRETY.
- PAINT FACADES OF BUILDING AS INDICATED ON PAINT ELEVATIONS.
- CLEAN AND PAINT ALL EXTERIOR SWING DOORS.
- CLEAN AND PAINT OVERHEAD DOORS THAT ARE NOT REPLACED.

ADD ALTERNATE NO. 1: NEW BUILDING ENTRY

- DEMOLISH EXISTING CANOPY AND ASSOCIATED SUPPORTS.
- DEMOLISH EXISTING OPENING TO CONSTRUCT NEW VESTIBULE.
- CONSTRUCT NEW VESTIBULE AND ENTRANCE CANOPY.

ADD ALTERNATE NO. 2: NEW MONUMENT SIGN

- MONUMENT SIGNAGE IN FRONT OF EXISTING GRAVEL PARKING LOT SEEN FROM I77.
- CIVIL WORK FOR ELECTRICAL CONDUIT TO SIGNAGE.

DRAWING INDEX

| Sheet Number | Sheet Name | BID DOCUMENTS 06.09.2026 |
|----------------------|---|--------------------------|
| GENERAL | | |
| G-1.0 | COVER SHEET | 1 |
| CIVIL | | |
| C-1.0 | GENERAL NOTES | 1 |
| C-2.0 | EXISTING CONDITIONS | 1 |
| C-3.0 | SITE PLAN - ALTERNATES #01, #02 | 1 |
| C-4.0 | DETAILS | 4 |
| STRUCTURAL | | |
| S001 | GENERAL NOTES | 1 |
| S100 | FOUNDATION AND FRAMING PLAN - ALTERNATES #01, #02 | 1 |
| S300 | CANOPY/VESTIBULE SECTIONS - ALTERNATES #01, #02 | 1 |
| S500 | FOUNDATION DETAILS - ALTERNATES #01, #02 | 1 |
| S501 | STEEL DETAILS - ALTERNATES #01, #02 | 1 |
| S600 | SCHEDULES - ALTERNATES #01, #02 | 6 |
| ARCHITECTURAL | | |
| AD-1.1 | FIRST AND SECOND FLOOR DEMOLITION PLAN | 1 |
| AD-2.1 | EXTERIOR ELEVATIONS - DEMOLITION | 1 |
| AD-5.1 | DEMOLITION DETAILS - ALTERNATE #01 | 1 |
| A-1.1 | FIRST AND SECOND FLOOR PLAN - NEW WORK | 1 |
| A-2.0 | 3D VIEWS | 1 |
| A-2.1 | EXTERIOR ELEVATIONS | 1 |
| A-2.2 | EXTERIOR PAINT ELEVATIONS | 1 |
| A-3.1 | WALL SECTIONS AND DETAILS - ALTERNATE #01 | 1 |
| A-3.2 | WALL SECTIONS AND DETAILS - ALTERNATE #01 | 1 |
| A-3.3 | WALL SECTIONS AND DETAILS - ALTERNATE #01 | 1 |
| A-3.4 | ENLARGED PLANS AND DETAILS - ALTERNATE #01 | 1 |
| A-6.0 | DOOR AND WINDOW ELEVATIONS AND SCHEDULE | 1 |
| A-6.1 | STOREFRONT DETAILS - ALTERNATE #01 | 1 |
| A-8.1 | EXTERIOR SIGNAGE - ALTERNATE #02 | 1 |
| MECHANICAL | | |
| MP-1.1 | HVAC AND PLUMBING PLANS - ALTERNATE #01 | 1 |
| ELECTRICAL | | |
| E-1.1 | SITE PLAN - ALTERNATE #02 | 1 |
| E-2.1 | ELECTRICAL PLANS AND DETAILS - ALTERNATE #01 | 2 |
| Total: 28 | | |

PROJECT TEAM

OWNER:

West Virginia Community and Technical College System
280 University Drive
Beaver, WV 25813
(304) 929-5450

ARCHITECTURAL SERVICES:

Omni Associates, Architects
207 Jefferson Street
Fairmont, WV 26554
(304) 367-1417



CIVIL \ SITE DESIGN:

Ascent Engineering
1700 Anmore Road
Bridgeport, WV 26330
(304) 933-3463

STRUCTURAL DESIGN:

Allegheny Design Services
102 Leeway Street
Morgantown, WV 26505
(304) 599-0771

MECHANICAL, ELECTRICAL, AND PLUMBING DESIGN:

Harper Engineering
52 B Street
St. Albans, WV 25177
(304)-541-1390

PROJECT LOCATION



PROJECT INFORMATION

| | |
|--|---|
| BUILDING ADDRESS: 527 Odd Rd. Ghent, WV 25843 Raleigh County | OWNER ADDRESS: 280 University Drive Beaver, WV 25813 Raleigh County |
| TYPE OF WORK: Renovation | TYPE(S) OF CONSTRUCTION: IIB |
| USE, OCCUPANCY CLASSIFICATION(S): Business | FIRE SUPPRESSION: Full |
| Number of Stories above grade | 2 |
| Does this building have a basement? | No |
| Building Footprint Area | 88,560 SF |
| Total Floor Area (SQ. FT.) | 91,730 SF |
| Floor Area of New Construction | 76 SF vestibule |
| Floor Area of Addition | 76 SF vestibule |
| Floor Area of Renovation | 76 SF |
| Applicable International Building Code (IBC) | 2018 (IBC) |
| Applicable Life Safety Code | 2021 (NFPA 101) |

ATC RENOVATION
NEW RIVER COMMUNITY & TECHNICAL COLLEGE
527 Odd Rd.
Ghent, WV 25843

COVER SHEET




Copyright © All rights reserved. Reproduction in whole or in part is prohibited. This drawing is an instrument of service, is the property of the Architect and may not be used in any way without written permission of this firm.
Project No: 2024008.001 Drawn by: ---



BID DOCUMENTS
06.09.2026
REVISIONS ▼



ATC RENOVATION
NEW RIVER COMMUNITY & TECHNICAL COLLEGE
527 Odd Rd.
Ghent, WV 25843
GENERAL NOTES

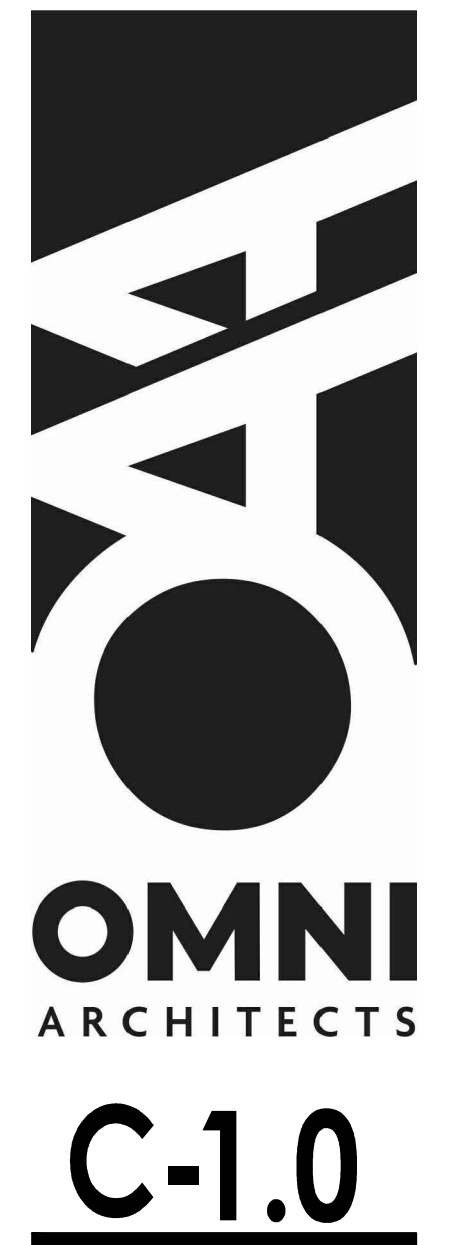

C-1.0
Copyright, © All rights reserved. Reproduction in whole or in part is prohibited. This drawing is an instrument of service, is the property of the Architect and may not be used in any way without written permission of this firm.
Project No: 202-0008.001 Drawn by: OTM

GENERAL NOTES

1. THE GOVERNING SPECIFICATIONS FOR THIS PROJECT ARE INCLUDED IN THE CONTRACT DOCUMENTS. ANY ITEMS NOT COVERED IN THE PROJECT SPECIFICATIONS SHALL BE COVERED BY THE WEST VIRGINIA DEPARTMENT OF TRANSPORTATION, DIVISION OF HIGHWAYS, STANDARD SPECIFICATIONS, ROADS AND BRIDGES, 2023 EDITION, WITH THE 2025 SUPPLEMENTAL SPECIFICATIONS. THE CONTRACT DOCUMENTS AND THE CONTRACT PLANS ARE THE GOVERNING PROVISIONS APPLICABLE TO THIS PROJECT.
2. THE CONSTRUCTION DRAWINGS REPRESENT THE PROPOSED LAYOUT, CONTOURS, UTILITIES, AND ANCILLARY ITEMS NECESSARY TO COMPLETE THE SCOPE OF WORK AS IT IS INTENDED. SOME INCIDENTAL ITEMS THAT ARE NECESSARY TO COMPLETE THE INTENDED SCOPE OF WORK MAY NOT BE SHOWN.
3. ALL WORK PERFORMED AND MATERIAL PROVIDED AND INSTALLED SHALL ADHERE TO THE CONSTRUCTION PLANS. LINES, GRADES, CROSS SECTIONS, DIMENSIONS, AND MATERIAL REQUIREMENTS SHALL BE FOLLOWED. ESTIMATED QUANTITIES ARE BASED ON THE PROJECT PLANS PROVIDED. THE CONSTRUCTION PLANS ARE SUBJECT TO VARIATION NECESSARY TO OBTAIN SUBGRADE AND/OR FINAL GRADE SATISFACTORY TO THE ENGINEER. ANY VARIATION OF THE PROJECT PLANS SHALL BE REVIEWED BY AND APPROVED BY THE ENGINEER.
4. A BOUNDARY SURVEY WAS COMPLETED IN FEBRUARY 2025 BY ASCENT CONSULTING & ENGINEERING. BASE MAPPING FOR THIS PROJECT WAS SURVEYED BY ASCENT CONSULTING & ENGINEERING IN FEBRUARY 2025. THE HORIZONTAL DATUM IS NAD83 WEST VIRGINIA STATE PLANES, SOUTH ZONE, US FOOT.
5. THE CONTRACTOR SHALL HAVE A SUPERINTENDENT ON SITE THAT IS FAMILIAR WITH THE WORK TYPE, IS COMPETENT, AND WILL COORDINATE WITH THE ENGINEER AND OWNER AS NEEDED.
6. THE CONTRACTOR SHALL VERIFY ALL PLAN ELEVATIONS AND DIMENSIONS PRIOR TO ORDERING ANY MATERIALS OR BEGINNING WORK. THE CONTRACTOR SHALL IMMEDIATELY NOTIFY THE ARCHITECT AND ENGINEER OF ANY VARIATION FROM PLAN.
7. THE CONTRACTOR SHALL LOCATE AND VERIFY UTILITY LOCATIONS PRIOR TO THE START OF WORK. THE CONTRACTOR SHALL ALSO PROTECT EXISTING UTILITIES FROM DAMAGE BY EQUIPMENT OR PERSONNEL. THE CONTRACTOR SHALL CONTACT ALL UTILITY AGENCIES FOR FIELD MARKING PRIOR TO BEGINNING CONSTRUCTION. THE CONTRACTOR SHALL NOTIFY THE ENGINEER AND/OR OWNER IN WRITING, OF ANY EXISTING DAMAGED UTILITIES PRIOR TO BEGINNING CONSTRUCTION. ANY UTILITIES OR FACILITIES DAMAGED DURING THE PROJECT BY THE CONTRACTOR OR EQUIPMENT SHALL BE PROMPTLY REPAIRED AT THE CONTRACTOR'S EXPENSE.
8. DEPOSITING OR BURYING, ON THE SITE, DEBRIS RESULTING FROM THE CLEARING AND GRUBBING IS **PROHIBITED**. NO DEBRIS RESULTING FROM CLEARING AND GRUBBING SHALL NOT BE USED AS STRUCTURAL OR ENGINEERED FILL.
9. SHOULD UNSUITABLE SOILS BE DISCOVERED BELOW THE PLANNED GRADE/ELEVATIONS, THE ARCHITECT AND ENGINEER SHALL BE NOTIFIED IMMEDIATELY. GENERALLY, SUCH UNSUITABLE MATERIAL MAY REQUIRE OVER-EXCAVATION EXTENDED BELOW THE REQUIRED ELEVATIONS. ANY SUCH ADDITIONAL EXCAVATION SHALL BE DIRECTED BY THE ARCHITECT AND ENGINEER.
10. COMPACTOR FOR EARTHWORK SHALL BE AS APPROPRIATE FOR THE TYPE OF SOIL MATERIAL AT THE SITE TO ACHIEVE THE COMPACTION REQUIREMENTS IN ACCORDANCE WITH CONTRACT DOCUMENTS.
11. ALL DISTURBED AREAS SHALL BE RESTORED AND GRADED TO DRAIN. THE CONTRACTOR SHALL SEED AND MULCH ALL DISTURBED AREAS AND STOCKPILES.
12. THIS PROJECT IS PARTLY LOCATED WITHIN THE 100 YEAR FLOODPLAIN PER THE FEMA MAP. FEMA MAP 54081C0451E.

CONSTRUCTION SEQUENCE - SITE WORK

1. INSTALL STABILIZED CONSTRUCTION ENTRANCE AND ALL PERIMETER EROSION AND SEDIMENT CONTROLS AS SHOWN ON THE PLANS AND MAINTAIN EACH FOR THE LIFE OF THE PROJECT OR UNTIL THERE IS MINIMUM 70% GROWTH ESTABLISHED OVER THE ENTIRE PROJECT AREA.
2. COMPLETE ALL ROUGH GRADING OPERATIONS.
3. INSTALL SIDEWALK.
4. REMOVE AND REPLACE EXISTING SECURITY SLIDE GATES.
5. INSTALL BASE STONE AND COMPLETE ASPHALT PAVING OPERATIONS.
6. COMPLETE PAVEMENT MARKINGS.
7. COMPLETE FINAL PROJECT CLEANUP.

EROSION AND SEDIMENT CONTROL NOTES

1. THE CONTRACTOR SHALL PROVIDE TEMPORARY EROSION AND SEDIMENT CONTROL MEASURES AND OTHER ACTIONS AS PER THE APPROVED PROJECT SWPPP. THE CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING OR MODIFYING BEST MANAGEMENT PRACTICES DURING CONSTRUCTION IN ORDER TO PREVENT EROSION AND SEDIMENTATION. ALL EROSION AND SEDIMENT CONTROL MEASURES SHALL BE IN ACCORDANCE WITH WEST VIRGINIA DEPARTMENT OF ENVIRONMENTAL PROTECTION DIVISION OF WATER AND WASTE MANAGEMENT 2024 NATIONAL POLLUTANT DISCHARGE ELIMINATION SYSTEM (NPDES) GENERAL WATER POLLUTION CONTROL PERMIT FOR STORMWATER ASSOCIATED WITH CONSTRUCTION ACTIVITIES (GENERAL PERMIT) AND THE WEST VIRGINIA EROSION AND SEDIMENT CONTROL BEST MANAGEMENT PRACTICE MANUAL FOR STANDARD GUIDELINES AND SPECIFICATIONS (LATEST EDITION).
2. CONTRACTOR SHALL INSTALL RAIN GAUGE WITHIN THE PROJECT BOUNDARY OR AS REQUIRED IN THE GENERAL PERMIT.
3. CONTRACTOR SHALL INSTALL STABILIZED CONSTRUCTION ENTRANCE(S) AND MAINTAIN FOR THE LIFE OF THE PROJECT AS REQUIRED.
4. CONTRACTOR SHALL INSTALL ALL REQUIRED BEST MANAGEMENT PRACTICES (BMP) AS SHOWN ON THE PLANS AND AS DIRECTED BY THE ENGINEER, AND MAINTAIN BMP FOR THE LIFE OF THE PROJECT. ALL BMP SHALL BE MAINTAINED IN ACCORDANCE WITH THE GENERAL PERMIT AND BMP MANUAL.
5. THE PROJECT IS NOT LOCATED IN A TOTAL MAXIMUM DAILY LOAD (TMDL) IMPAIRED WATERSHED, SO ENHANCED BMP ARE NOT REQUIRED.
6. INSPECT ALL EROSION AND SEDIMENT CONTROLS AT LEAST ONCE EVERY SEVEN (7) CALENDAR DAYS AND WITHIN 24 HOURS AFTER ANY PRECIPITATION EVENT GREATER THAN 0.50 INCHES PER 24 HOURS PERIOD, UNLESS SUCH INSPECTIONS ARE NOT PRACTICABLE WITHIN 24 HOURS, IN WHICH CASE THAT FACT SHALL BE NOTED IN THE INSPECTION REPORT.
7. CONTRACTOR SHALL COMPLETE ANY NECESSARY BMP REPAIRS AND/OR MAINTENANCE IMMEDIATELY OR AS SOON AS PRACTICABLE AFTER THE INSPECTION. COMPLETED REPAIRS SHALL BE RE-INSPECTED NO LATER THAN THE NEXT INSPECTION DATE. IF REPAIRS CANNOT BE COMPLETED BETWEEN INSPECTIONS, THAT FACT SHALL BE EXPLAINED ON THE INSPECTION REPORT AND SUCH EXPLANATION SHALL INCLUDE AN ANTICIPATED COMPLETION DATE.
8. STRIP AND STOCKPILE TOPSOIL TO BE RE-SPREAD IN DISTURBED AREAS UPON COMPLETION OF EARTH MOVING OPERATIONS. TOPSOIL SHALL BE RE-DISTRIBUTED ON ALL DISTURBED AREAS TO BE STABILIZED PRIOR TO SEEDING.
9. CONTRACTOR SHALL STABILIZE ALL EMBANKMENTS UPON COMPLETION. STABILIZATION MEASURES SHALL BE INITIATED AS SOON AS PRACTICABLE IN PORTIONS OF THE SITE WHERE CONSTRUCTION ACTIVITIES HAVE TEMPORARILY OR PERMANENTLY CEASED, BUT IN NO CASE MORE THAN SEVEN (7) CALENDAR DAYS AFTER THE CONSTRUCTION ACTIVITY IN THAT PORTION OF THE SITE HAS PERMANENTLY CEASED. TEMPORARY SEED AND MULCH SHALL BE APPLIED TO AREAS THAT WILL NOT BE RE-DISTURBED FOR MORE THAN TWENTY-ONE (21) CALENDAR DAYS. PERMANENT SEED AND MULCH SHALL BE APPLIED TO AREAS AT FINISH GRADE.
10. WHERE THE INITIATION OF STABILIZATION MEASURES WITHIN SEVEN (7) CALENDAR DAYS AFTER CONSTRUCTION ACTIVITY TEMPORARILY OR PERMANENTLY CEASES IS PRECLUDED BY SNOW COVER, STABILIZATION MEASURES SHALL BE INITIATED AS SOON AS CONDITIONS ALLOW.
11. WHERE CONSTRUCTION ACTIVITY WILL RESUME ON A PORTION OF THE SITE WITHIN TWENTY-ONE (21) CALENDAR DAYS FROM WHEN ACTIVITIES CEASED (E.G., THE TOTAL TIME PERIOD THAT CONSTRUCTION ACTIVITY IS TEMPORARILY HALTED IS LESS THAN TWENTY-ONE (21) CALENDAR DAYS), THEN STABILIZATION MEASURES DO NOT HAVE TO BE INITIATED ON THAT PORTION OF THE SITE BY THE SEVENTH (7TH) DAY AFTER CONSTRUCTION ACTIVITIES HAVE TEMPORARILY CEASED.
12. SEEDBED PREPARATION: AREAS TO BE SEEDED SHALL BE FREE OF ROCKS AND STONES, DISKED TO A DEPTH OF 4-IN TO 6-IN, AND SMOOTHLY GRADED.
13. SEEDING METHOD: SEED MAY BE BROADCAST BY HYDROSEEDER OR MANUALLY AS FOLLOWS: BY HAND WITH A CYCLONE SEEDER, OR FERTILIZER SPREADER. IF A MANUAL METHOD IS USED, DIVIDE THE SEED INTO TWO LOTS AND BROADCAST THE SECOND PERPENDICULAR TO THE FIRST.
14. AREAS WHERE THE SEED HAS FAILED TO GERMINATE ADEQUATELY (UNIFORM PERENNIAL VEGETATIVE COVER WITH A DENSITY OF 70%) WITHIN THIRTY (30) CALENDAR DAYS AFTER SEEDING AND MULCHING MUST BE RE-SEEDED IMMEDIATELY, OR AS SOON AS WEATHER CONDITIONS ALLOW.
15. **TEMPORARY STABILIZATION**
 DATES: MARCH 1 THROUGH JUNE 15
 SEED: OATS @ 168 LB/AC
 DATES: AUGUST 15 THROUGH NOVEMBER 1
 SEED: RYE @ 120 LB/AC
 FERTILIZER: 10-10-10 @ 400 LB/AC
 NOTE: FOR STABILIZATION OUTSIDE SEEDING DATES, USE HAY OR STRAW MULCH AT 3 TONS/AC OR AT 2 TONS/AC IF ASPHALT EMULSION IS APPLIED AT 100 GAL/AC.
16. **PERMANENT STABILIZATION**
 DATES: MARCH, APRIL, AUGUST, & SEPTEMBER
 SEED: KY-31 TALL FESCUE @ 50 LB/AC
 FERTILIZER: 10-20-10 @ 1000 LB/AC
 LIME: 3 TONS/AC OR PER SOIL TEST RESULTS
 MULCH: HAY OR STRAW @ 2 TONS/AC OR @ 1.5 TONS/AC WITH ASPHALT EMULSION @ 125 GAL/AC

CONTACTS

- MISS UTILITY**
800-245-4848
www.wv811.com
- NATIONAL RESPONSE CENTER FOR REPORTING CHEMICAL OR OIL SPILLS**
800-424-8802
- STATE EMERGENCY SPILL NOTIFICATION**
800-642-3074
- AMBULANCE, FIRE, LAW ENFORCEMENT**
911
- ASCENT CONSULTING AND ENGINEERING**
MICHAEL NESTOR, P.E., PROJECT MANAGER
mnestor@ascentwv.com
304-933-3463
1700 ANMOORE RD
BRIDGEPORT, WV 26330
- NEW RIVER COMMUNITY AND TECHNICAL COLLEGE**
527 ODD ROAD,
GHENT, WV 25843
866-349-3739
- RALEIGH COUNTY STORMWATER MANAGEMENT**
116 N. HEBER STREET
BECKLEY, WV 25801
304-255-9173
- RALEIGH COUNTY PLANNING & ZONING**
116 N. HEBER STREET
BECKLEY, WV 25801
304-255-9173
- AMERICAN ELECTRIC POWER COMPANY**
800-956-4237
- SUDDENLINK COMMUNICATIONS**
304-860-1905
- FRONTIER COMMUNICATIONS**
800-921-8101
- FIBERLIGHT**
844-509-0775
- COOL RIDGE - FLAT TOP PSD**
304-763-4151
- SHADY SPRING PSD**
304-255-1565



BID DOCUMENTS
06.09.2026
REVISIONS





ATC RENOVATION
NEW RIVER COMMUNITY & TECHNICAL COLLEGE
527 Odd Rd.
Ghent, WV 25843
EXISTING CONDITIONS



Copyright © All rights reserved. Reproduction in whole or in part is prohibited. This drawing is an instrument of service, is the property of the Architect and may not be used in any way without written permission of this firm.
Project No: 202-0008.001 Drawn by: OTM

LEGEND

- EXISTING STREAM
- EXISTING CONTOURS
- EXISTING EDGE OF PAVEMENT
- EXISTING EDGE OF GRAVEL
- EXISTING FENCE LINE
- EXISTING EDGE OF BUILDING
- EXISTING FIBER OPTIC
- EXISTING SANITARY LINE
- EXISTING CULVERT
- EXISTING POND

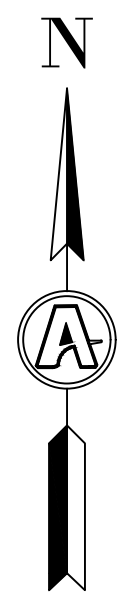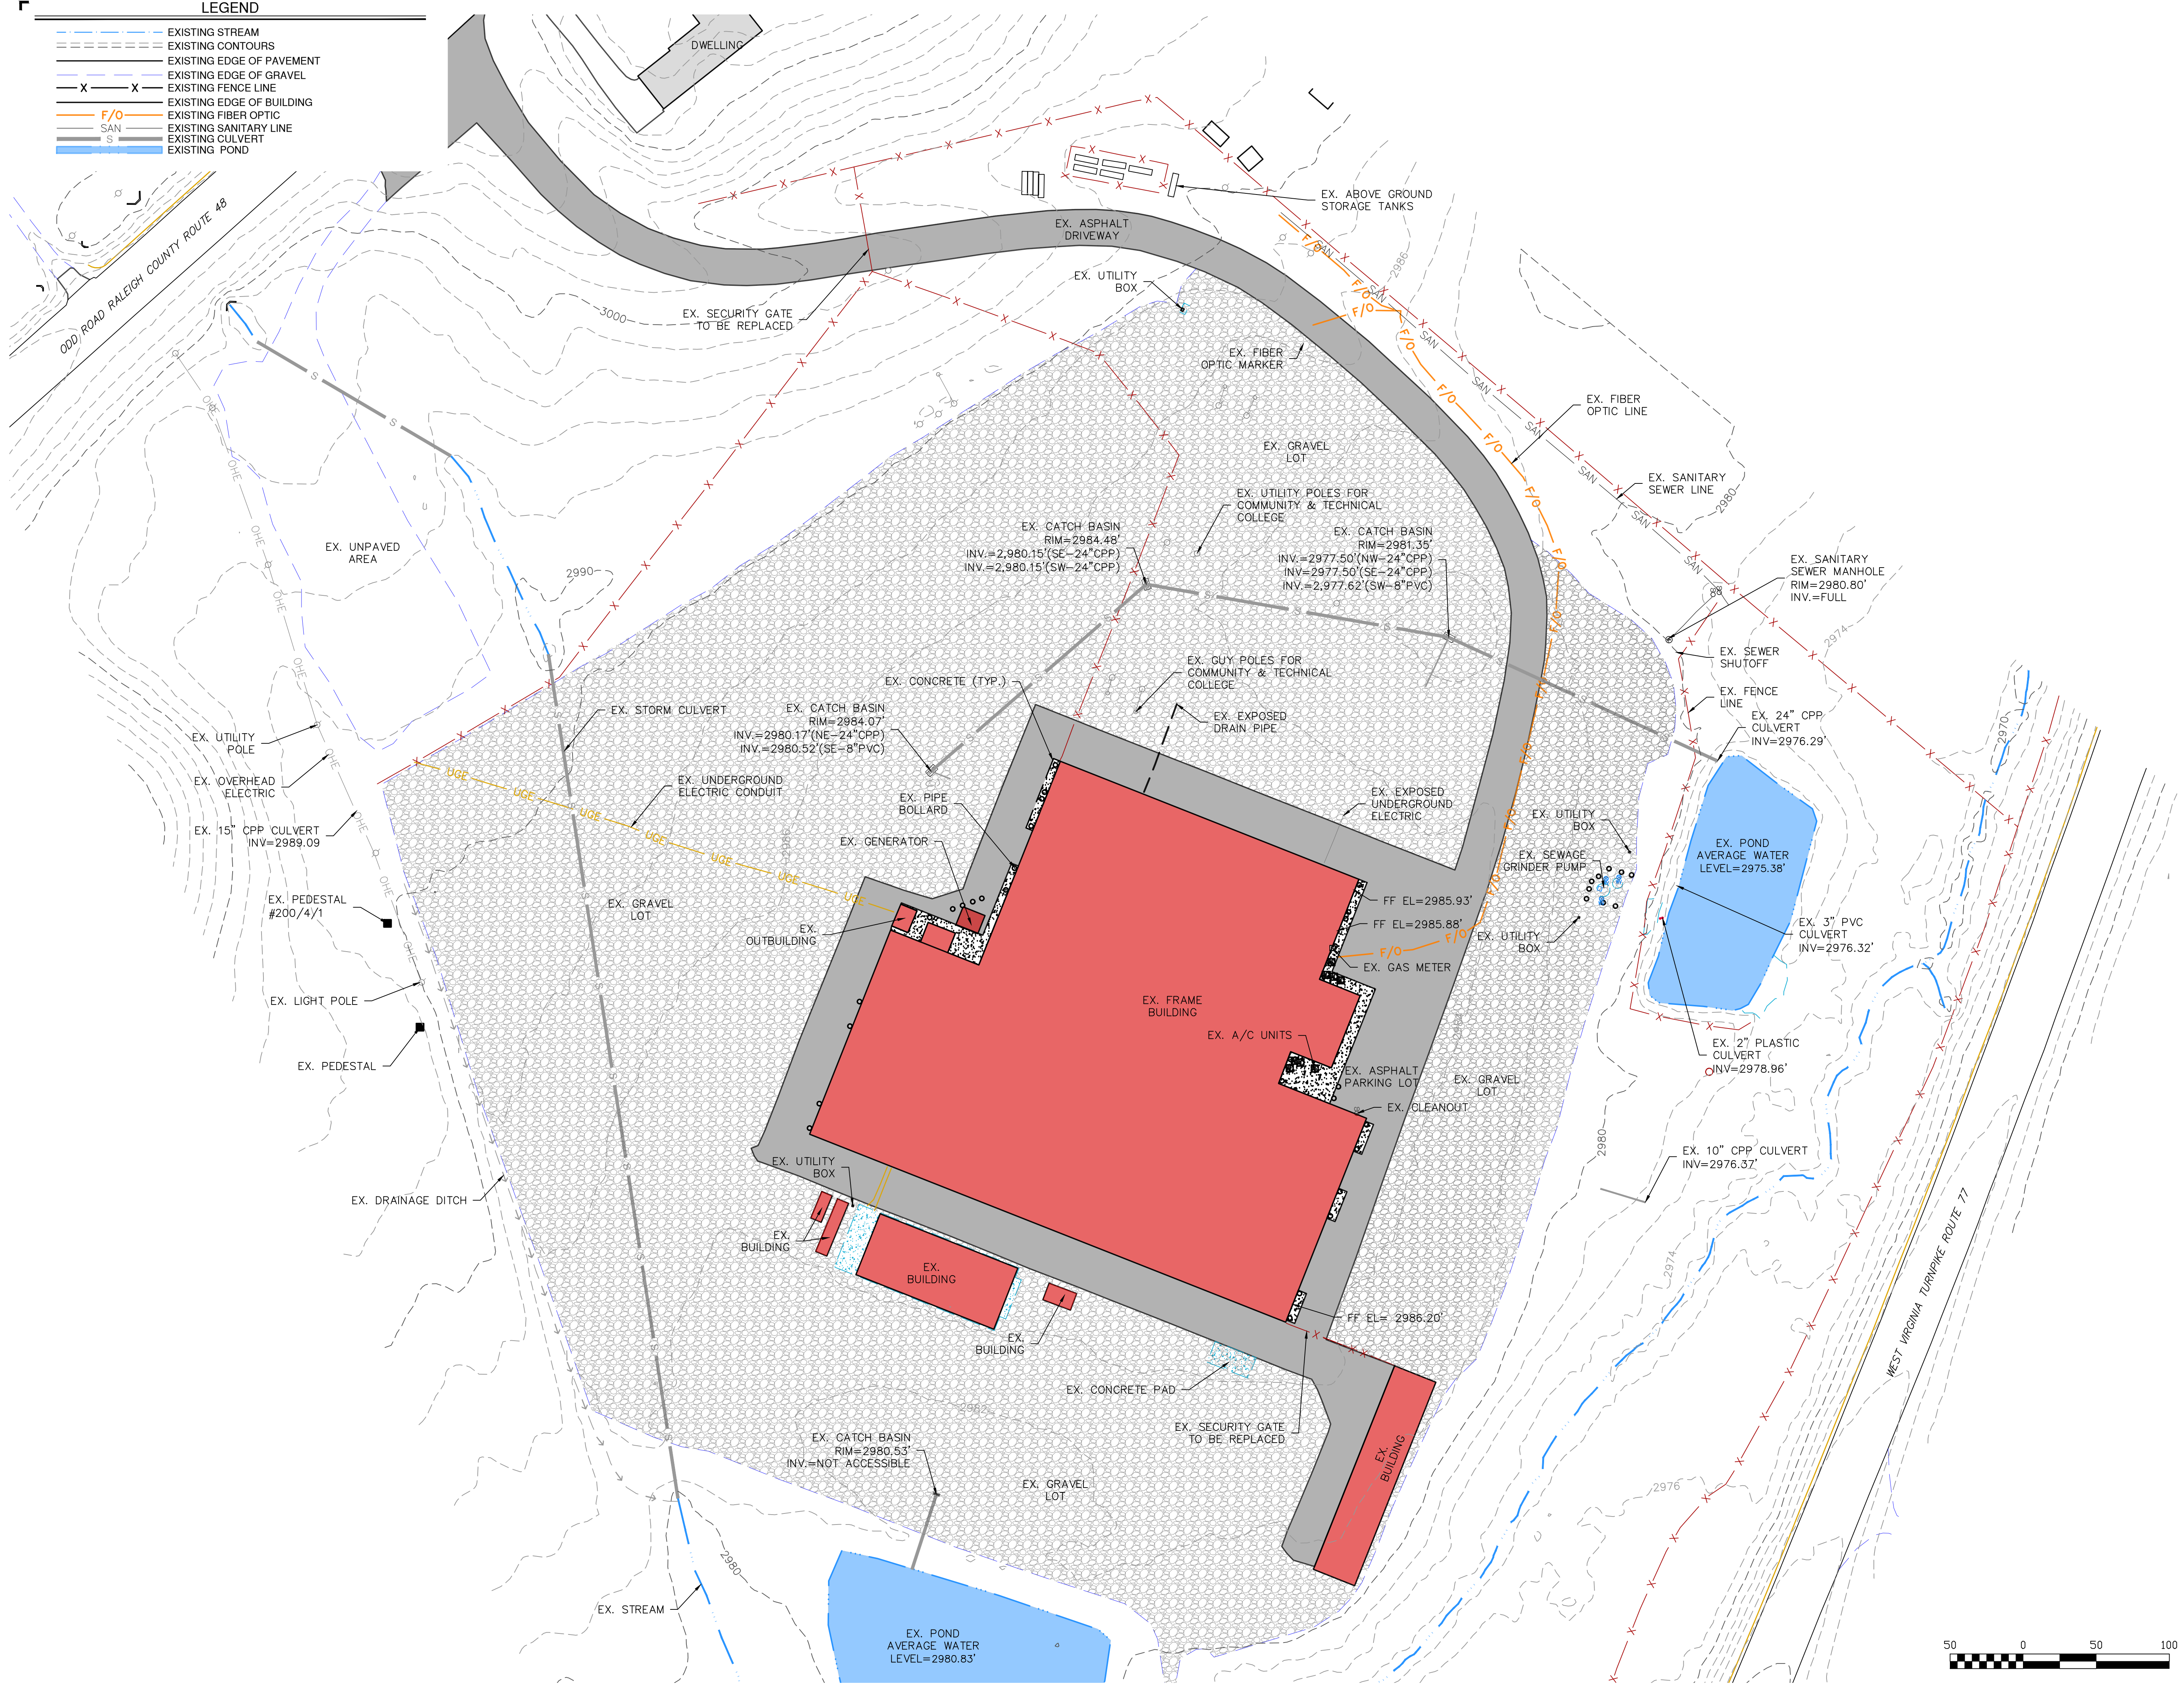





ATC RENOVATION
NEW RIVER COMMUNITY & TECHNICAL COLLEGE
527 Odd Rd.
Ghent, WV 25843
SITE PLAN




LEGEND

| | |
|--|---------------------------|
| | EXISTING STREAM |
| | EXISTING CONTOURS |
| | EXISTING EDGE OF PAVEMENT |
| | EXISTING EDGE OF GRAVEL |
| | EXISTING FENCE LINE |
| | EXISTING EDGE OF BUILDING |
| | EXISTING FIBER OPTIC |
| | EXISTING SANITARY LINE |
| | EXISTING CULVERT |
| | EXISTING POND |
| | PROPOSED HANDICAP PARKING |
| | PROPOSED EDGE OF PAVEMENT |
| | PROPOSED PARKING |
| | PROPOSED GREEN SPACE |
| | PROPOSED ASPHALT |

NOTE: ALL CIVIL ITEMS DEPICTED TO BE INCLUDED IN ALTERNATIVES

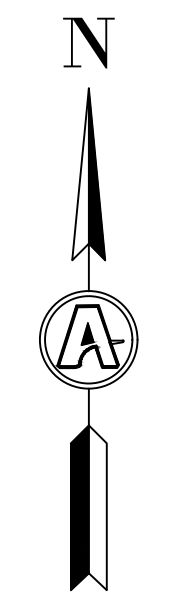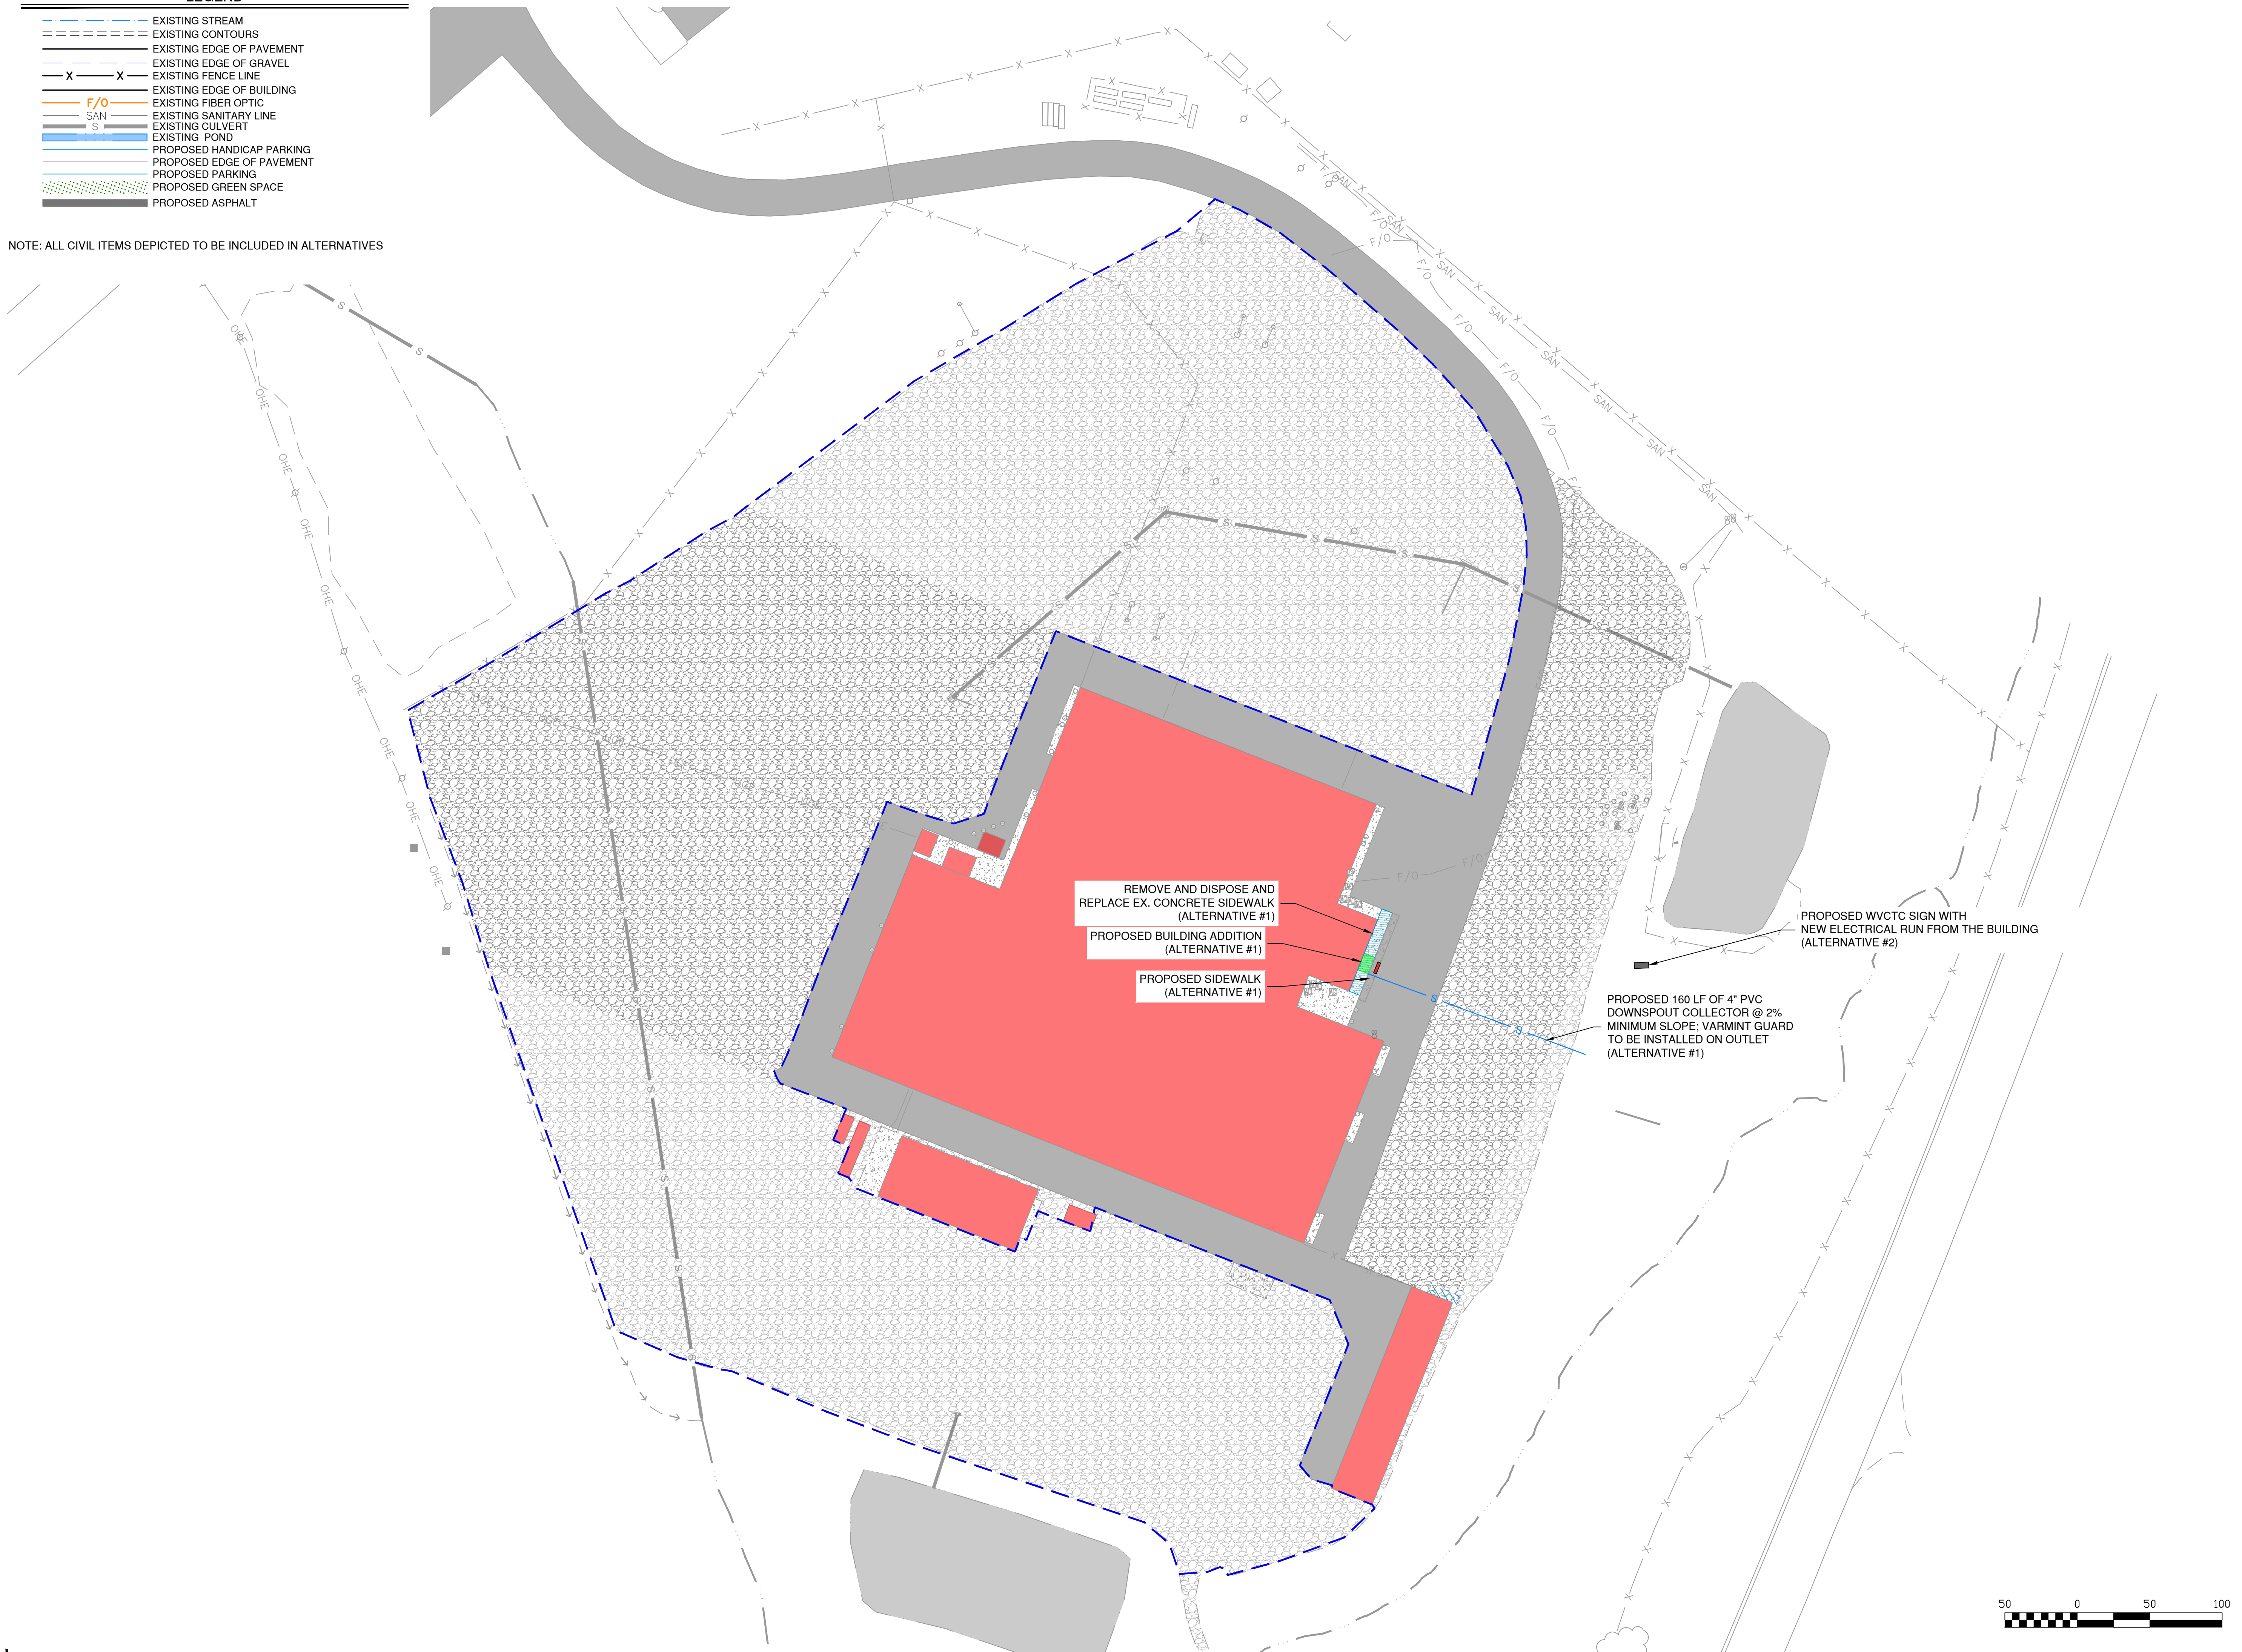


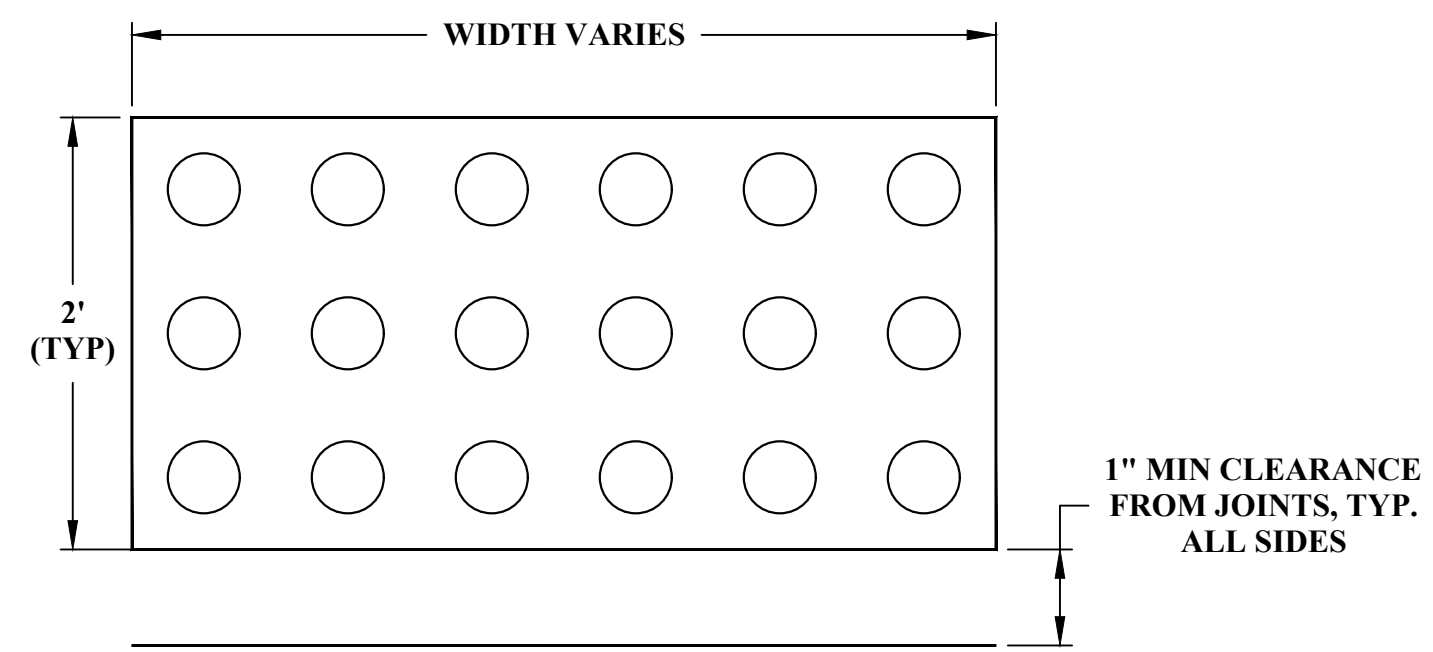

NOTES:

1. DOMES IN DETECTABLE WARNING SURFACE SHALL HAVE A MINIMUM BASE DIAMETER OF 0.9 INCHES TO A MAXIMUM OF 1.4 INCHES
2. DOMES MUST HAVE A TOP DIAMETER THAT IS 50-65% OF THE BASE DIAMETER
3. DOMES MUST BE 0.2 INCHES IN HEIGHT
4. THE DOMES WITHIN THE SURFACE SHALL BE SPACED A MINIMUM OF 1.6 INCHES AND A MAXIMUM OF 2.4 INCHES FROM CENTER TO CENTER.


TRUNCATED DOME
NOT TO SCALE

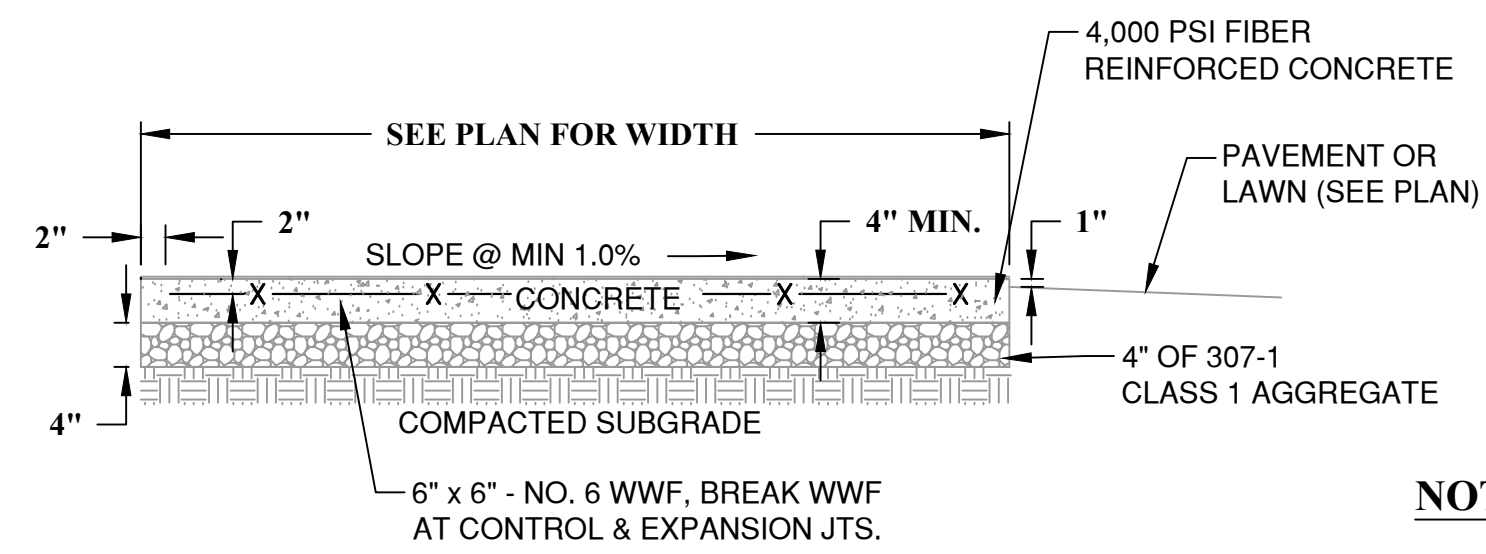

TYPICAL SIDEWALK SECTION
NOT TO SCALE

NOTES:

1. PLACE EXPANSION JOINT WHERE DIFFERENT SIDEWALKS ABUT, AND AGAINST ANY STRUCTURE.
2. PLACE EXPANSION JOINTS 20' O.C.
3. PLACE CONTRACTION JOINS 5' O.C.

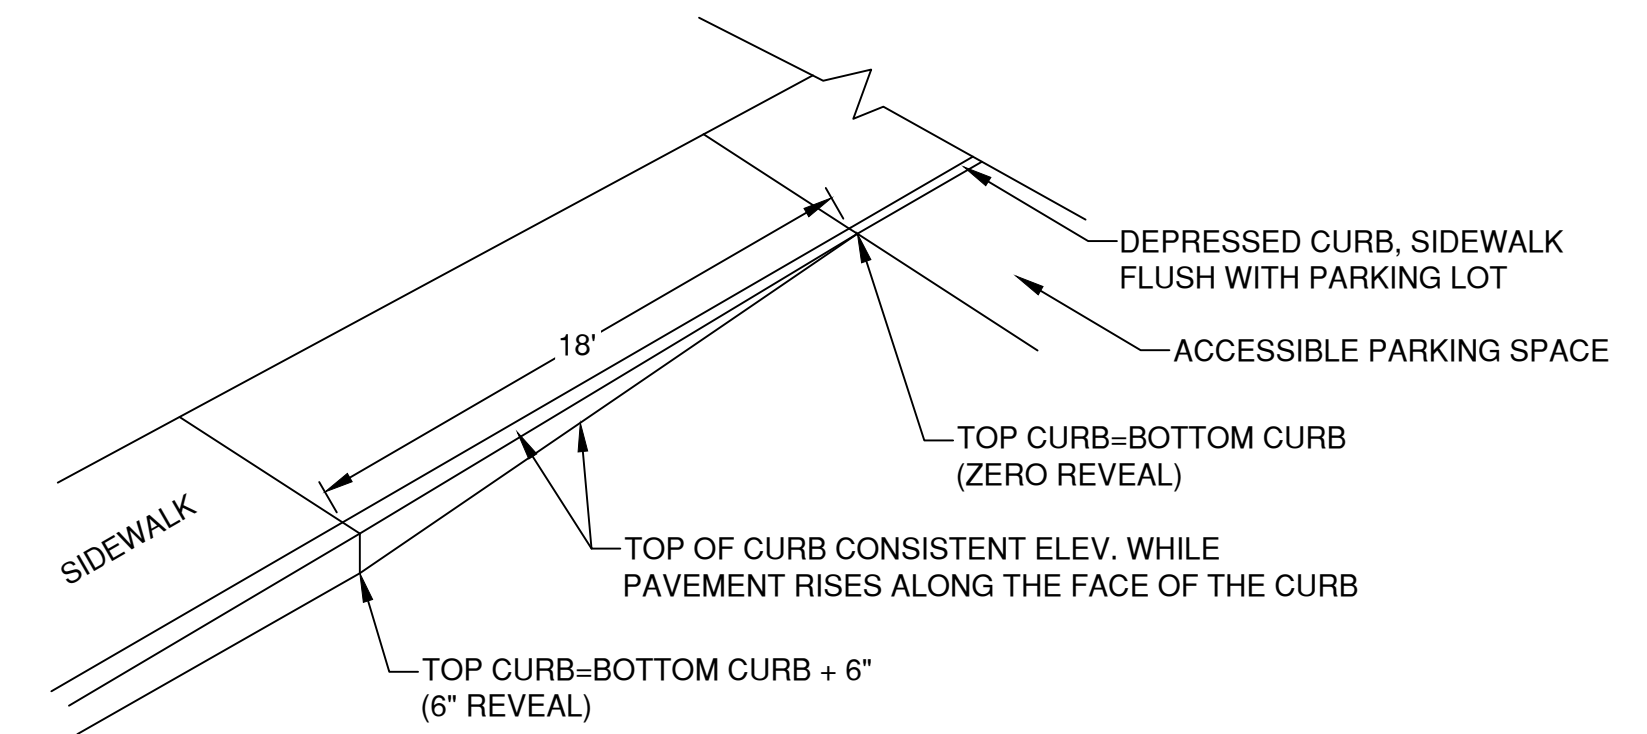

DEPRESSED CONCRETE CURB TRANSITION
NOT TO SCALE



BID DOCUMENTS
06.09.2026

REVISIONS ▼



ATC RENOVATION
NEW RIVER COMMUNITY & TECHNICAL COLLEGE
527 Odd Rd.
Ghent, WV 25843


DETAILS



OMNI
ARCHITECTS

C-4.0

Copyright © All rights reserved. Reproduction in whole or in part is prohibited. This drawing is an instrument of service, is the property of the Architect and may not be used in any way without written permission of this firm.
Project No: 202-0008.001 Drawn by: OTM

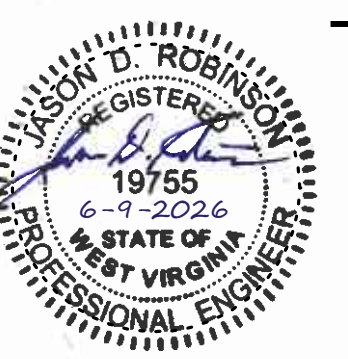

BID DOCUMENTS
06.09.2026

REVISIONS

ATC RENOVATION
NEW RIVER COMMUNITY & TECHNICAL COLLEGE
527 Odd Rd.
Ghent, WV 25843
GENERAL NOTES



S001

Copyright © All rights reserved. Reproduction in whole or in part is prohibited. This drawing is an instrument of service, is the property of the Architect and may not be used in any way without written permission of this firm.
Project No. 2024008.001 Drawn by: jf

PERFORMANCE REQUIREMENTS:

- No provision of any referenced standard specification, manual or code (whether or not specifically incorporated by reference in the contract documents) shall be effective to change the duties and responsibilities of owner, contractor, engineer, supplier, or any of their consultants, agents, or employees from those set forth in the contract documents. Nor shall it be effective to assign to the structural engineer of record or any of the structural engineer of record's consultants, agents, or employees any duty or authority to supervise or direct the furnishing or performance of the work or any duty or authority to undertake responsibilities contrary to the provisions or the contract documents.
- Contract documents include, but are not limited to, the structural documents (drawings and specifications), but do not include shop drawing, vendor drawings, or materials prepared and submitted by the contractor.
- Reference to standard specifications or any technical society, organization, or association or to codes of local or state authorities, shall mean the latest standard, code, specification or tentative specification adopted at the date of taking bids, unless specifically stated otherwise.
- Contract documents shall govern in the event of a conflict with the code of practice or specifications of ACI, PCI, AISC, SJI, or other standards. Where a conflict occurs within the contract documents, the strictest requirement shall govern.
- Contractor shall obtain and coordinate edge of slab and roof deck edge dimensions, opening locations and dimensions, depressed slab locations and extents, slab slopes, curb locations, and CMU wall location. Architect/Structural engineer shall be notified of any discrepancy or omission. In the event of discrepancies, the non-structural architectural details shall govern.
- Contractor shall verify existing dimensions, elevations, and site conditions before starting work. Architect/Structural engineer shall be notified of any discrepancy.
- Contractor shall verify the structurally supported mechanical equipment weights, opening sizes, and locations identified on the structural drawing with architectural and mechanical drawings.
- Contractor shall verify that miscellaneous framing shown on the structural drawings for mechanical equipment, owner-furnished items, partitions, etc. is consistent with the requirements of such items.
- Contractor has responsibility for means, methods, safety, techniques, sequences, and procedures of construction.
- The structure is stable only in its completed form. Temporary supports required for stability during all intermediate stages of construction shall be designed, furnished, and installed by the contractor. Contractor is responsible for constructability analysis, and erection procedures, including design and erection of framework, temporary bracing, etc.
- Contractor has sole responsibility to comply with all OSHA regulations.
- Reproduction of structural drawings for shop drawings is not permitted.
- Electronic drawing files will not be provided to the contractor.
- Structural engineer of record is not responsible for the design of steel stairs, handrails, curtain wall/window systems, cold-formed metal framing, toilet partition supports, shelf systems, or other systems not shown in the structural documents; such systems shall be designed, furnished, and installed by others as required by other portions of the contract documents.
- Structural Engineer shall not be responsible for specifying all waterproofing details and elements on the superstructure and below grade structures.
- General Contractor shall review and coordinate elevator rail and hoist requirements with structural drawings. Notify structural engineer immediately if changes are required.

CONSTRUCTION MEANS AND METHODS

- Contractor agrees that Contractor shall assume sole and complete responsibility for job site conditions during the course of the Work, including safely of all persons and property; that this requirement shall apply continuously and not be limited to normal working hours; and that Contractor shall defend, indemnify, and hold Owner and Structural Engineer harmless from any and all liability, real or alleged, in connection with the performance of the Work on this Project, excepting for liability arising from the sole negligence of Owner or Structural Engineer.
- The Contract Documents represent the finished structure. They do not include the method of construction. Contractor shall provide all measures necessary to protect the structure during construction. Such measures shall include, but not be limited to: protection of subgrade from freezing conditions, bracing, shoring for loads due to construction equipment, temporary structures, and partially completed work. Observation visits to the site by Structural Engineer shall not include inspection of the above items.
- ADS Consulting Engineers shall not have control over or charge of and shall not be responsible in any way for construction means, methods, techniques, sequences, or procedures, or safety or safety precautions and programs in connection with any construction activities, since these are solely Contractor's responsibility under the Contract.
- ADS Consulting Engineers shall not be responsible for Contractor's schedule or failures to carry out any construction activities in accordance with the Contract Documents. ADS Consulting Engineers shall not have control over or charge of actions of Contractor, Subcontractor, or any of their Agents, or employees, or any other persons performing portions of any construction activities.
- The structure is stable only in its completed form. Temporary supports required for stability of the structure during all intermediate stages of construction shall be designed and provided by Contractor.

STRUCTURAL STEEL:

- All structural steel work shall be in accordance with the "Specifications for the Design, Fabrication, and Erection of Structural Steel Buildings" (14th Edition) of the AISC. Maintain copy of each on job site during construction.
- Structural steel shall conform to the following:
 - Wide flange shapes and WT's - ASTM A992 with a minimum yield strength of 50,000 PSI.
 - Channels, angles, plates, and miscellaneous connection material - ASTM A36 with a minimum yield strength of 36,000 PSI unless noted otherwise.
 - Pipes - ASTM A501 with a minimum yield strength of 36,000 PSI or ASTM A53 Type E or S with a minimum yield strength of 35,000 PSI.
 - Tubes - ASTM A500, Grade B with a minimum yield strength of 46,000 PSI.
- All bolts shall be 3/4" dia. unless noted otherwise ASTM A325 H.S. bolt of either friction or bearing type. Use slip critical connections for all wind bracing connections. Threads shall be included in the shear plane.
- All bolted connections shall be made according to AISC Table II or III framed beam connections. The minimum depth of connection must be more than one half the depth of the beam except that beams framing to columns shall have full depth connections using 3/8" connection angles or plates. Contractor shall provide certified design for all shear connections by a Professional Engineer in the state in which the project is located. Submit calculations for moment connections using braced member capacity U.N.O. on plans. Minimum end reaction of beams:
 - W8's = 10 kips
 - W10's= 12 kips
 - W12's= 16 kips
 - W14's= 18 kips
 - W16's= 20 kips
 - W18's= 22 kips
 - W21's= 24 kips
 - W24's= 26 kips
- When using AISC Tables all composite beam connections shall be designed, u.n.o., for an end reaction "R" equal to not less than the following:
 - For beam depths greater than 21"-----Rc=1.5xR
 - For beam depths greater than or equal to 14" but less than 21"-----Rc=2.0xR
 - For beam depths greater than or equal to 8", but less than 14"-----Rc=2.25xR
 If reactions are shown on plans, use the plan reactions regardless.
- All welding shall be in strict accordance with the standards of the AWS and the AISC. Use E70XX electrodes.
- Contractor shall submit Welders' certificates in accordance with AWS B2.1B2.1M. It shall be dated no more than 12 months before start of scheduled welding work.
- Do not paint steel where encased in concrete or at field weld areas.
- No shop or field holes or cuts are to be placed in structural members unless indicated on the contract or shop drawings.
- The Structural Steel Fabricator shall field verify all dimensions prior to fabrication. Particularly for stairs, handrail systems, etc.
- The Structural Steel Fabricator shall provide for vertical and horizontal adjustment of all support assemblies.
- The Structural Steel Fabricator and/or the General Contractor shall verify all existing dimensions and conditions at the site. All discrepancies found shall be reported to the Architect prior to preparation of shop drawings. Shop drawings shall include all field measurements and conditions.
- Expansion bolts: Use expansive anchors of the diameter indicated on the drawings as manufactured by HILTI Fastening Systems or approved equal.
 - In concrete, use HSL Heavy Duty Anchors.
 - In brick and CMU, use sleeve and fill CMU cells at all bolt locations.
- Anchor bolts must meet ASTM A1554 gr. 36 specifications and be 3/4" diameter (unless otherwise indicated).
- The Structural Steel Fabricator shall provide all supports for any precast concrete panels as indicated on the drawings and as required by the manufacturer. Location of such supports shall be coordinated with the manufacturer.
- The Structural Steel Fabricator, Precast Concrete Supplier, and the General Contractor shall coordinate all support and tie-back locations and connections, if applicable.
- All galvanizing shall be per ASTM A123 and A780. All steel exposed to the elements and masonry support members shall be galvanized. Backup steel supporting masonry veneer and precast support angles shall be zinc primed and painted.
- Refer to architectural and mechanical drawings for possible miscellaneous steel. This steel shall also conform to the requirements in these General Notes and the Structural Steel specifications.
- Steel fabricator shall be certified under the AISC quality Certification Program.
- 75% of field welds shall be visually inspected and tested using one of the following:
 - Radiographic testing performed in accordance with ASTM E94/E94M
 - Ultrasonic testing performed in accordance with ASTM E164
 - Liquid penetrant inspection performed in accordance with ASTM E165/165M
 - Magnetic particle inspection performed in accordance with ASTM E709
- All shear studs shall be 3/4" diameter x 1 1/2" taller than the metal deck height. (1 1/2" deck + 1 1/2" = 3")
- Steel fabricator shall review Architectural drawings and include all miscellaneous steel in their bid. If notes on architectural drawings refer to "see structural" and the structural drawings do not address this item notify the E.O.R. at least two weeks prior to bid opening to allow time for issue of addendum.
- Column Schedule may not include all columns on the project. Review all drawings to insure all columns are included in bid.
- Steel lintels can be replaced with engineered reinforced precast lintels. Mfgr shall submit certified Engineer design with lintel submittal.
- Support for RTU's shall be limited to framed opening steel around roof openings. Additional steel required for RTU support shall be designed and provided by the General Contractor with coordination with the RTU manufacturer.

MASONRY WORK:

- Masonry work shall conform to the references and standards listed in the Project Manual.
- Maximum lateral deflection is to be limited to L/360.
- Vertical control joints shall be located at a maximum 15ft. o.c.
- Mortar shall be ASTM C270, Type S, 2500 PSI minimum.
- Grout shall conform to ASTM C476. Use fine grout for collar joints 1" wide or less and when grouting cells of hollow masonry units with or without vertical reinforcing. Use coarse grout when grouting bond beams.
- Wall construction under masonry bearing structural members shall be as follows, unless otherwise noted:
 - Provide solid masonry, 32" long and 16" high, centered under each wall bearing open web steel joist supporting roof loads.
 - Provide solid masonry, 32" long and full height of wall to the footing, centered under each wallbearing steel beam or cast-in-place concrete beam.
- All masonry walls shall have galvanized horizontal reinforcing of one of the following:
 - Truss type 3/16" side rods and #9 gage cross rods, for all non-reinforced walls, spaced 16" on-center vertically.
 - Ladder type 3/16" side rods and #9 gage cross rods, for all vertically reinforced or grouted walls, spaced 16" on-center vertically.
- Conventional reinforcing bars, horizontal and vertical, shall be ASTM A615, Grade 60.
- All units shall be laid with full mortar coverage on head, bed (face shells), and webs, unless otherwise noted.
- All new wall construction shall have a bond beam coarse set at the each floor level and at the top row with 2-#5's continuous in each level of bond beam. U.N.O. Do not exceed 12 ft. vertical wall height without a bond beam.
- For all air spaces behind veneer below grade, fill space with min. 2500 psi grout, unless noted otherwise on Architectural drawings.
- For all HVAC penetrations through CMU walls General Contractor shall coordinate locations with all trades. Opening locations shall be determined upon coordination with HVAC contractor. Notify Architect and Engineer of Record for review of determination of lintel requirements. All openings greater than 24" shall have a lintel above the wall opening. In bearing walls duct openings shall not be closer than 8" to the floor above.
- Minimum quality assurance requirements shall be per Table 1.15.2, ACI 530/ASCE5/TMS402. Contractor shall submit a written Quality Assurance Program in accordance with Table 1.15.2. Inspection results shall be provided to Architect no less than monthly over the course of the masonry installation.
- Lap splices in masonry shall conform to TMS 402/ACI 530/ASCE 5 Section 2.1.3.7.1.1. The minimum length of lap splices for reinforcing bars in tension or compression, *l_d*, shall be:
 - db* - *l_d* (inches)
 - #3 - 11"
 - #4 - 18"
 - #5 - 29"
 - #6 - 41"
 - #7 - 53"
 - #8 - 72"
 - #9 - 92"
- All reinforcement welding shall conform to AWS D1.4. Welded splices shall be of ASTM A706 steel reinforcement. Reinforcement larger than No. 9 (M #29) shall be spliced using mechanical connections in accordance with section 2.1.9.7.3.

FOUNDATIONS:

- Foundation design is based on an assumed allowable soil bearing pressure of 1,500 psf. A professional geotechnical engineer licensed in the state of West Virginia shall verify this assumption before construction. Structural engineer is not responsible for subsurface conditions encountered in the field different from those assumed for design.
 - Foundations are indicated on the drawings as either drilled piers or spread footings, based on an interpretation of information provided in the geotechnical report. After excavation to the bearing elevation and after evaluation of the bearing medium, it may be necessary to revise the foundation design from a drilled pier to a spread footing or from a spread footing to a drilled pier. The minimum length of drilled piers shall be 2.0 times the diameter of the drilled pier. If auger refusal is reached at an elevation where the length of a drilled pier would be less than 2.0 times the diameter of the drilled pier, then a rock socket shall be provided. The total length of the drilled pier, including the portion of the drilled pier socketed into rock, shall be a minimum of 2.0 times the diameter of the drilled pier.
- For spread footings where the soil or rock capable of supporting the minimum specified geotech report bearing capacity is below the bottom of the footing elevation, based on the top of footing elevation shown on the drawings, the top of the footing shall be maintained, and a plain concrete pad, consisting of concrete with a 28-day compressive strength of 3000 PSI and utilizing type I cement, shall be placed under the footing. The plansize of the plain concrete pad shall be at least as large as the spread footing. Foundations for miscellaneous foundation walls, cantilevered retaining walls, and miscellaneous structures shall consist of individual and continuous spread footings and shall bear on soil capable of supporting 1,500 psf.
- Notify the Architect of any unusual soil conditions that are in variance with the test borings, such as ground water, substandard bearing material, or obstructions.
- Refer to Foundation Plan for footing elevations. Elevations shown are "top of concrete".
- Backfilling against foundation or pit walls will not be permitted until supporting floors at the top of these walls are in place and able to provide full support to the imposed loads. Proper temporary bracing may be used in lieu thereof with prior approval of the Architect. The design of the temporary bracing is the responsibility of the General Contractor. G.C.'s Shoring Design Engineer shall provide a certified design for approval. Shoring forces will be provided by the E.O.R. upon request.
- The General Contractor shall be responsible for the design, installation, and final clearance of any required shoring or bracing.
- Remove all unsuitable fill and replace per the recommendations of the Geotechnical Engineer of record.
- Anchor bolts shall be set in place prior to concrete placement. They shall not be forced into wet concrete.
- Unless noted otherwise in the geotechnical report or specifications, compact all fill under slabs on ground and foundations to 98% of optimum laboratory density in accordance with ASTM D698 Standard Proctor Method. Place fill in 6" to 8" lifts and compact with vibratory tamping equipment.
- Locate existing underground utilities in areas of construction. Contact local authorities for coordination.
- When excavations approach the ground water level, the water level shall be continuously lowered by an acceptable dewatering system so that the water level is maintained continuously a minimum of 2'-0" below the excavation.
- Shale containing pyrites must be protected as indicated in the Geotechnical Report.

DESIGN/CONSTRUCTION DOCUMENTS - EXISTING CONSTRUCTION:

Design and construction documents are based upon assumptions made from available original and field investigation. Information shown may not necessarily reflect actual conditions. The contractor drawings shall field verify or establish the following:

- All dimensions and elevations.
- Existing conditions.
- Existing structural arrangement and sizes in work areas.

The contractor shall notify the Architect of any discrepancies between the design documents and actual conditions. All existing dimensions and conditions shall be reflected on the shop drawings prior to submission for review.

CAST-IN-PLACE CONCRETE:

- Cast-in-place concrete work shall conform to the American Concrete Institute codes and standards listed in the Project Manual except as modified therein or on the drawings. Maintain copy of each on job site during construction.
 - The minimum ultimate compressive strength of concrete at 28 days shall be:
 - 3000 psi - Stair plain infill
 - 4000 psi - All other unless noted otherwise on drawings.
 - Air Content: All concrete exposed to freezing and thawing and/or required to be watertight shall have an air content of 4.5% to 7.5%. All other concrete shall have an air content of 3% to 4%.
- Water Cement Ratio: All concrete subjected to exposed to freezing and thawing in moist condition and/or required to be watertight shall have a maximum water-cement ratio of 0.45. All reinforced concrete exposed to deicing salts, brackish water seawater or spray from these sources, shall have a maximum water-cement ratio of 0.40.
- Maximum aggregate size shall be 1 1/2", well graded, well-shaped (not elongated, flat, or slippery), and free of clay, dirt, and excess fines, U.N.O.
- Aggregate composition shall consist of quartz, limestone, dolomite, granite, or feldspar.
- Cement shall be Type 1, U.N.O.
- Maximum concrete slump 3", U.N.O.
- Reinforcing bars: ASTM A615, Grade 60.
- Welded wire fabric: ASTM A185.
- Provide 6x6-w2.9xw2.9 welded wire fabric in all non-structural slabs on grade, unless otherwise noted.
- Place reinforcement in slabs, 1-1/2" down from top of slab, unless otherwise noted.
- Provide control joints in all non-structural slabs on grade. The maximum spacing of control joints shall be 20'-0" O.C. unless otherwise noted. Control joint depth equal to 1/5 slab thickness not less than 1 inch.
- Reinforcing bar lap splices and anchorage lengths shall conform with ACI 318-11 "Development and Splices of Reinforcement." All splices shall be Type B.
- Top layer of reinforcing steel in slabs and footings shall be considered top bars regardless of thickness of concrete below the bars.
- All horizontal wall bars shall be bent lapped around all corners, unless otherwise noted.
- Provide vertical and horizontal reinforcing bars in concrete walls to conform to the minimum provisions of ACI 318, Section 14.3 unless otherwise noted.
- Chamfer exposed edges of concrete 1/2" unless otherwise noted.
- Refer to architectural drawings for location and extent of finishes or other treatments to exposed concrete.
- Determine size, location and weight of mechanical equipment and make provisions for bolts, sleeves, pads, etc. from manufacturer's certified drawings. This work shall be coordinated with the trades involved.
- All new concrete shall be bonded to previously placed concrete per specification requirements, U.N.O.
- The Contractor shall prepare shop drawings showing detail layouts of reinforcing, including dimensions, openings, and spacing, bending details, bar schedules, and similar items required for the proper construction of the work. Provisions for the connection of work by other trades shall be indicated on the shop drawings. The location of all embedded items shall be indicated by the contractor on the shop drawings. All shop drawings shall be submitted for approval in accordance with the requirements of the Contract Documents.
- Preparing, curing, transporting, and testing concrete cylinders. For each class of concrete placed, at least four cylinders shall be taken for each 50 cubic yards, or fraction thereof, of each class of concrete placed each day. Cylinders are to be taken in accordance with ASTM C31 and results shall be submitted to the Architect/Engineer, Construction Manager and owner. Two cylinders will be tested at 7 days and two at 28 days.

GENERAL STRUCTURAL NOTES:

- Design Code: IBC 2018, Risk Category II
- No provisions have been made for future horizontal or vertical expansion.
- Wind Design Data:
 - Ultimate 3-Second Gust Design Wind Speed: 110 mph
 - Wind exposure classification: C
- A. Internal Pressure Coefficient: +/- 0.18
- Components and Cladding
- B. Design wind pressure for exterior components: 25 psf
4. Earthquake Design Data:
 - Seismic Importance Factor, *I_e* = 1.00
 - Mapped spectral response acceleration parameters: *S_s* =0.227, *S₁* = 0.071
 - Design spectral response acceleration parameters: *S_{DS}* =0.242, *S_{1D}* = 0.113
 - Seismic Site Class: D
 - Seismic Design Category: B
 - Basic Seismic Force Resisting System: Ordinary Steel Moment Frames
5. Live Load data:

Uniform Floor Live Loads:

| Location | Load |
|-------------|---------|
| • Corridors | 100 psf |

Concentrated Floor Live Loads (distributed over an area 2-1/2 sq. ft., unless noted otherwise):

- Office Buildings: 2000 lbs
- Handrail:
- Top Rail: 200 lb. or 50 lb/ft applied non-concurrently in any direction.



Snow Load data:

- Ground Snow Load, *P_g* = 30 psf
- Flat Roof Snow Load, *P_f* = 25 psf (min)
- Snow Exposure Factor, *C_e* = 1.0
- Thermal Factor, *C_t* = 1.0
- Snow Load Importance Factor, *I_s* = 1.0


- General Contractor shall verify all dimensions and conditions related to existing construction, existing services, and the site.
- Construction loads shall not exceed design live loads. Shoring and re-shoring is the responsibility of the General Contractor.

SHOP DRAWINGS:


- See Project Manual - Administrative Requirements for submittal procedures.
- The General Contractor shall review, check, and stamp "Approved" all shop drawings prior to submitting them to the Architect. Shop drawings which have not been stamped "Approved" by the General Contractor do not conform to the requirements of the Contract Documents and will be rejected.
- The General Contractor shall provide a shop drawing submittal schedule to the Architect at least two weeks prior to submittal of the first set of shop drawings.
- Shop drawing submittals and review must precede the start of fabrication. General Contractor proceeds at their own risk without reviewed as noted shop drawings from the Architect. The maximum turn-around time for shop drawings will be two weeks (ten working days) from the date of receipt in the Architect's office to the date of return delivery. General Contractor and Architect shall increase coordination efforts when large numbers of shop drawings are invited.
- Refer to the Project Manual (if available) for specific submittal procedures.
- Shop drawings shall not simply be a copy of the engineer's design drawings with the contractor's title block. Electronic files from the E.O.R. can be provided to the G.C. at a negotiated fee. Fee will be based on amount of subcontractor's contract and benefit to subcontractor.
- Shop drawings shall be completely prepared by the submitting entity.

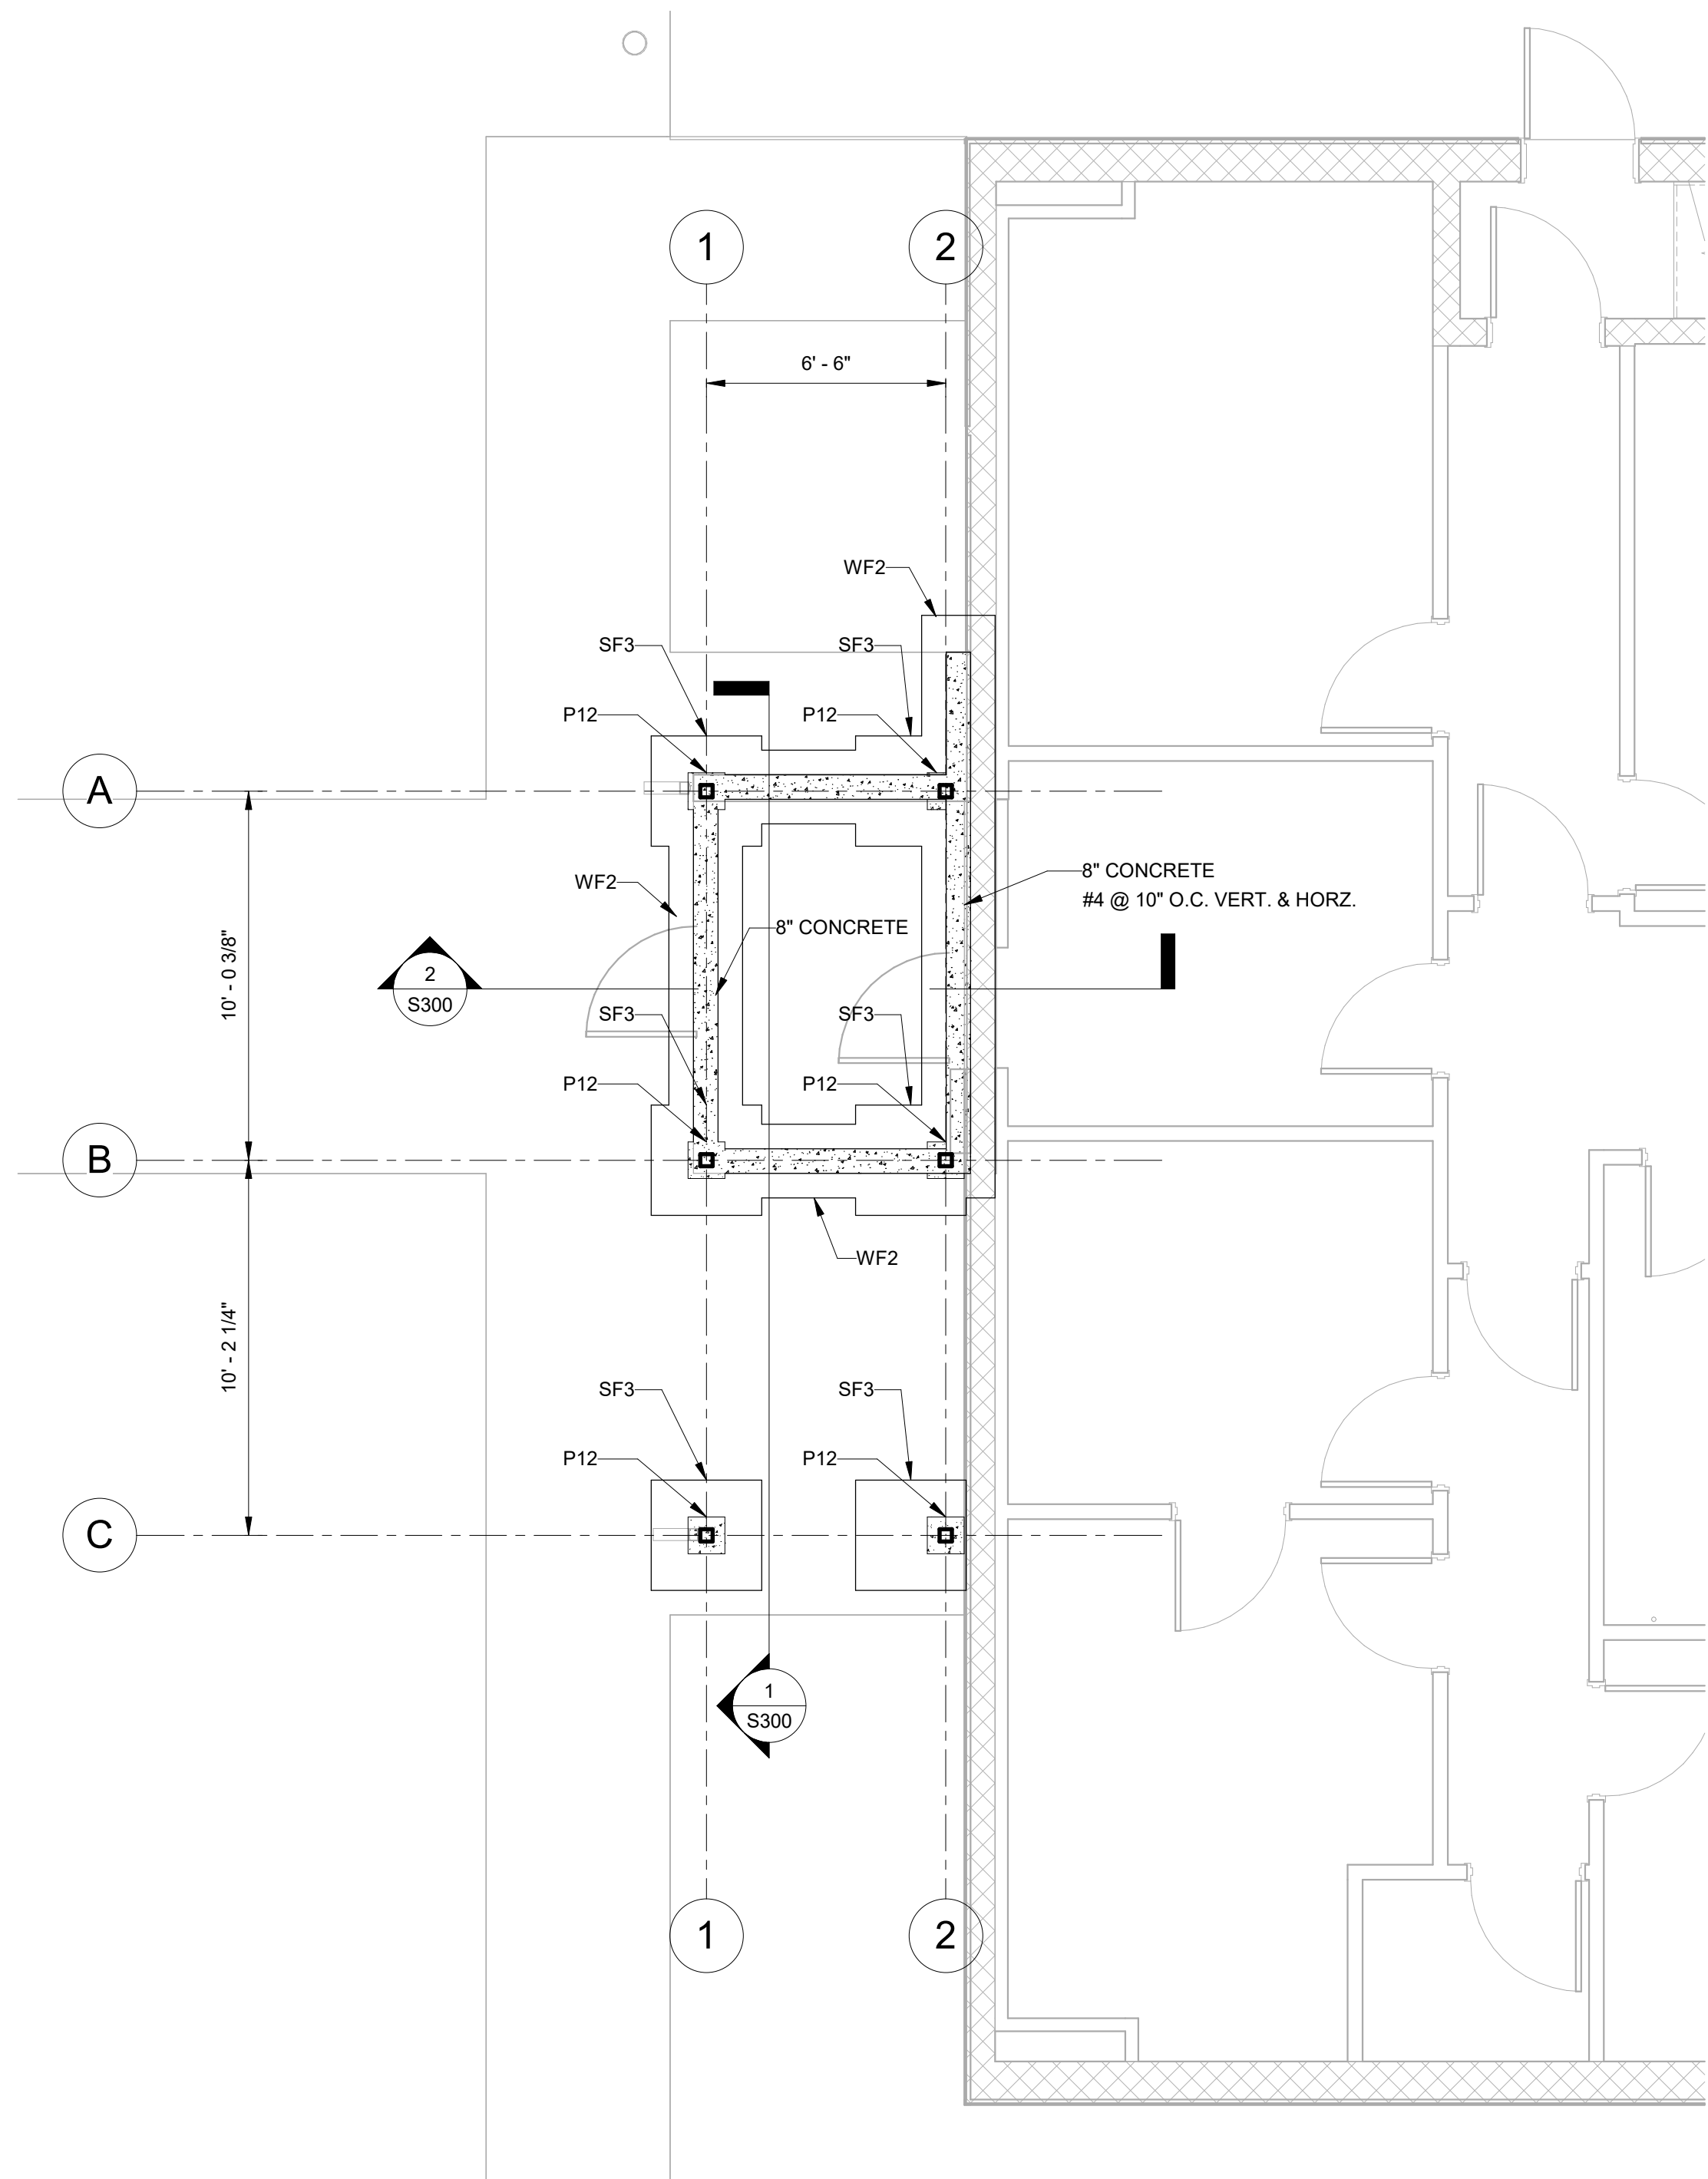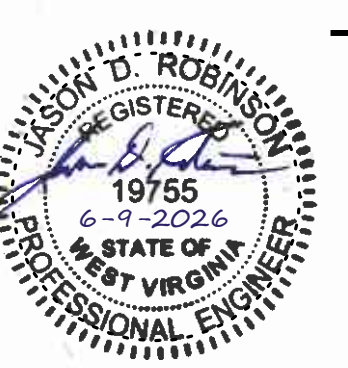

PLAN
FOUNDATION/FIRST FLOOR PLAN (Add Alt #01)
SCALE: 1/4" = 1'-0"
NORTH

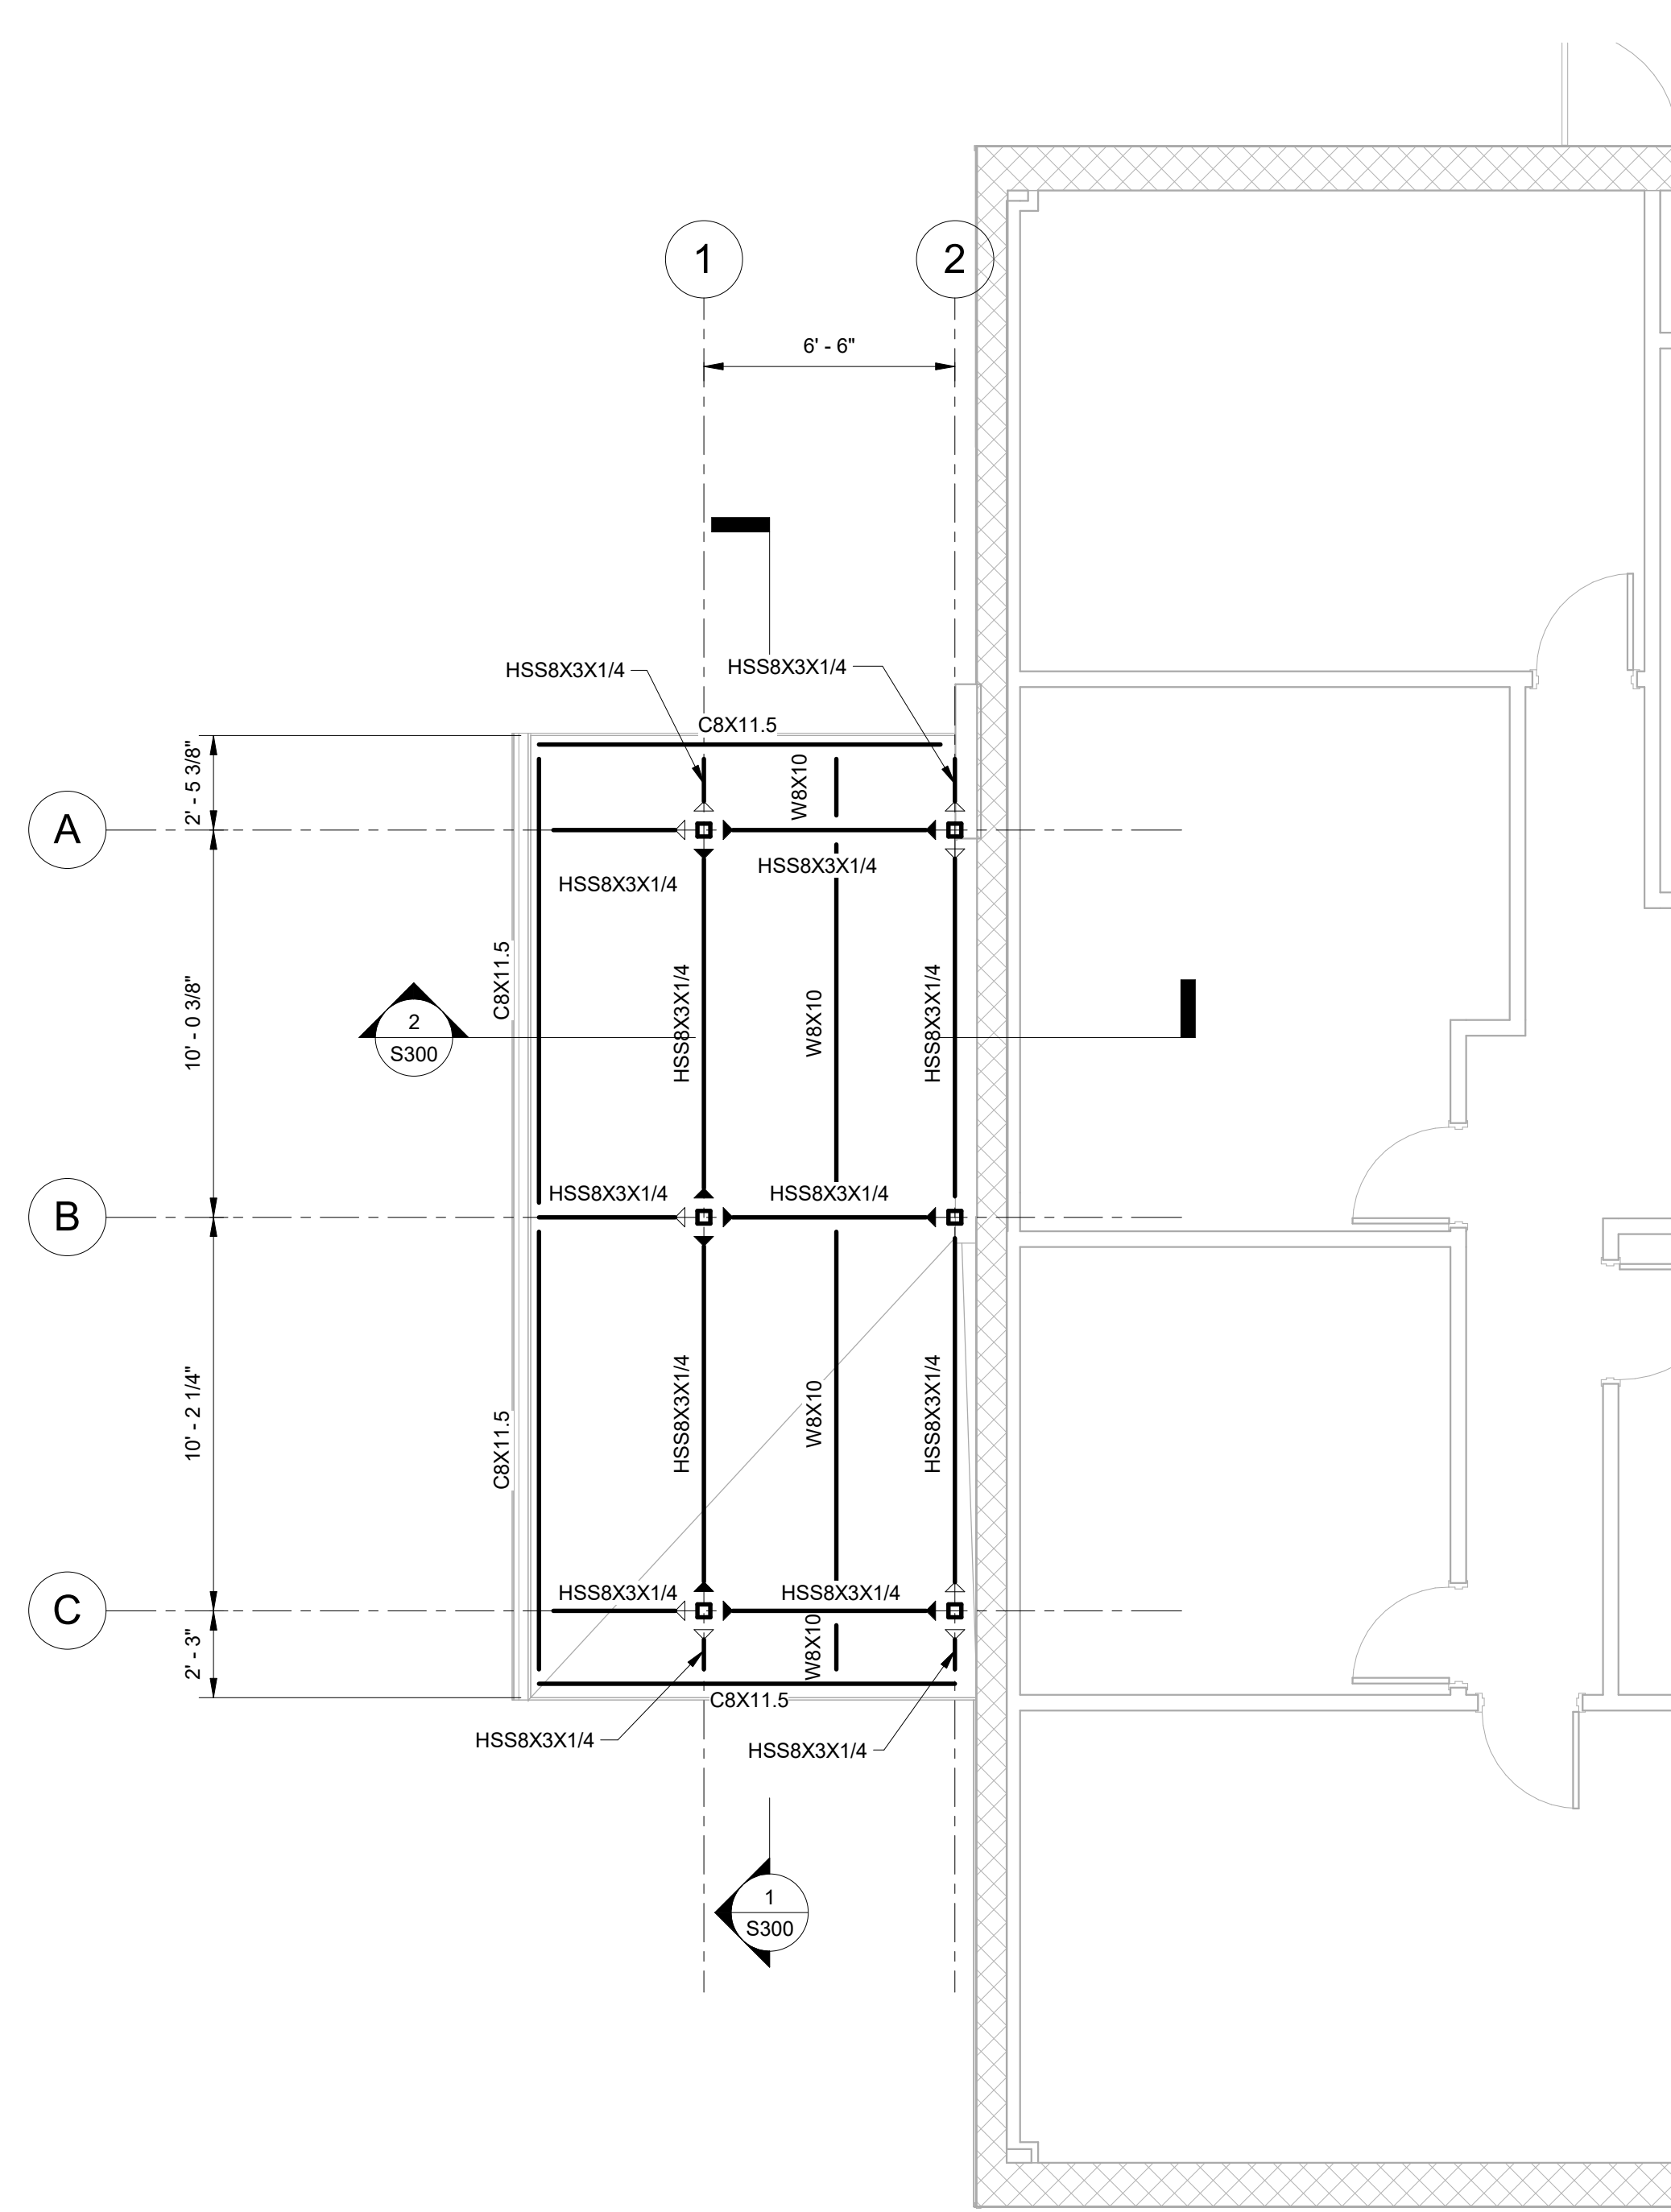

PLAN
CANOPY/VESTIBULE ROOF LEVEL PLAN (Add Alt #01)
SCALE: 1/4" = 1'-0"
NORTH

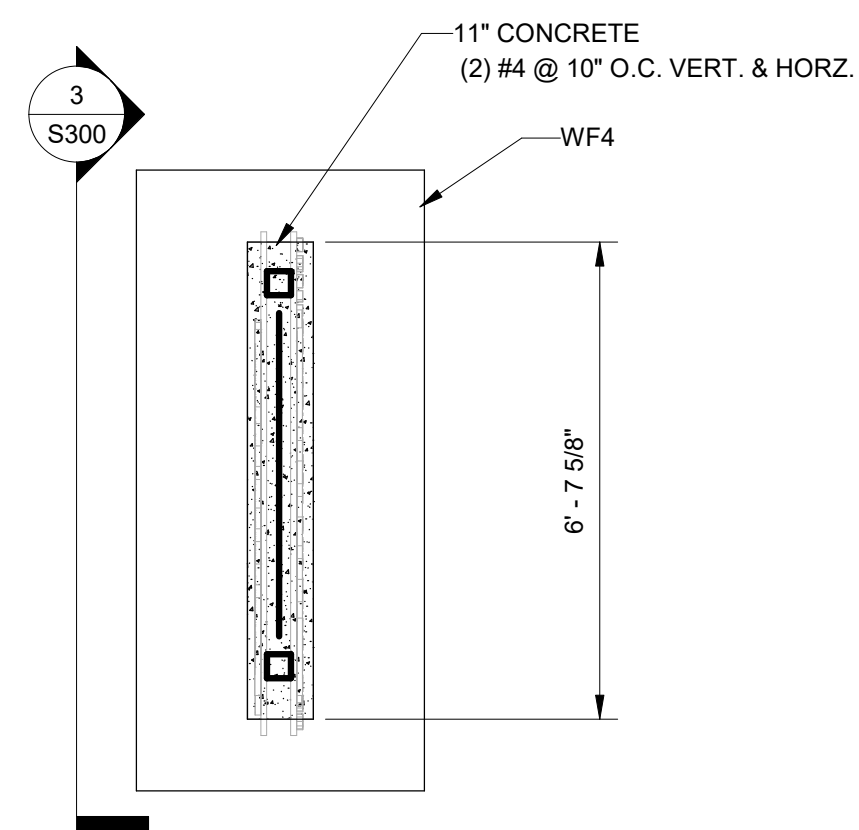


PLAN
SIGN FOUNDATION PLAN (Add Alt #02)
SCALE: 3/8" = 1'-0"
NORTH

- NOTES:
- ELEVATIONS REFERENCE FINISH FLOOR. REFERENCE LEVEL = 0'-0" (LEVEL 1)
 - T/FOOTING = -2'-0" TYP. U.N.O. (BOTTOM OF FOOTING SHALL BE -3'-0" MIN BELOW GRADE)
 - BP INDICATES BASE PLATE TYPE. SEE X-XXX FOR DETAILS.
 - PX INDICATES PIER TYPE. SEE X-XXX FOR DETAILS.
 - RD 1" INDICATES 1.5" DEEP 20 GA. G30 GALV. ROOF DECK. USE 3/8" DECK ATTACHMENT W/12" O.C. PERIMETER WITH HILTI EMP-2 FASTENERS. SIDE LAPS #10TYPE 1 SCREWS 2 PER SPAN
 - FOR BEAM REACTIONS NOT SHOWN, SEE GENERAL NOTES FOR MINIMUM END REACTION.

| FOUNDATION SCHEDULE | | | | | | |
|---------------------|--|--------------------|-----------------|----------------------|-------------------|----------|
| DESIGNATION | FOOTING SIZE (HEELxTOExDEPTH) or (WxD) | LONG. BOTTOM REBAR | LONG. TOP REBAR | TRANSV. BOTTOM REBAR | TRANSV. TOP REBAR | COMMENTS |
| SF3 | 3'-0"x3'-0"x1'-0" | (4) #4 | (4) #4 | (4) #4 | (4) #4 | |
| WF2 | 2'-0"x1'-0" | (3) #5 | N/A | #4 @ 12" O.C. | N/A | |
| WF4 | 4'-0"x1'-0" | (4) #5 | (4) #5 | #4 @ 12" O.C. | #4 @ 12" O.C. | |


| CONCRETE PIER SCHEDULE | | | | |
|------------------------|---------------|----------------|---------------|----------|
| DESIGNATION | D(in.)xW(in.) | VERTICAL REBAR | REBAR TIES | COMMENTS |
| P12 | 12"x12" | (4) #6 | #3 @ 10" O.C. | N/A |



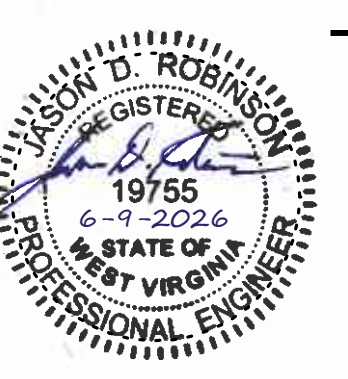


BID DOCUMENTS
06.09.2026


REVISIONS

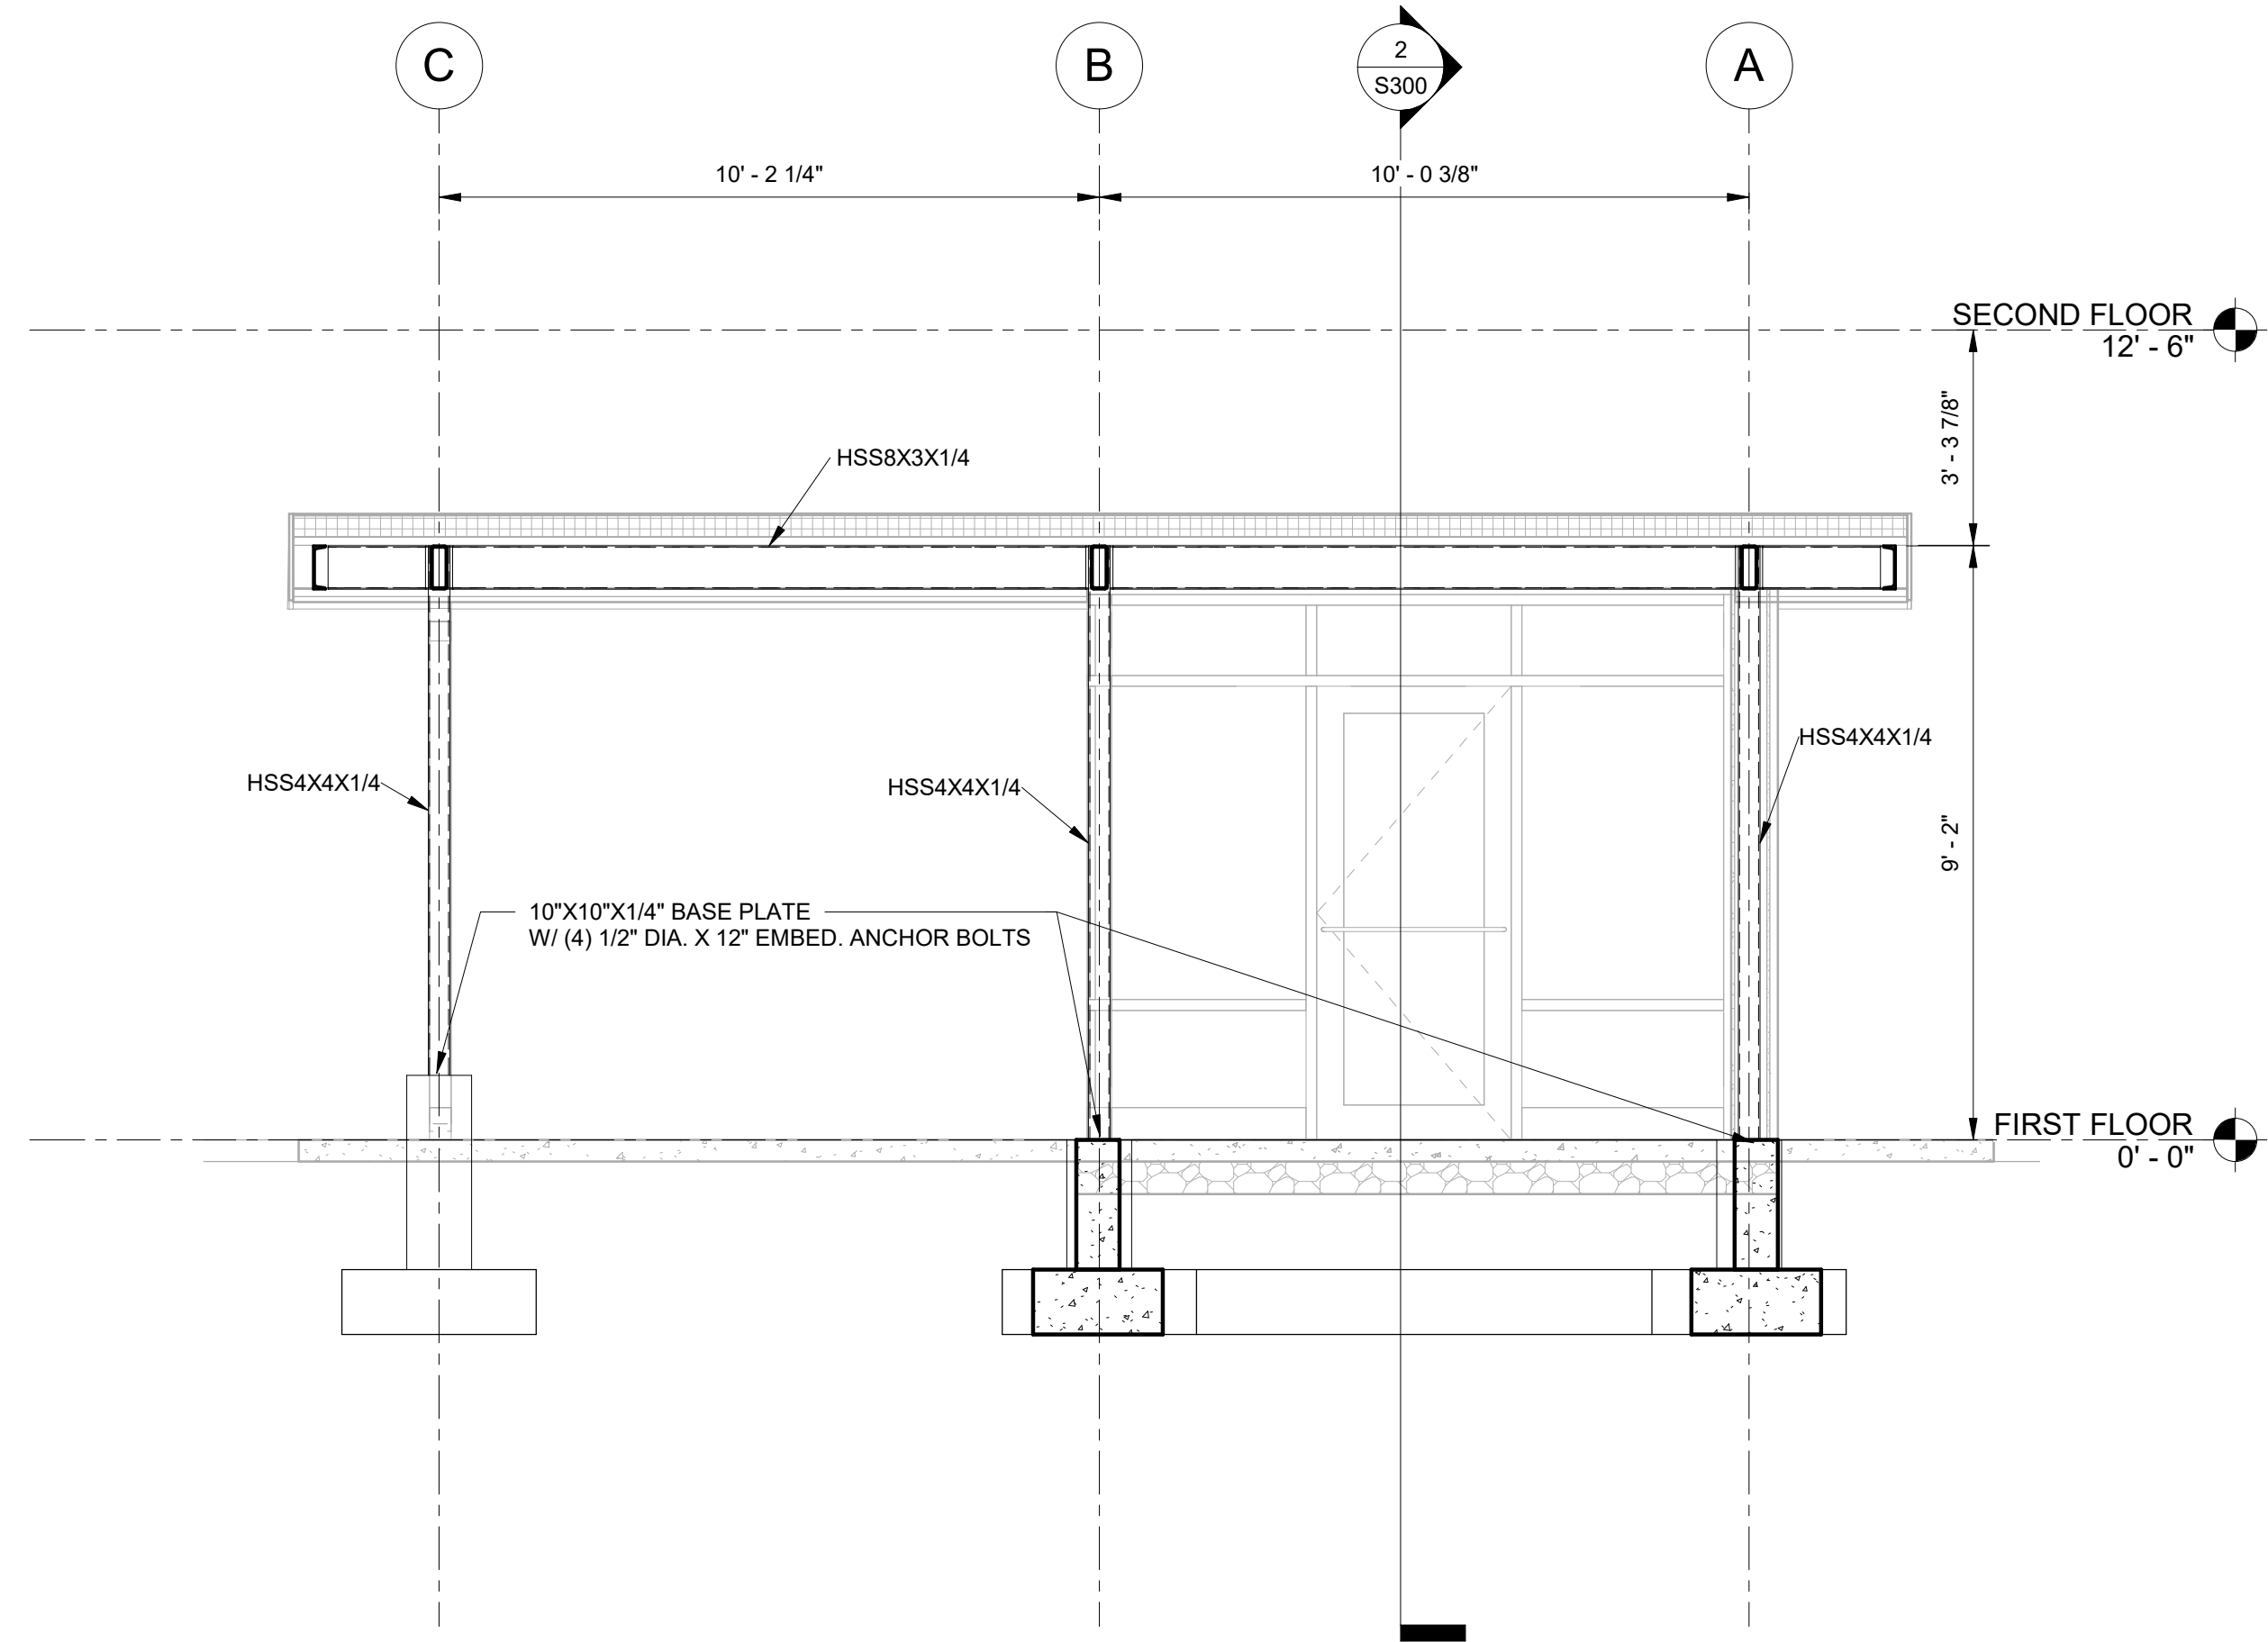

1 CANOPY/VESTIBULE SECTION (Add Alt #01)
SCALE: 3/8" = 1'-0"

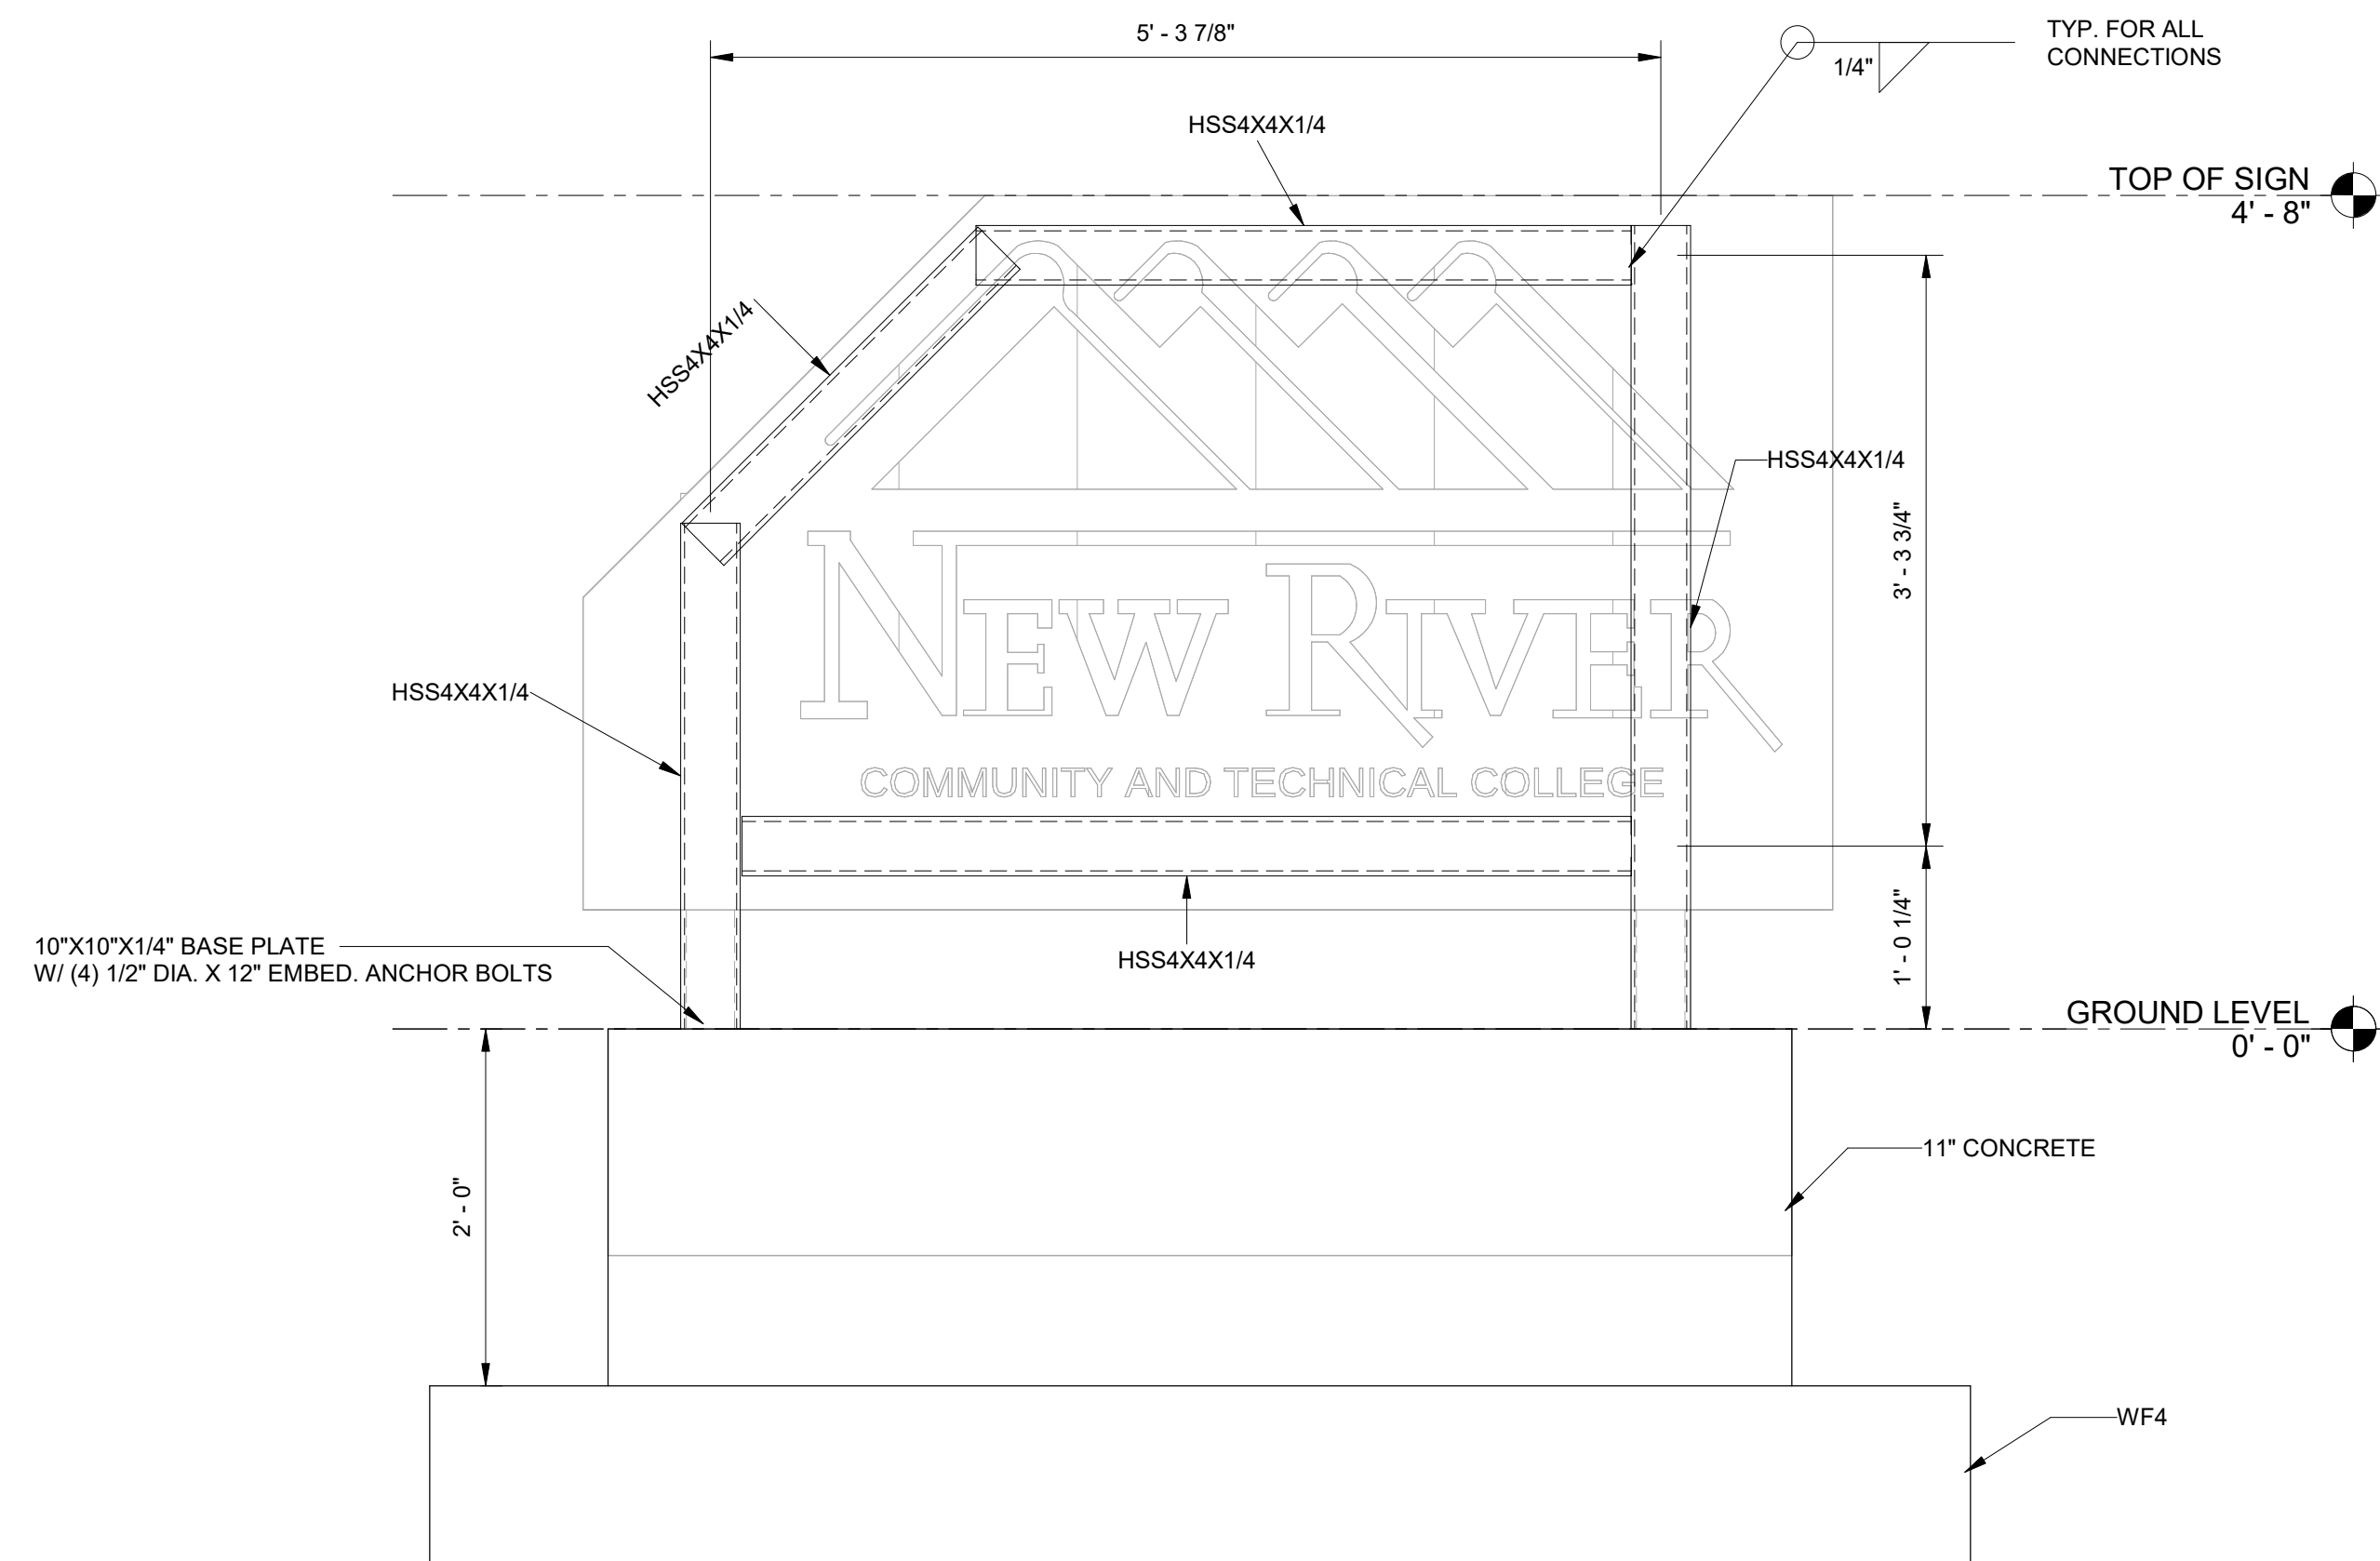

3 SIGN SECTION (Add Alt #02)
SCALE: 1" = 1'-0"

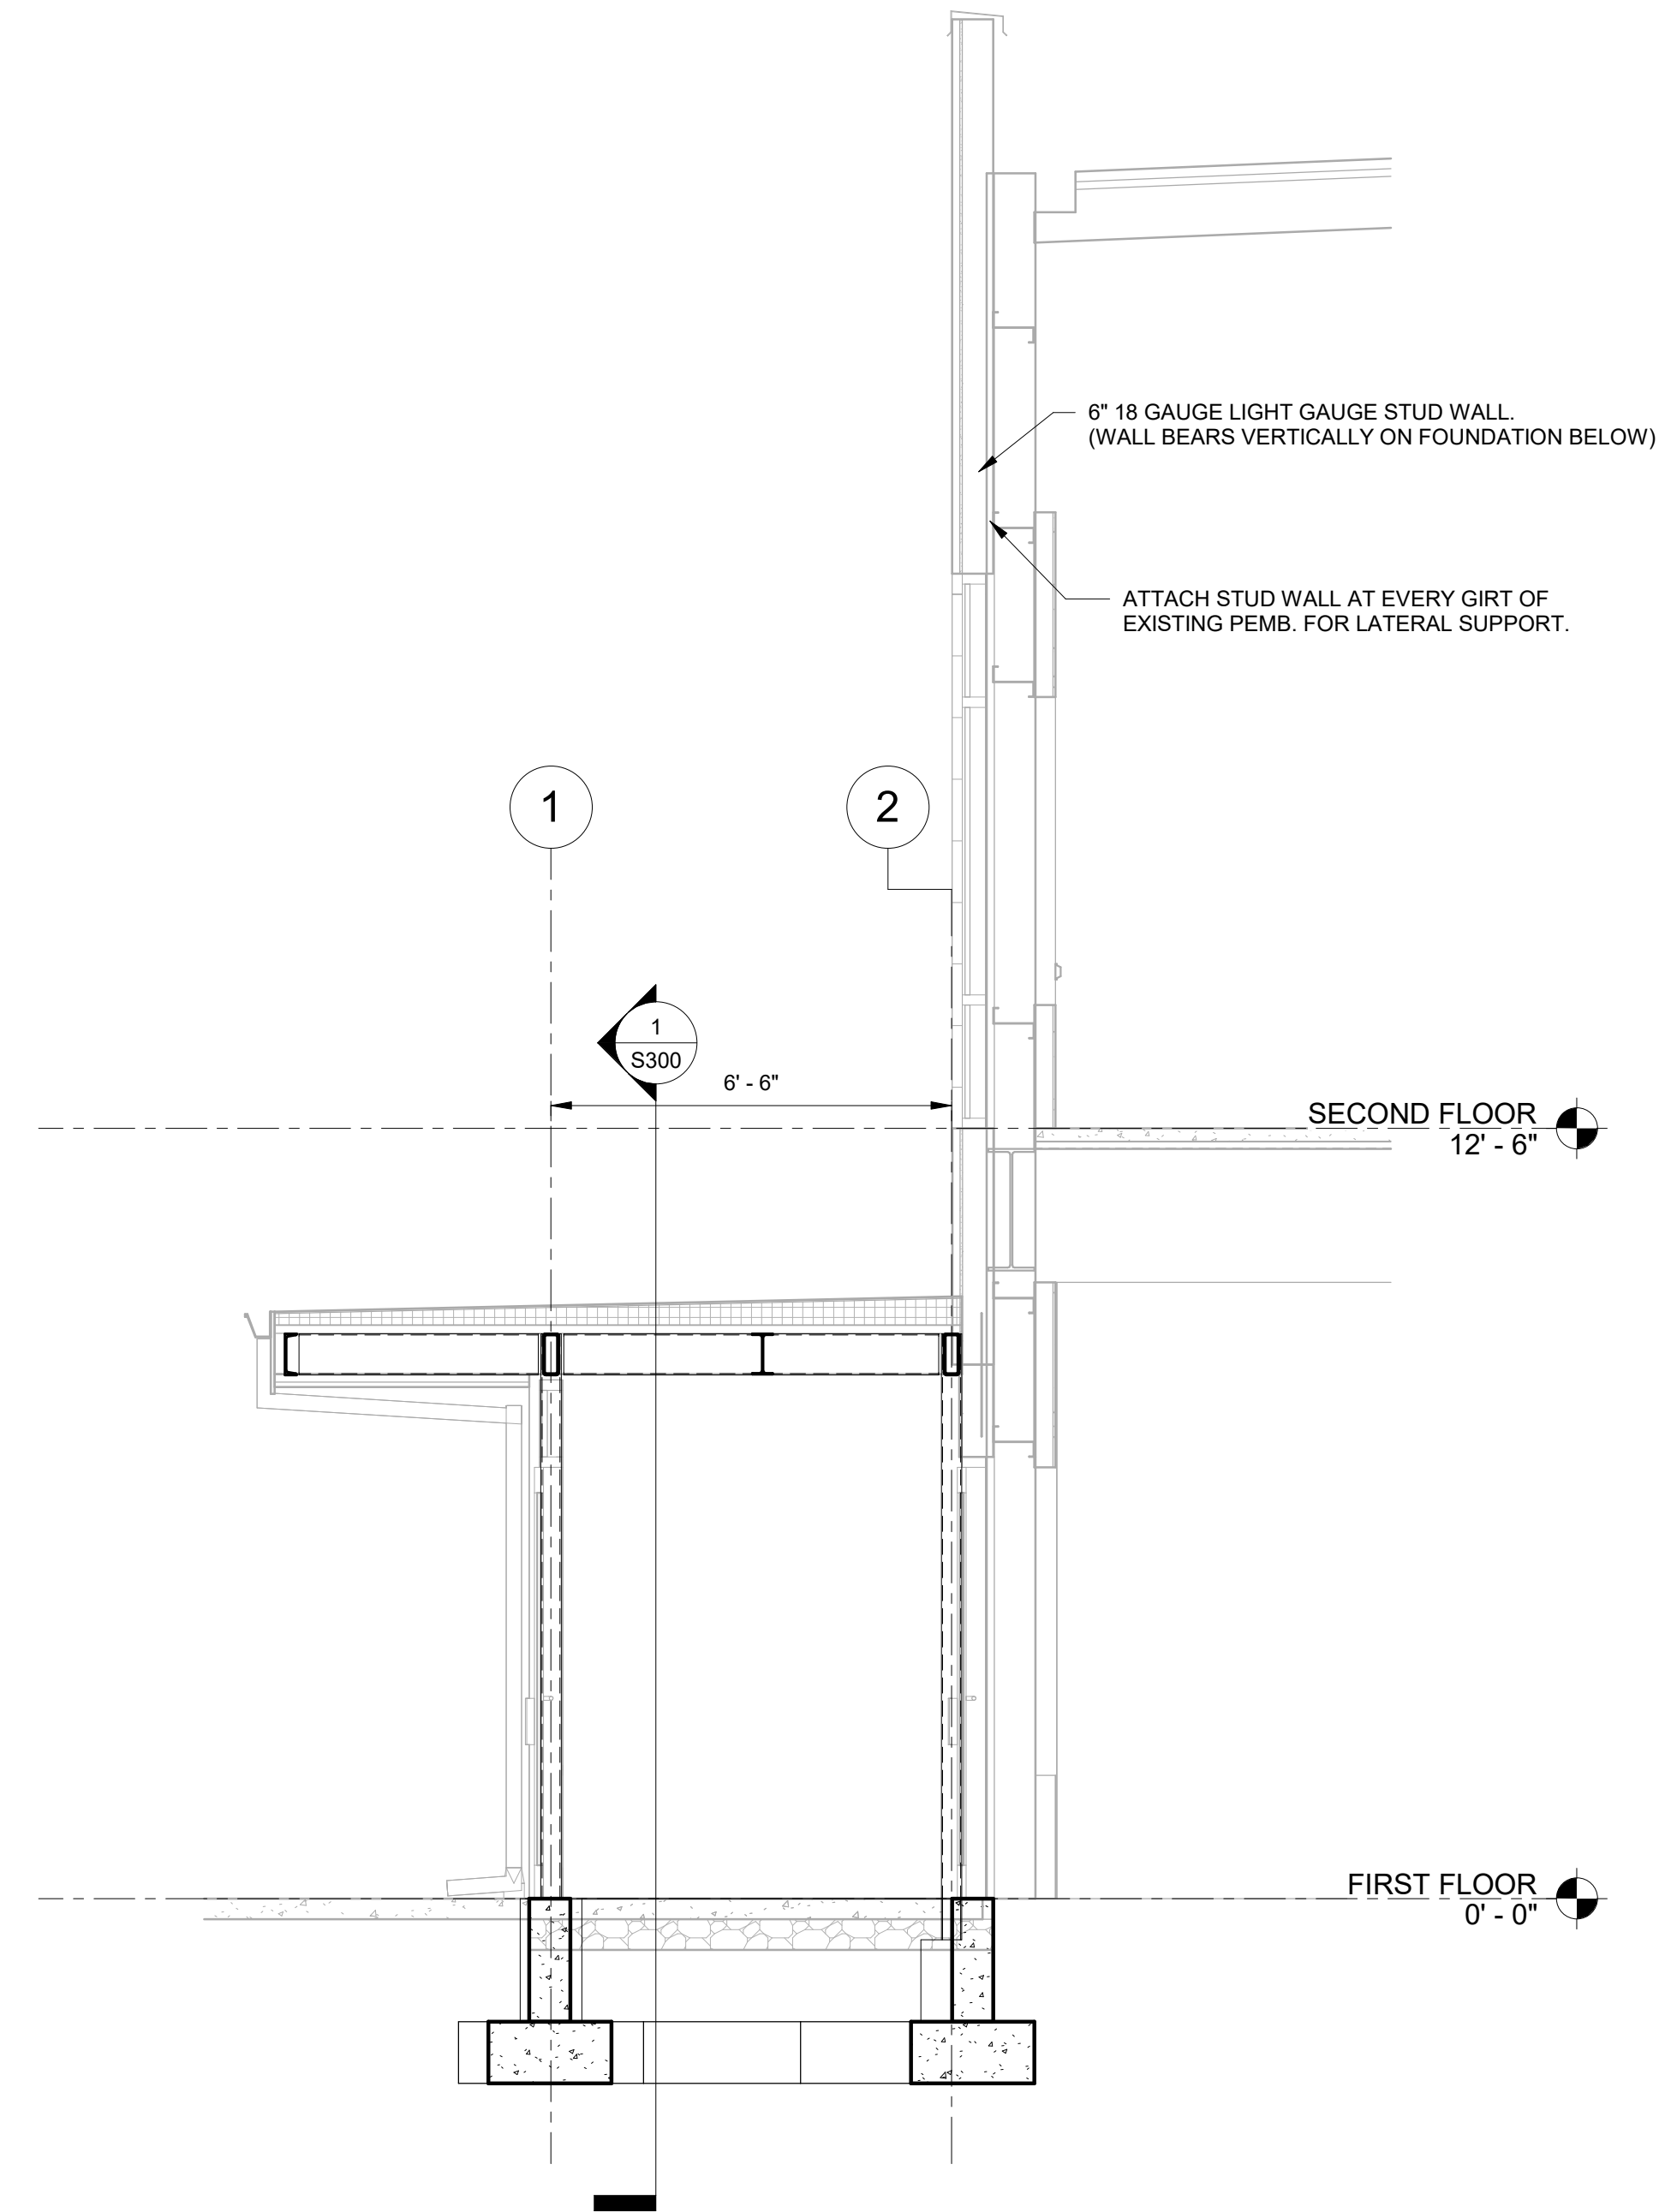


2 CANOPY/VESTIBULE SECTION (Add Alt #01)
SCALE: 3/8" = 1'-0"

ATC RENOVATION
NEW RIVER COMMUNITY & TECHNICAL COLLEGE
527 Odd Rd.
Chenoi, WV 25843




S300

Copyright © All rights reserved. Reproduction in whole or in part is prohibited. This drawing is an instrument of service, is the property of the Architect and may not be used in any way without written permission of this firm.
Project No. 2024008.001 Drawn by: Author

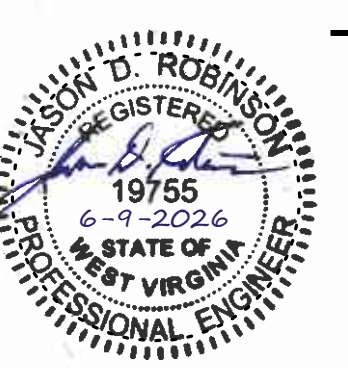


BID DOCUMENTS
06.09.2026
REVISIONS

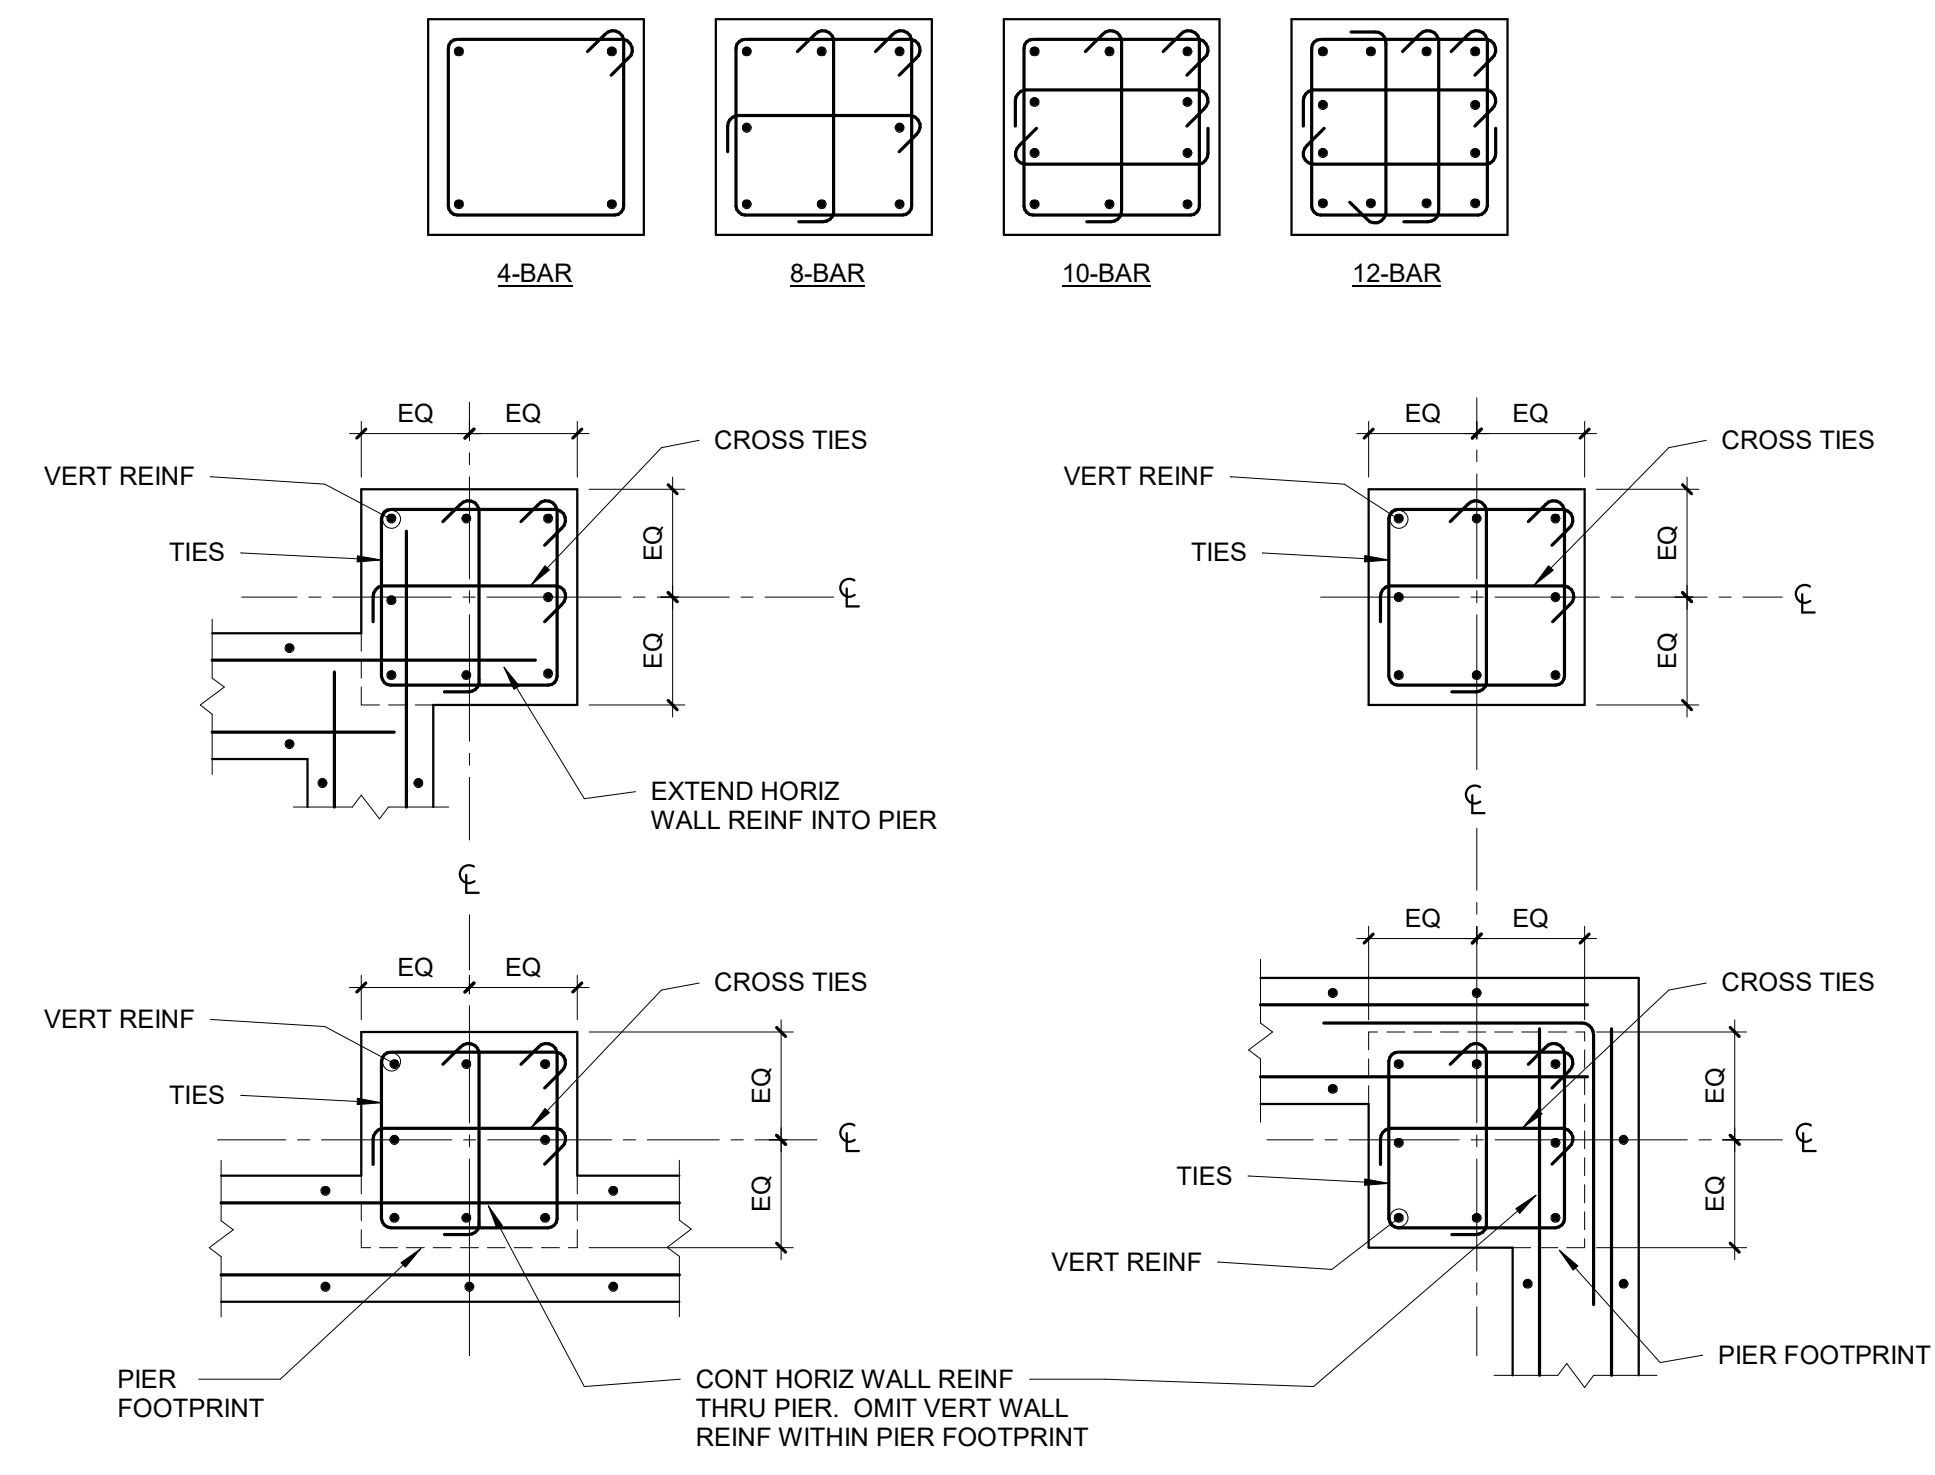


- NOTES:
1. PROVIDE 135 DEGREE HOOKS AT TIES.
 2. PROVIDE 135 DEGREE AND 90 DEGREE HOOKS AT CROSS TIES.
 3. ALTERNATE HOOK LOCATIONS AT CONSECUTIVE TIES.


1
S500 TYPICAL CONCRETE PIER DETAIL

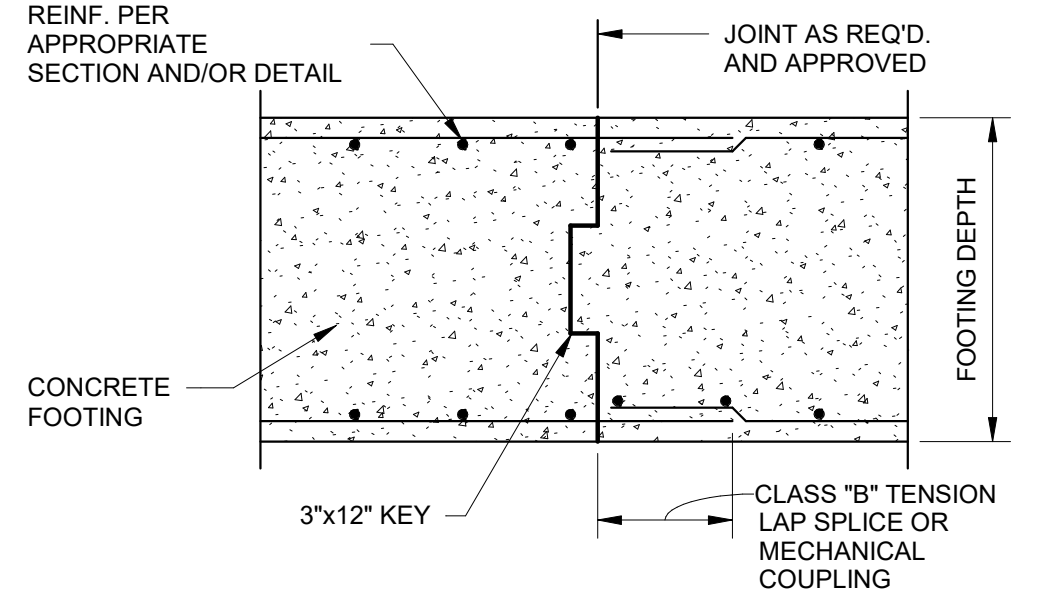


2
S500 TYPICAL CONCRETE FOOTING CONSTRUCTION JOINT DETAIL

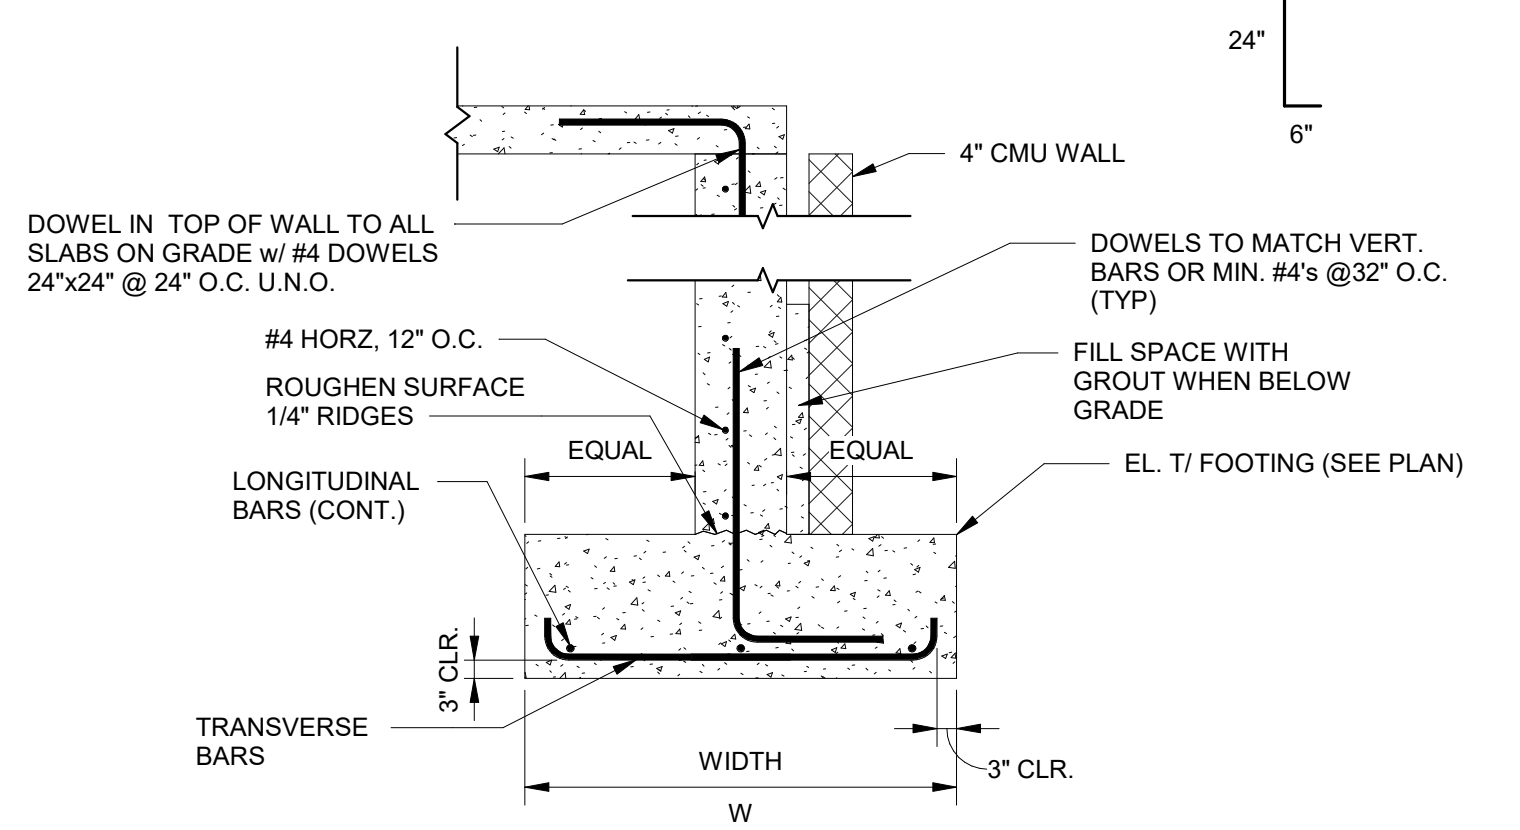


3
S500 TYPICAL CONCRETE STEM WALL CONTINUOUS WALL FOOTING DETAIL

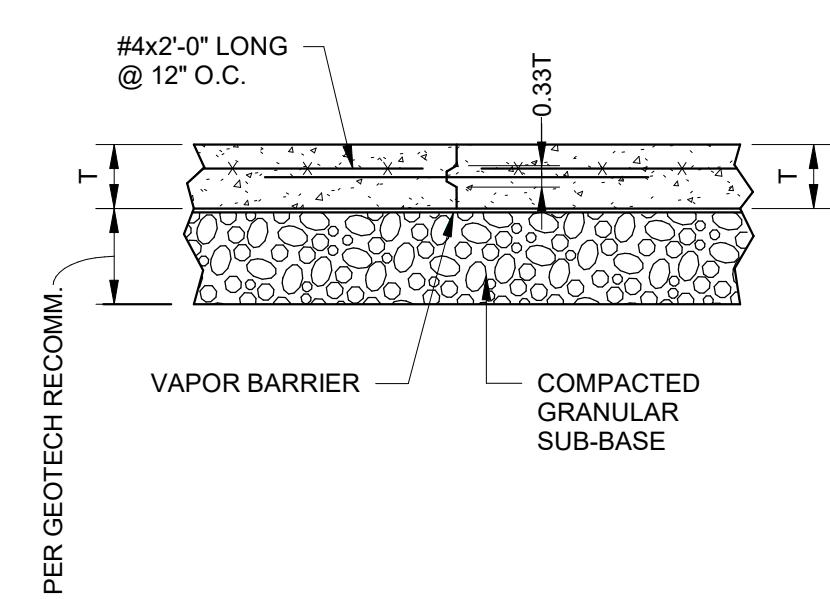


4
S500 TYPICAL CONSTRUCTION JOINT DETAIL

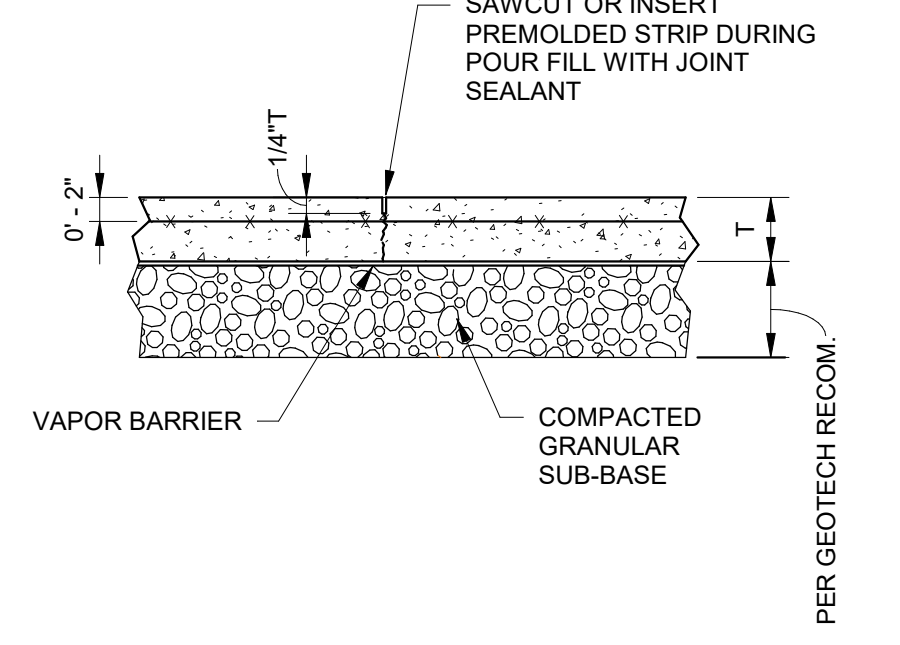


5
S500 TYPICAL CONTROL JOINT DETAIL

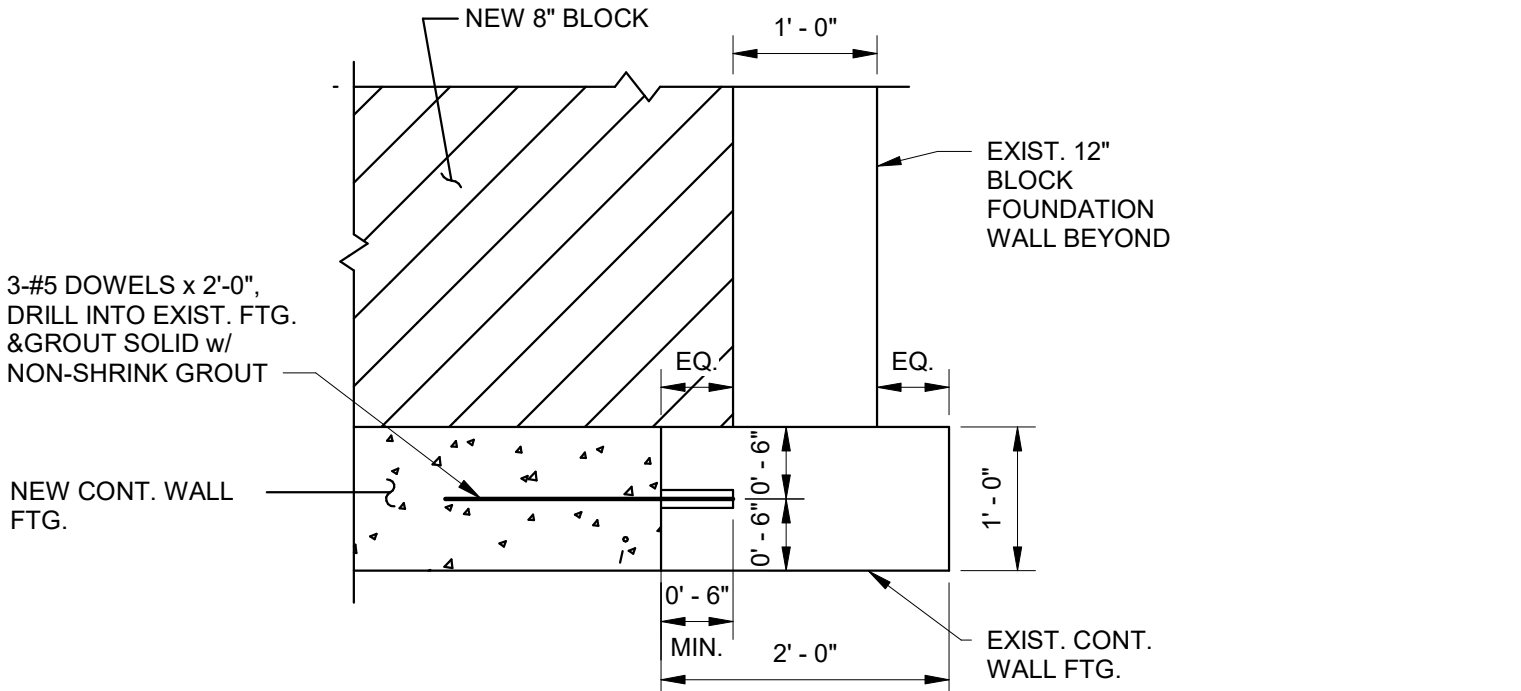

6
S500 TYPICAL NEW WALL FOOTING INTERSECTING AN EXISTING WALL FOOTING DETAIL

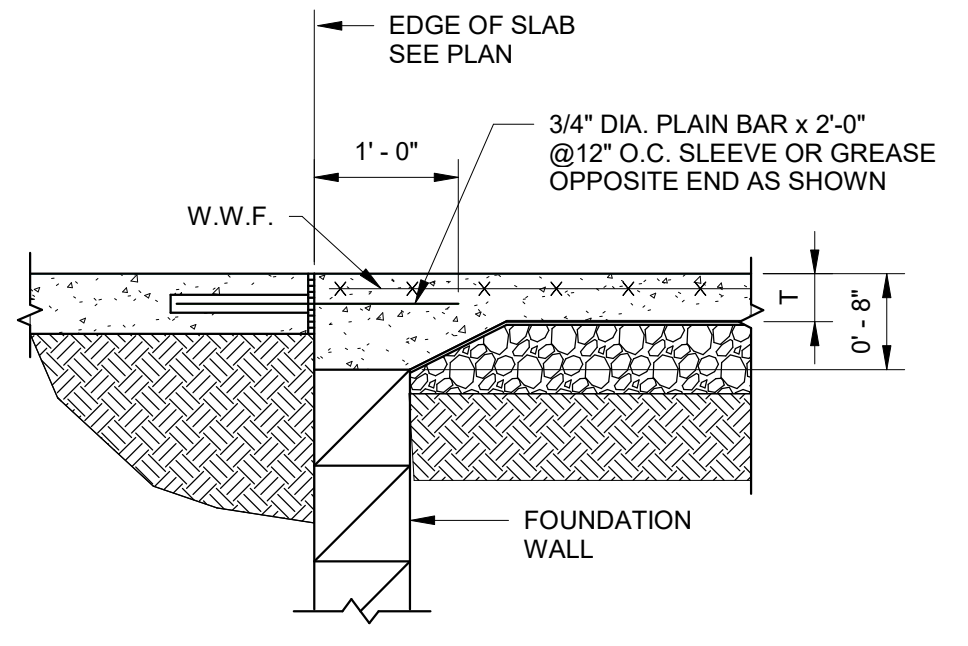

7
S500 TYPICAL SLAB-ON-GRADE ENTRY DETAIL

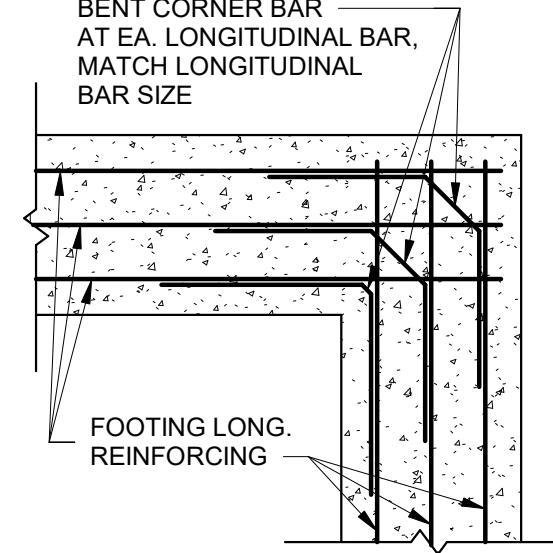

8
S500 TYPICAL WALL FOOTING CORNER DETAIL

ATC RENOVATION
 NEW RIVER COMMUNITY & TECHNICAL COLLEGE
 527 Odd Rd.
 Ghent, WV 25843



FOUNDATION DETAILS




OMNI
 ARCHITECTS

S500


Copyright © All rights reserved. Reproduction in whole or in part is prohibited. This drawing is an instrument of service, is the property of the Architect and may not be used in any way without written permission of this firm.
 Project No. 2024008.001 Drawn by: Author

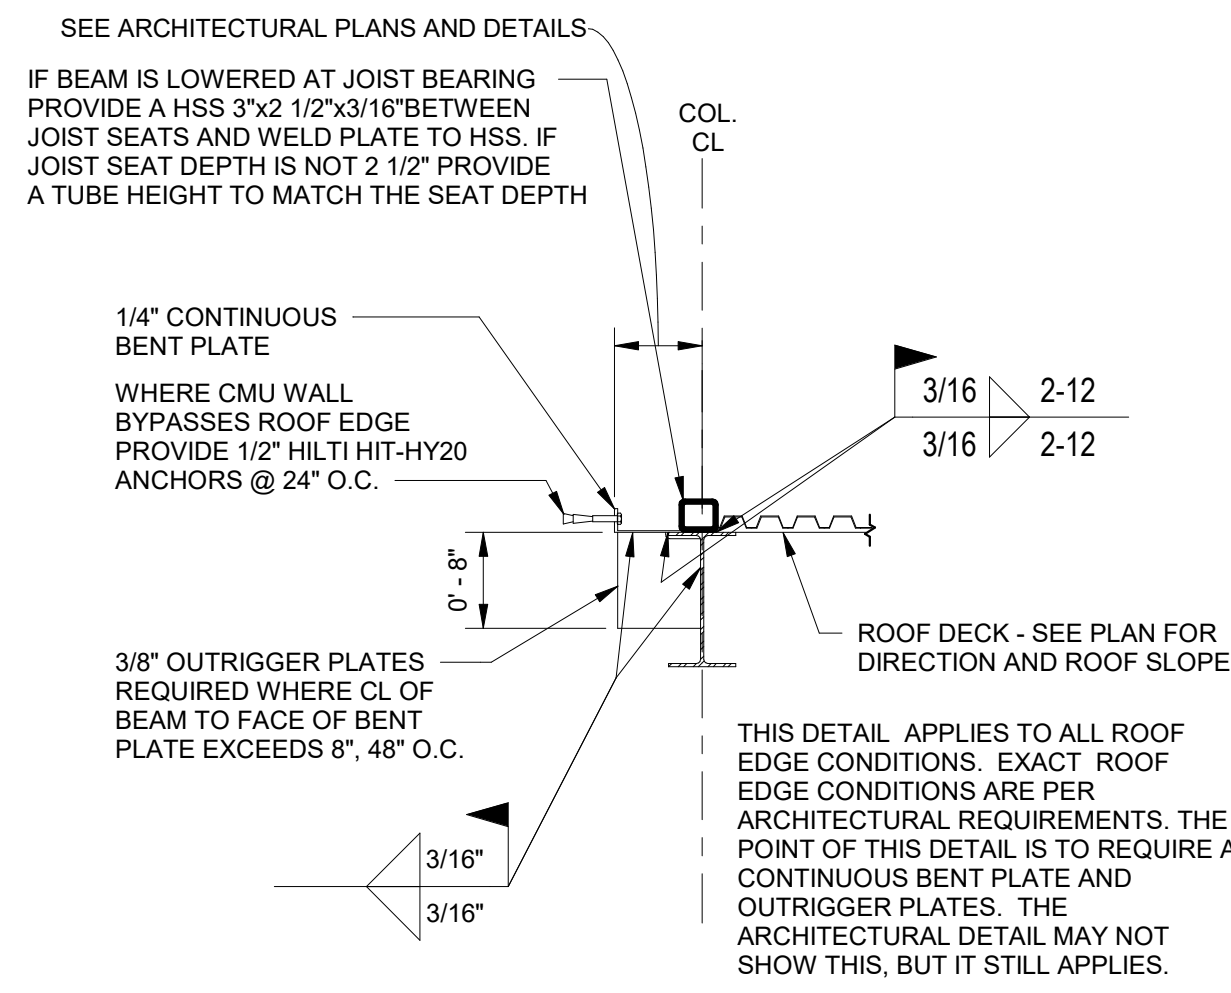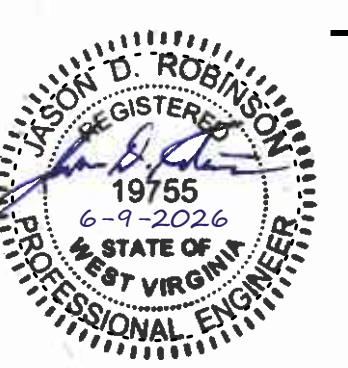


1
S501 **TYPICAL SECTION AT ROOF**

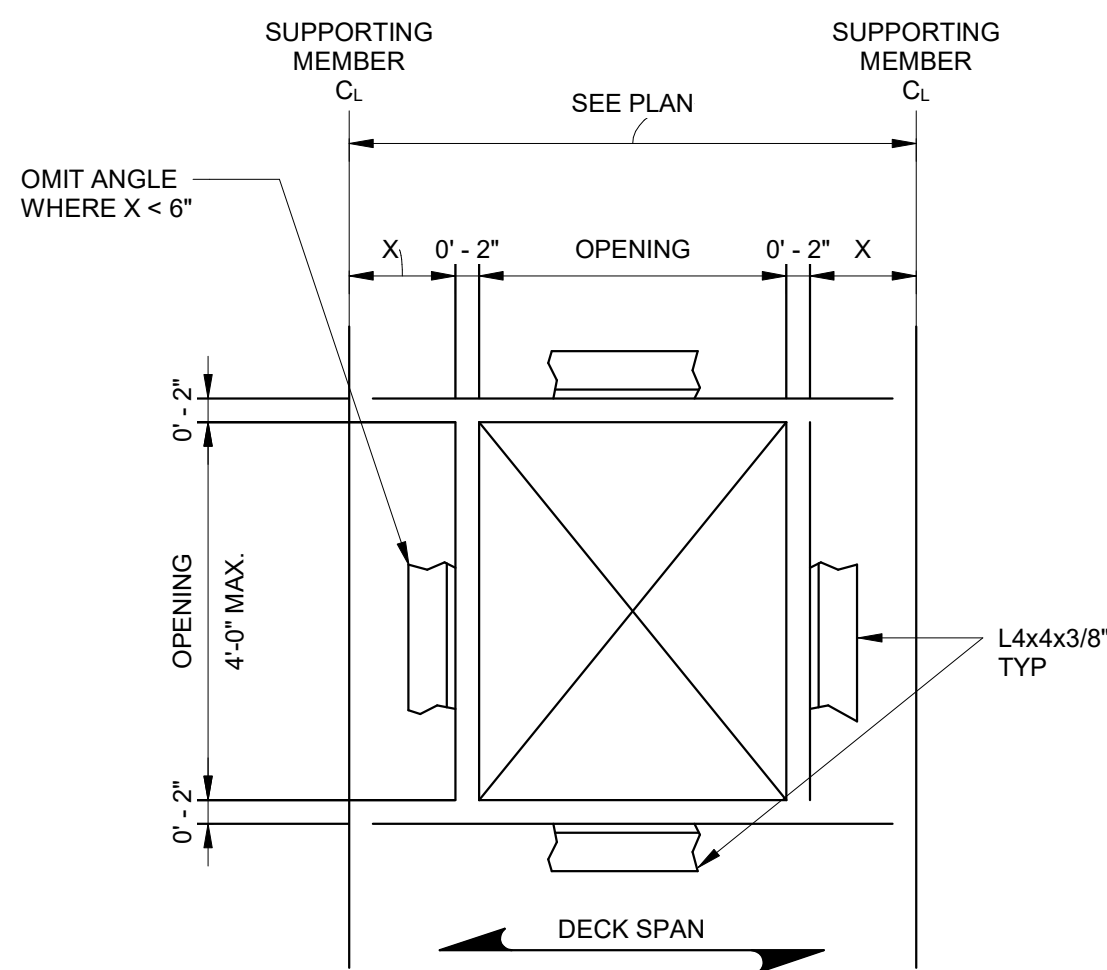


2
S501 **TYPICAL ROOF OPENING DETAIL**

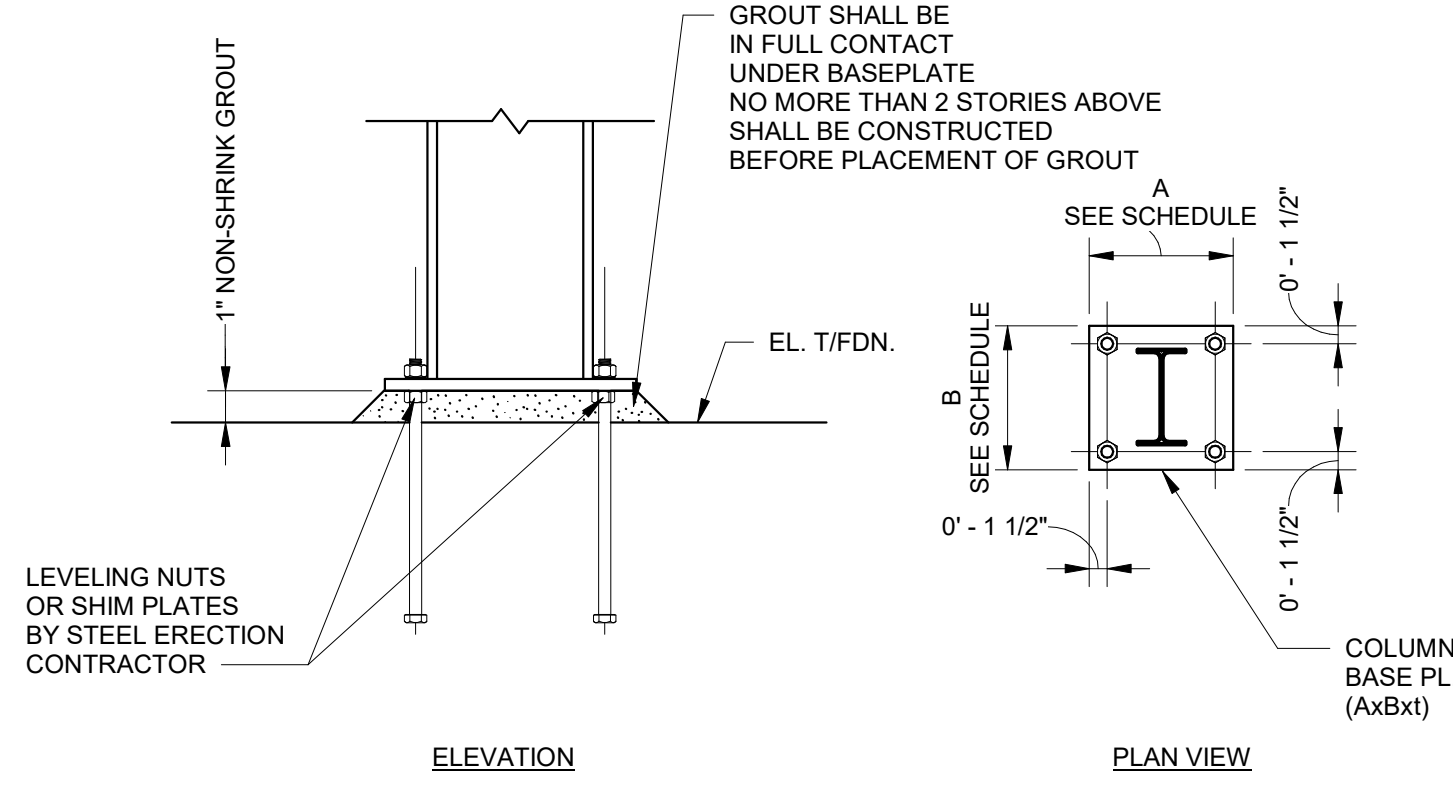


3
S501 **TYPICAL COLUMN BASE DETAIL**

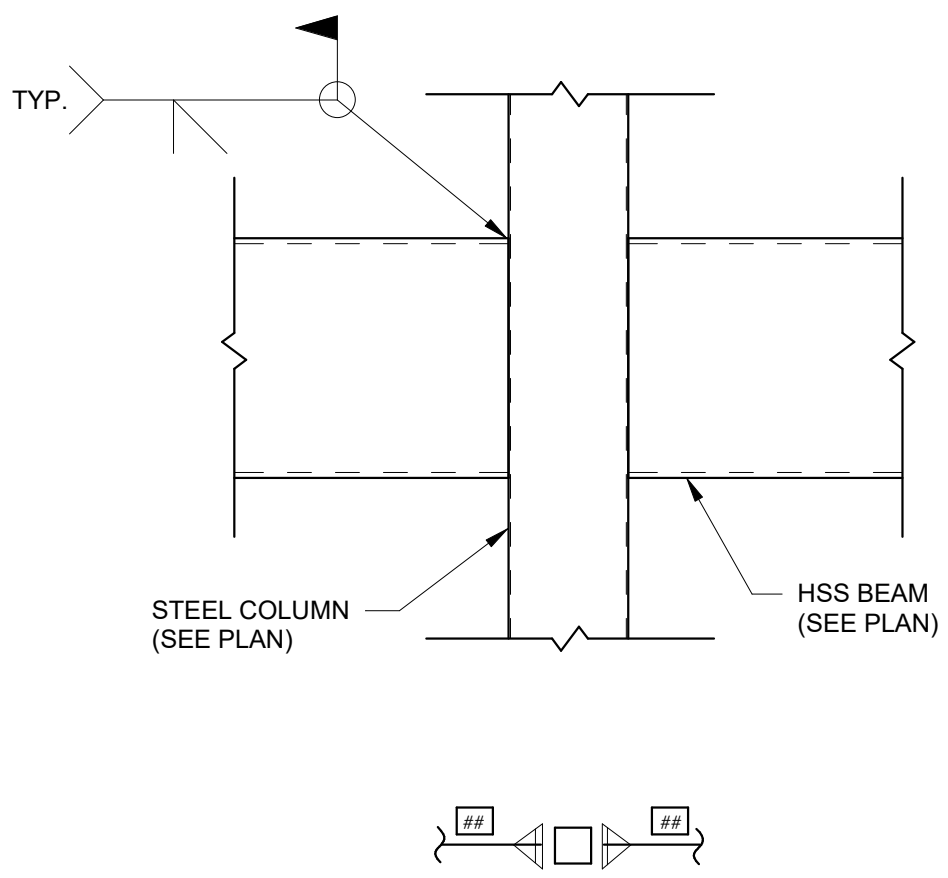

4
S501 **TYPICAL BEAM TO HSS COLUMN MOMENT CONNECTION**

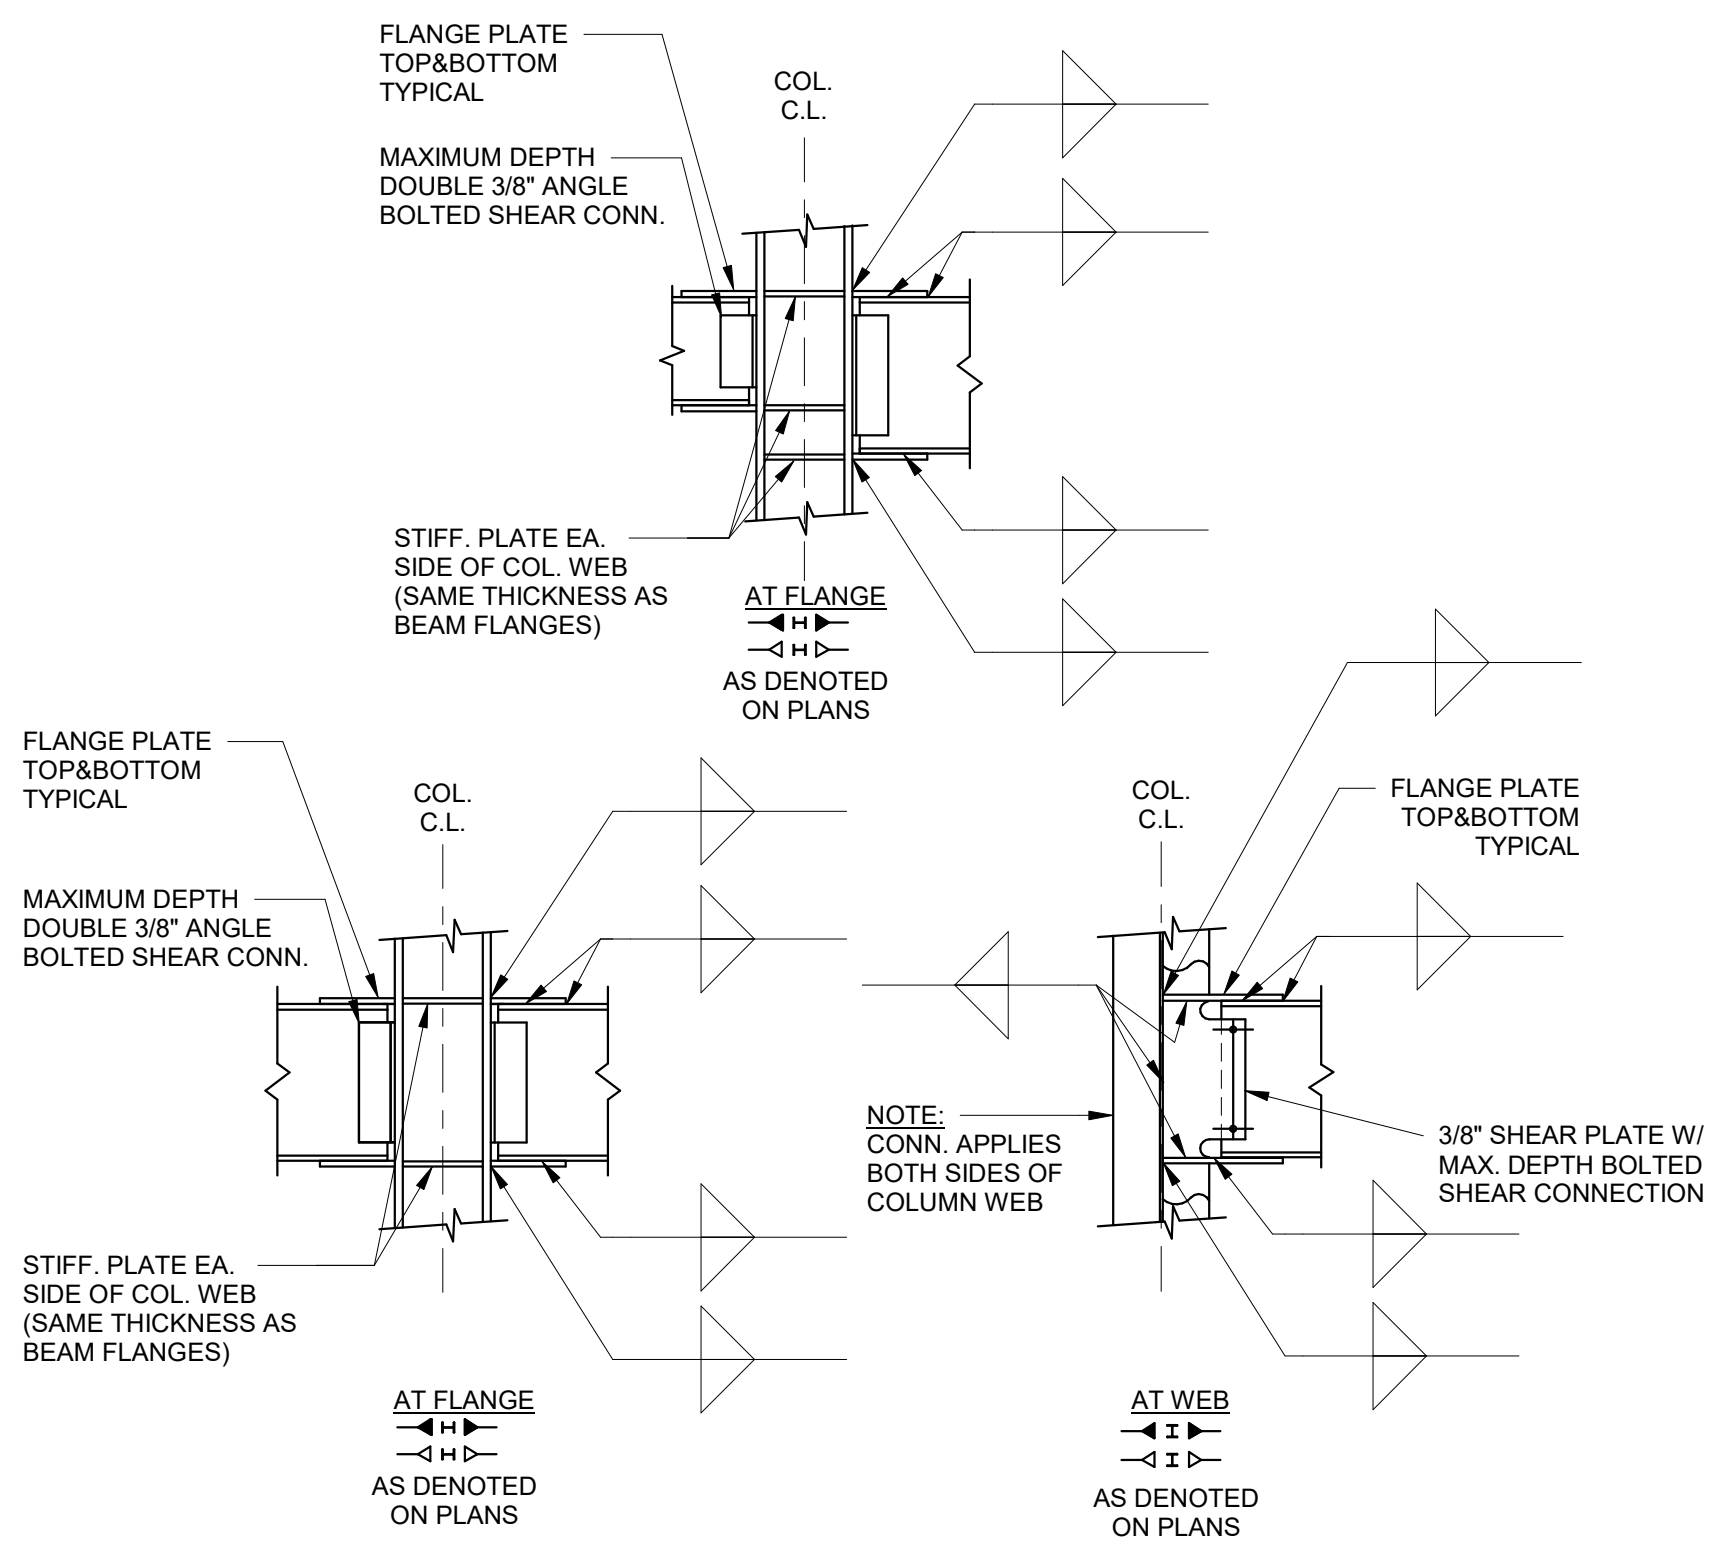


5
S501 **TYPICAL BEAM TO COLUMN MOMENT WELDED FLANGES**

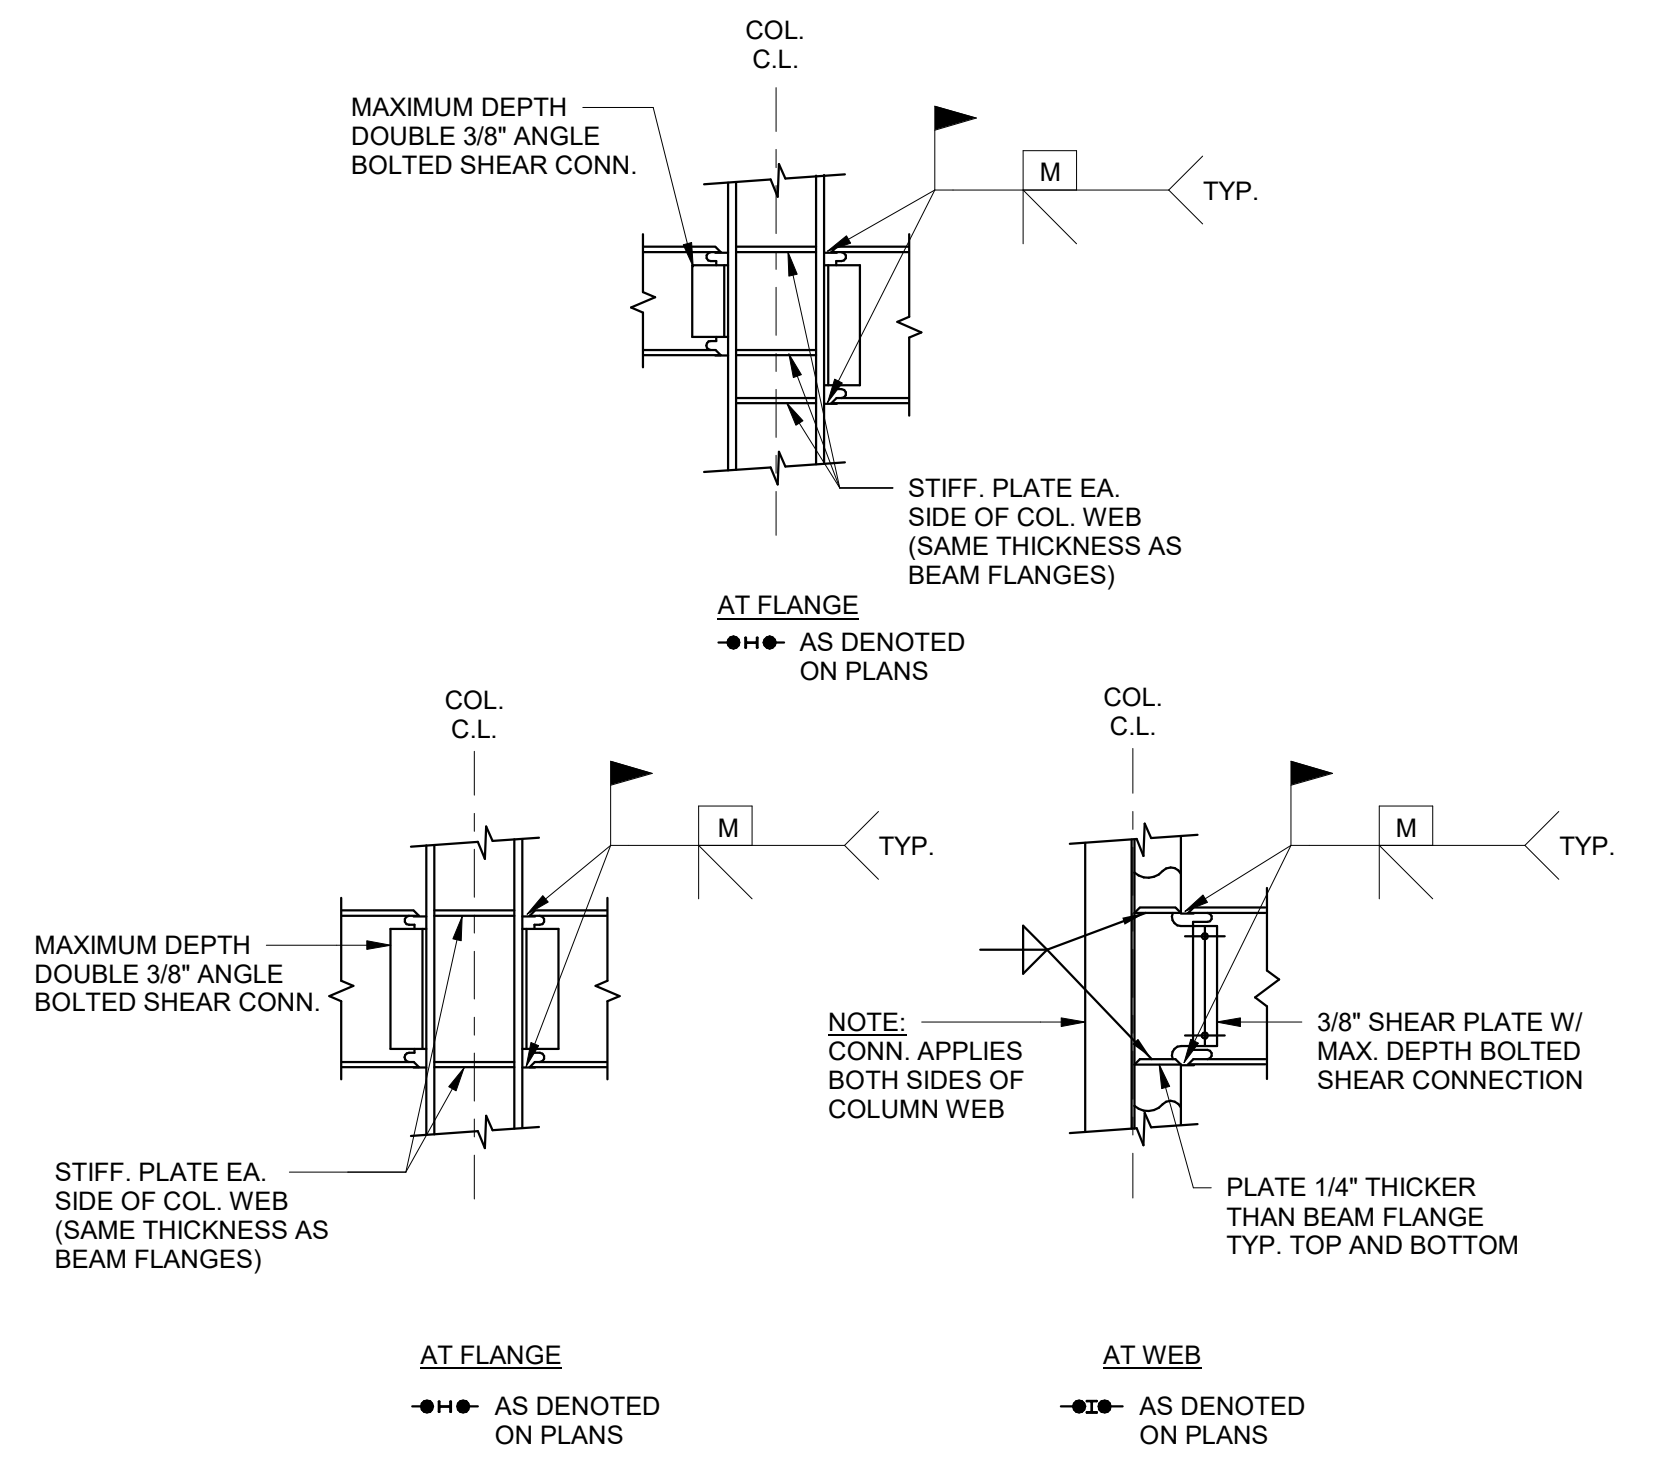

6
S501 **TYPICAL BEAM TO COLUMN MOMENT CONNECTION DETAIL**



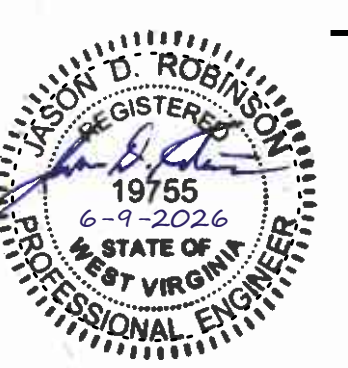

BID DOCUMENTS
06.09.2026

REVISIONS ▼


| COLUMN SCHEDULE | | | | |
|------------------------|-------------------|-------------------|-------------------|--------|
| FLOOR | COL. 1 | COL. 2 | COL. 3 | COL. 4 |
| SECOND FLOOR 12'-6" | | | | |
| FIRST FLOOR 0'-0" | HSS4X4X1/4 P12 | HSS4X4X1/4 P12 | HSS4X4X1/4 P12 | |
| Column Locations | A-1, B-1 | A-2, B-2 | C-1, C-2 | |

| FOUNDATION SCHEDULE | | | | | | |
|---------------------|--|--------------------|-----------------|----------------------|-------------------|----------|
| DESIGNATION | FOOTING SIZE (HEELxTOExDEPTH) or (WxD) | LONG. BOTTOM REBAR | LONG. TOP REBAR | TRANSV. BOTTOM REBAR | TRANSV. TOP REBAR | COMMENTS |
| SF3 | 3'-0"x3'-0"x1'-0" | (4) #4 | (4) #4 | (4) #4 | (4) #4 | |
| WF2 | 2'-0"x1'-0" | (3) #5 | N/A | #4 @ 12" O.C. | N/A | |
| WF4 | 4'-0"x1'-0" | (4) #5 | (4) #5 | #4 @ 12" O.C. | #4 @ 12" O.C. | |

| CONCRETE PIER SCHEDULE | | | | |
|------------------------|---------------|----------------|---------------|----------|
| DESIGNATION | D(in.)xW(in.) | VERTICAL REBAR | REBAR TIES | COMMENTS |
| P12 | 12"x12" | (4) #6 | #3 @ 10" O.C. | N/A |

| REINFORCING LAP LENGTH SCHEDULE | | | | | | | | | | | |
|--|----------|-----------|--|------|------|----------------|------|------|------|--|--|
| Tension lap splice lengths, (bar diameters, db) for grade 60 uncoated bars; normal-weight concrete | | | | | | | | | | | |
| f _c (psi) | Bar Size | Lap Class | Lap Length per Spacing and Cover Case ¹ | | | | | | | | |
| | | | Top Horizontal Bars ¹ | | | All Other Bars | | | | | |
| | | | Category | | | Category | | | | | |
| | | | 1 | 2 | 3 | 1 | 2 | 3 | | | |
| 3000 | #3-#6 | A | 86db | 58db | 36db | 66db | 44db | 28db | | | |
| | | B | 112db | 74db | 46db | 86db | 58db | 36db | | | |
| | #7-#11 | A | 107db | 72db | 43db | 83db | 55db | 33db | | | |
| | | B | 139db | 93db | 56db | 107db | 72db | 43db | | | |
| | 4000 | #3-#6 | A | 74db | 50db | 30db | 58db | 38db | 24db | | |
| | | | B | 98db | 66db | 40db | 74db | 50db | 31db | | |
| #7-#11 | | A | 93db | 62db | 37db | 72db | 48db | 29db | | | |
| | | B | 121db | 81db | 49db | 93db | 62db | 37db | | | |
| 5000 | #3-#6 | A | 68db | 46db | 32db | 52db | 34db | 21db | | | |
| | | B | 86db | 58db | 42db | 68db | 46db | 27db | | | |
| | #7-#11 | A | 83db | 56db | 34db | 64db | 43db | 26db | | | |
| | | B | 108db | 72db | 43db | 83db | 56db | 34db | | | |
| | 6000 | #3-#6 | A | 62db | 42db | 26db | 48db | 32db | 19db | | |
| | | | B | 80db | 54db | 32db | 62db | 42db | 26db | | |
| #7-#11 | | A | 76db | 51db | 31db | 59db | 39db | 24db | | | |
| | | B | 99db | 66db | 40db | 76db | 51db | 31db | | | |
| 7000 | #3-#6 | A | 56db | 38db | 23db | 44db | 30db | 18db | | | |
| | | B | 74db | 50db | 30db | 56db | 38db | 23db | | | |
| | #7-#11 | A | 70db | 47db | 28db | 54db | 36db | 22db | | | |
| | | B | 91db | 61db | 37db | 70db | 47db | 28db | | | |
| | >= 8000 | #3-#6 | A | 54db | 36db | 22db | 42db | 28db | 18db | | |
| | | | B | 68db | 46db | 28db | 54db | 36db | 22db | | |
| #7-#11 | | A | 66db | 44db | 27db | 51db | 34db | 21db | | | |
| | | B | 85db | 57db | 34db | 66db | 44db | 27db | | | |

- Lap Notes:**
- Lap splice lengths are based on ACI318-08 section 12.2 and subsections 12.2.2 and 12.2.3.
 - Category definitions: (see figures below for additional information).
 - Category 1 - Code 12.2.2 other cases - does not meet category 2 or 3.
 - Category 2 - Code 12.2.2 - clear spacing of bars being developed or spliced not less than 2db and clear cover not less than db.
 - Category 3 - Code 12.2.3 - clear cover not less than 2db and clear spacing not less than 4db.
 - Minimum lap splice shall not be less than 12 inches.
 - Multiply above lengths by 1.25 for grade 75 reinforcing steel.
 - Top bars are defined as horizontal reinforcement so placed that more than 12 inches of fresh concrete is cast in the member below the development length or splice.
 - Compression laps for GR. 60 uncoated bars in normal weight concrete with a minimum strength of 3000 psi shall be 30 db. Use 44 db for GR. 75 compression lap.
 - For epoxy-coated bars or wires with cover less than 3db, or clear spacing less than 6db, multiply lap length by 1.5. For all other epoxy coated bars or wires, multiply lap length by 1.2.
 - For lightweight concrete multiply lap length by 1.3.
 - Lap Class is determined in accordance with ACI318-08 section 12.15.2, use class B U.N.O.

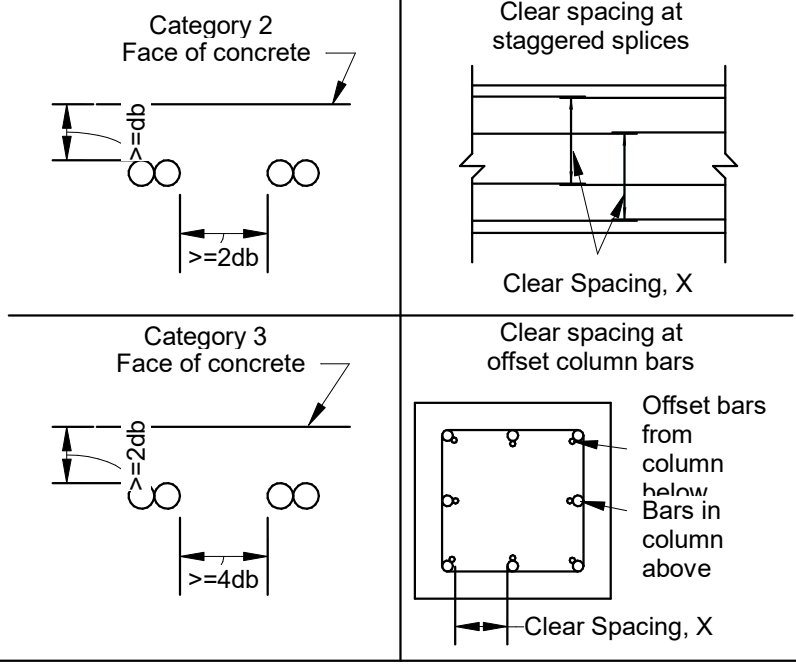


ATC RENOVATION
NEW RIVER COMMUNITY & TECHNICAL COLLEGE
527 Odd Rd.
Ghent, WV 25843




| # | Note Text |
|-----|---|
| D01 | REMOVE EXISTING CANOPY IN ITS ENTIRETY |
| D05 | REMOVE METAL PANEL UP TO GIRT AT +/- 7'-4" AROUND ENTIRE PERIMETER. FIELD VERIFY GIRT HEIGHT. |
| D06 | REMOVE EXISTING SIDEWALK. SEE CIVIL. |
| D07 | REMOVE OVERHEAD DOOR AND OLD ACCESSORIES AS NECESSARY FOR INSTALLATION ON NEW OVERHEAD DOORS. |


***NOTE: DEMOLITION NOTES D01 AND D06 REFERRING TO EXTERIOR VESTIBULE AND CANOPY ALTERNATIONS ARE ONLY IF ALTERNATE #1 IS APPROVED**

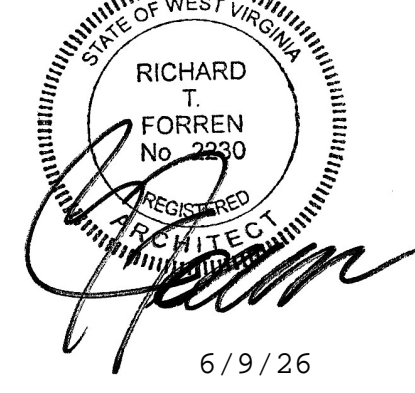

BID DOCUMENTS
06.09.2026
REVISIONS ▼

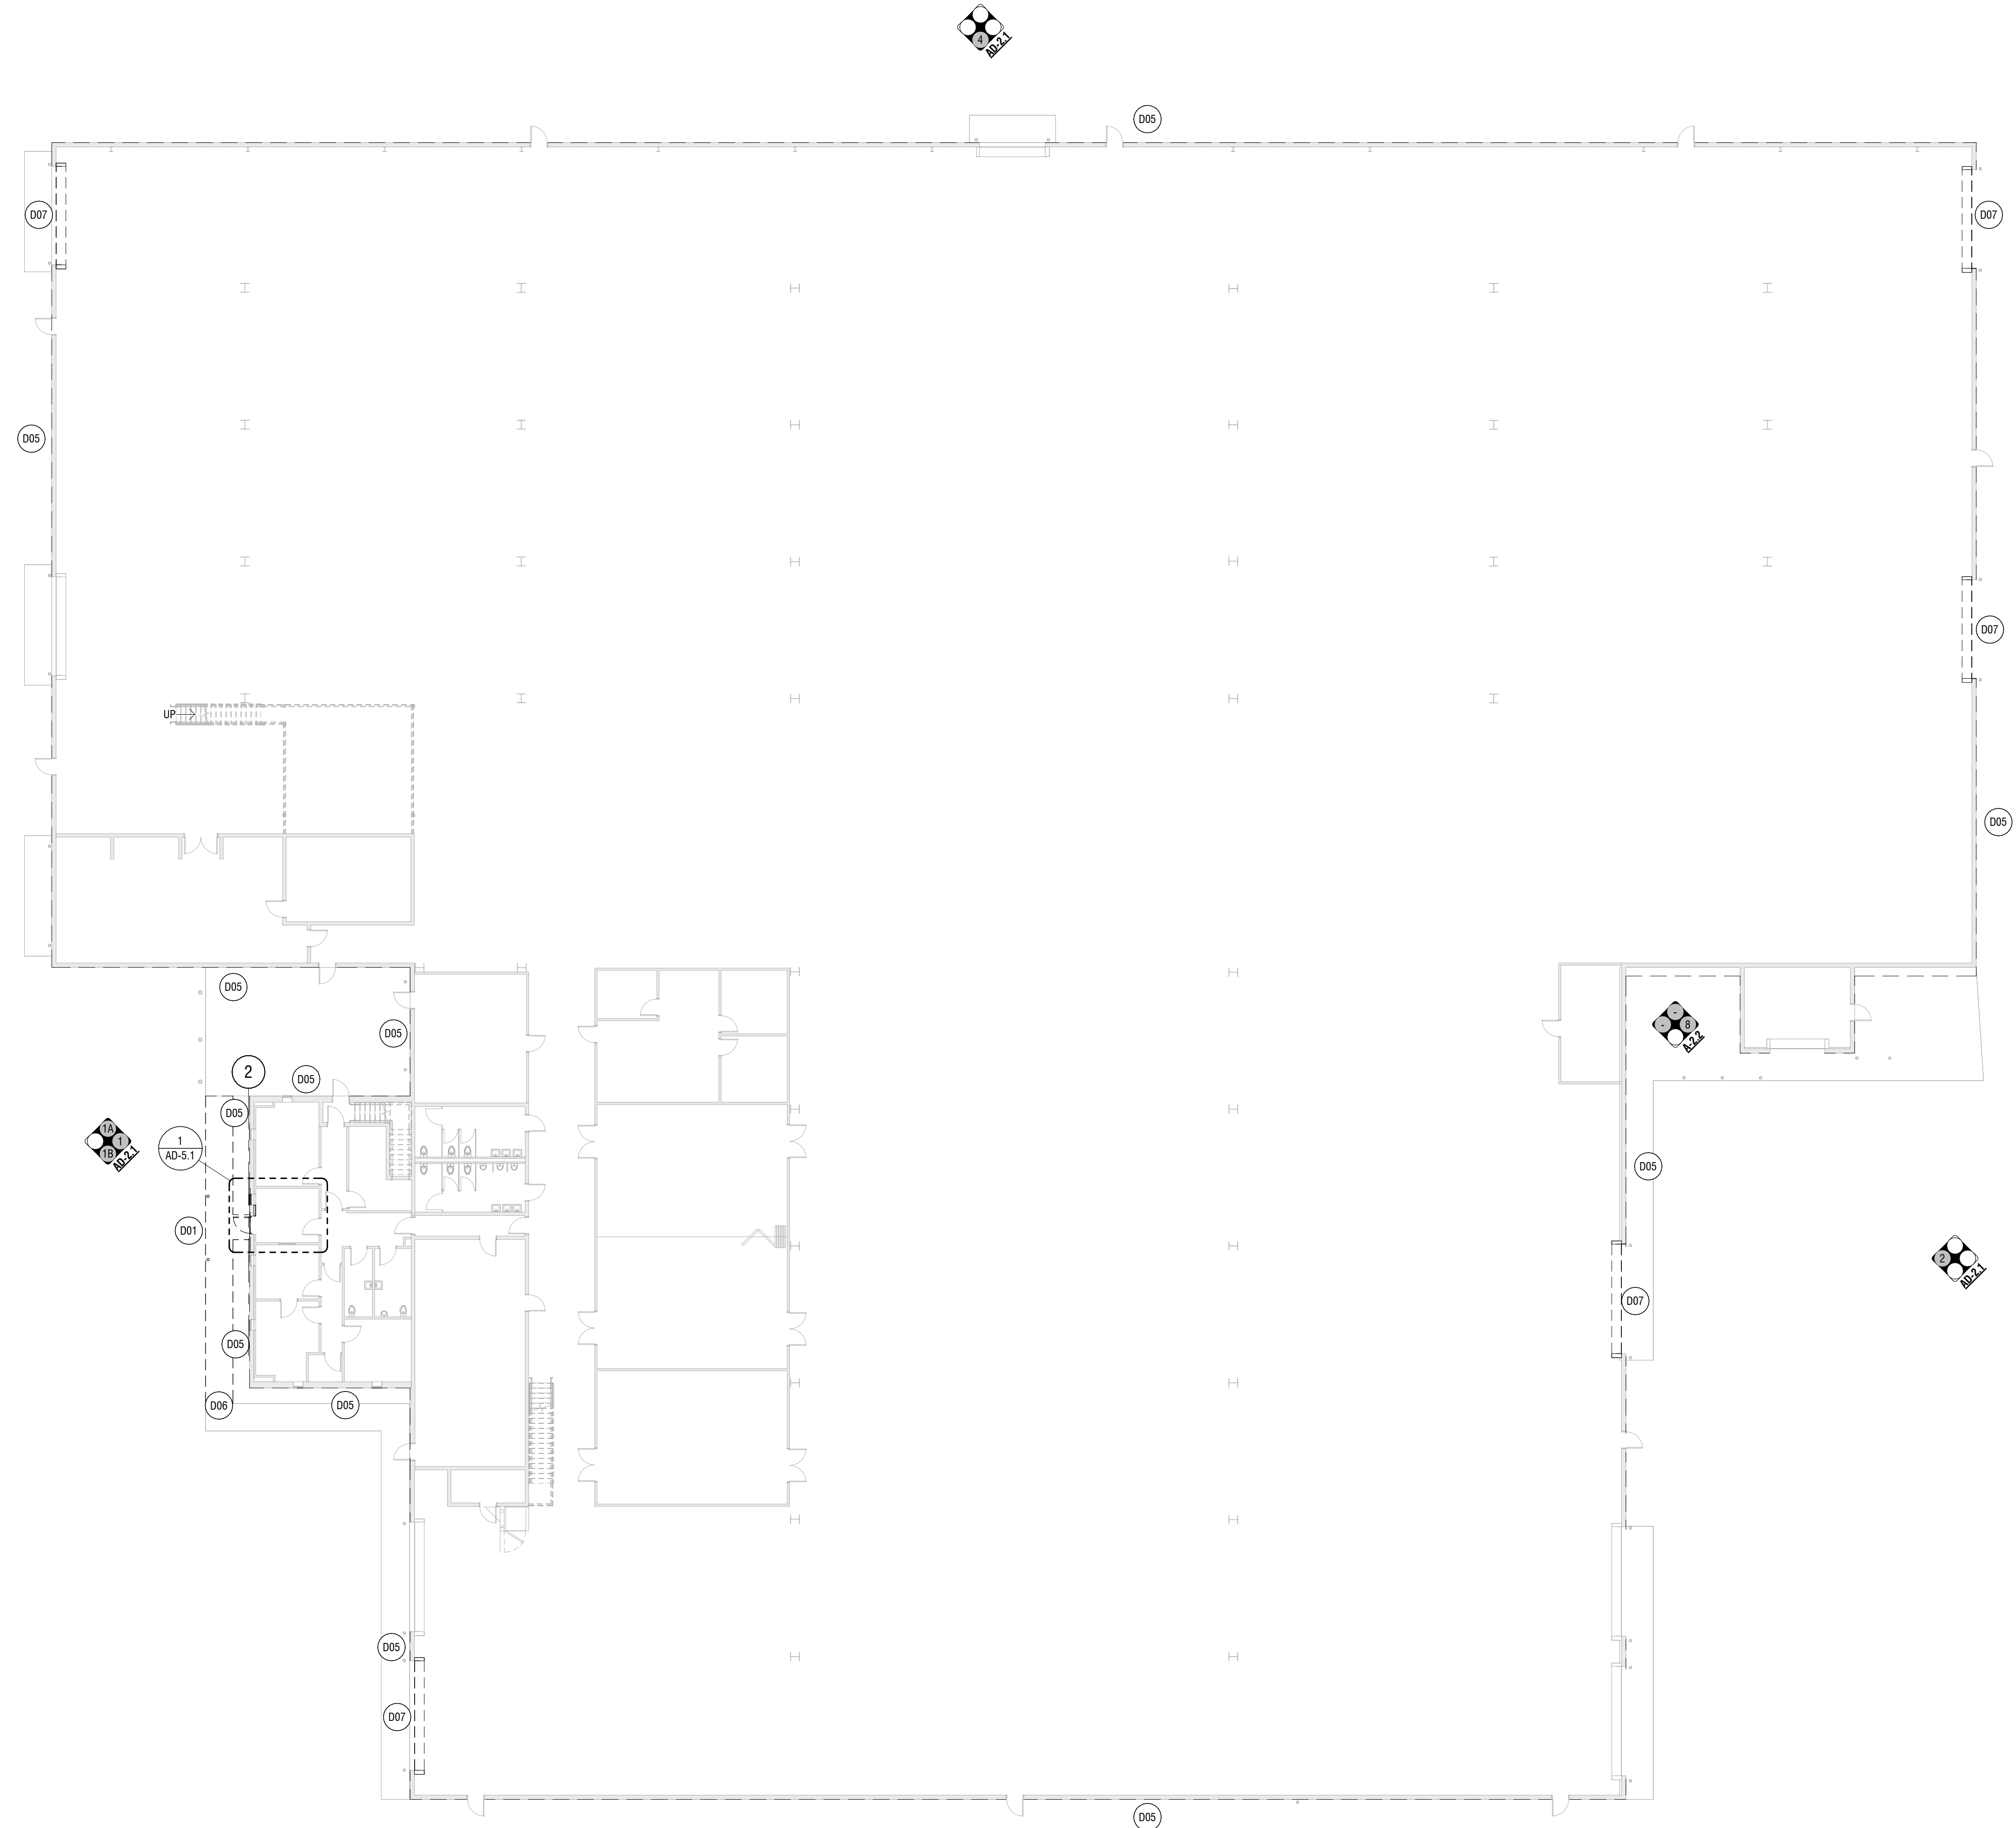

1 FIRST FLOOR DEMOLITION PLAN
SCALE: 1/16" = 1'-0" SHEET: AD-1.1

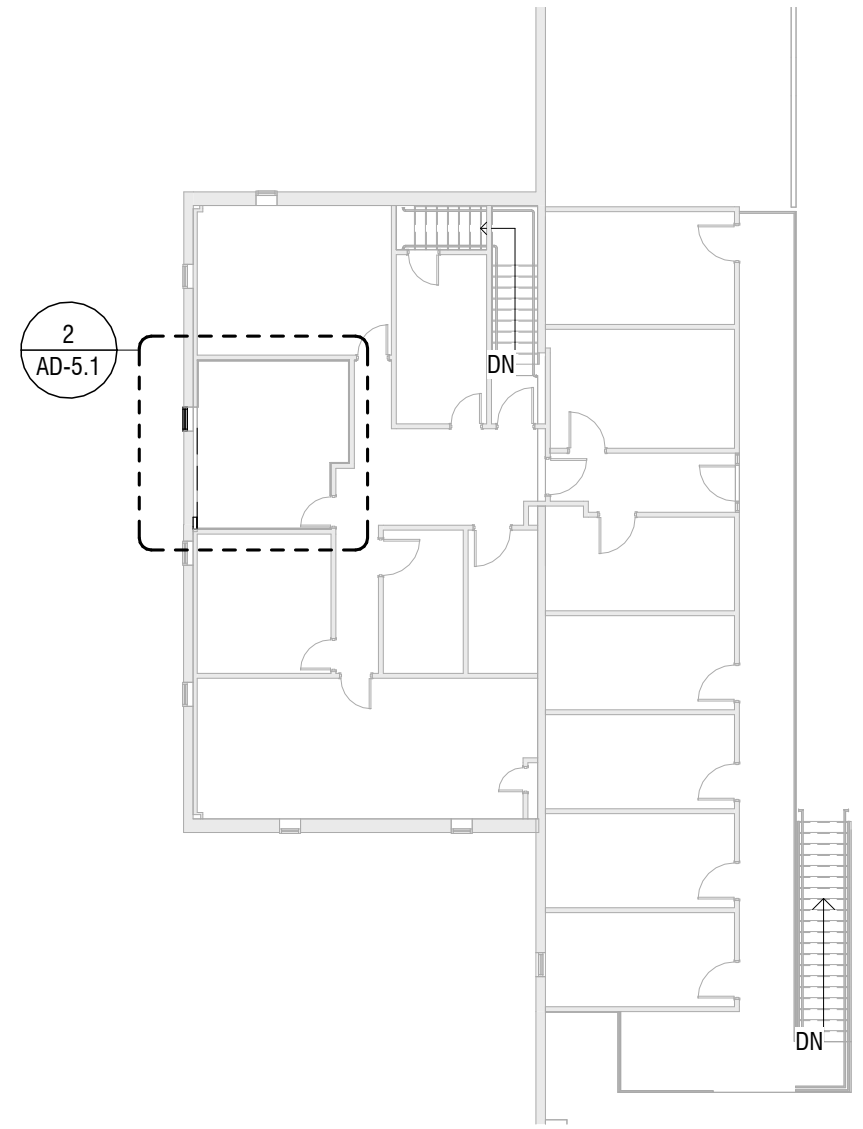

2 02 SECOND FLOOR DEMOLITION PLAN
SCALE: 1/16" = 1'-0" SHEET: AD-1.1

ATC RENOVATION
NEW RIVER COMMUNITY & TECHNICAL COLLEGE
527 Odd Rd.
Ghent, WV 25843




OMNI
ARCHITECTS

AD-1.1

Copyright © All rights reserved. Reproduction in whole or in part is prohibited. This drawing is an instrument of service, is the property of the architect and may not be used in any way without written permission of this firm.
Project No: 2024008.001 Drawn by: ---


FIRST AND SECOND FLOOR DEMOLITION PLAN

| # | Note Text |
|-----|---|
| D01 | REMOVE EXISTING CANOPY IN ITS ENTIRETY |
| D02 | REMOVE STOREFRONT WINDOW |
| D03 | REMOVE PORTION OF METAL PANEL FOR NEW ADDITION VESTIBULE. SEE NEW WORK PLANS |
| D04 | REMOVE FULL GLASS DOOR AND FRAME |
| D05 | REMOVE METAL PANEL UP TO GIRT AT +/- 7'-4" AROUND ENTIRE PERIMETER. FIELD VERIFY GIRT HEIGHT. |
| D07 | REMOVE OVERHEAD DOOR AND OLD ACCESSORIES AS NECESSARY FOR INSTALLATION ON NEW OVERHEAD DOORS. |
| D08 | REMOVE TRANSLUCENT PANELS. |

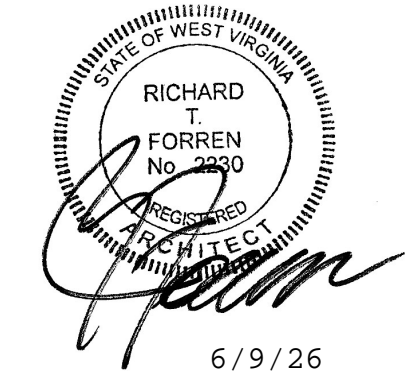


BID DOCUMENTS
06.09.2026
REVISIONS ▼


***NOTE: DEMOLITION NOTES D01, D02, D03, AND D04 REFERRING TO EXTERIOR VESTIBULE AND CANOPY ALTERNATIONS ARE ONLY IF ALTERNATE #1 IS APPROVED**

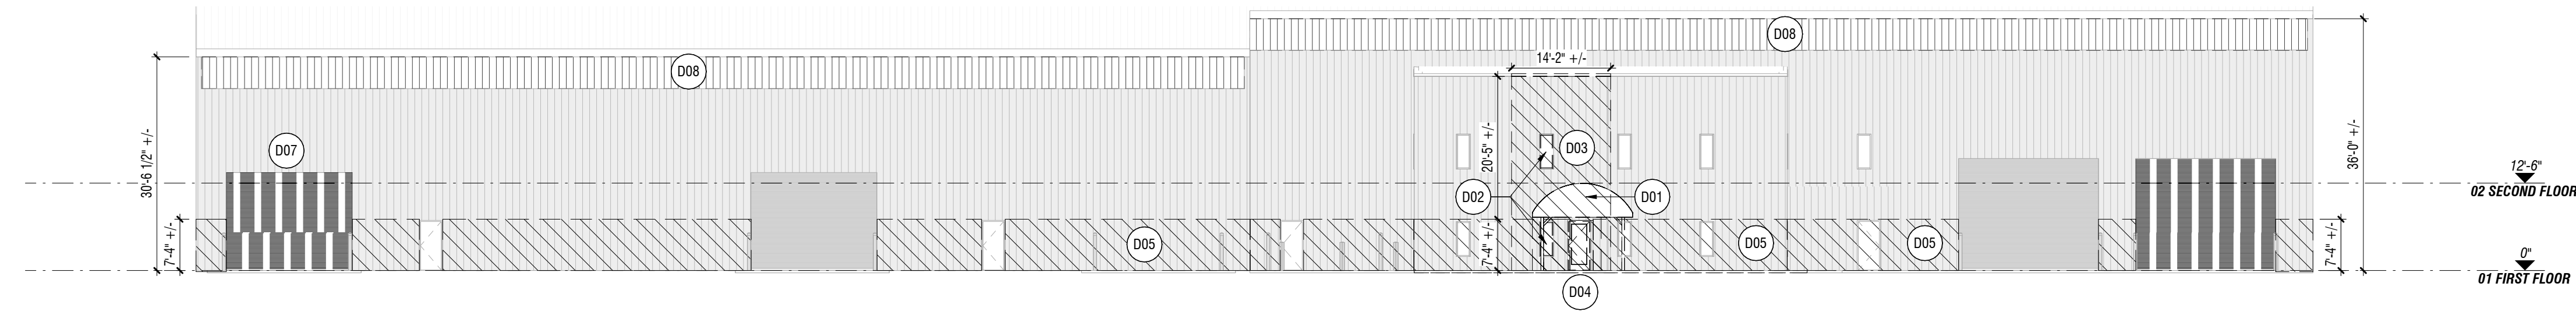


1 WEST ELEVATION (DEMO)
SCALE: 1/16" = 1'-0" SHEET: AD-2.1

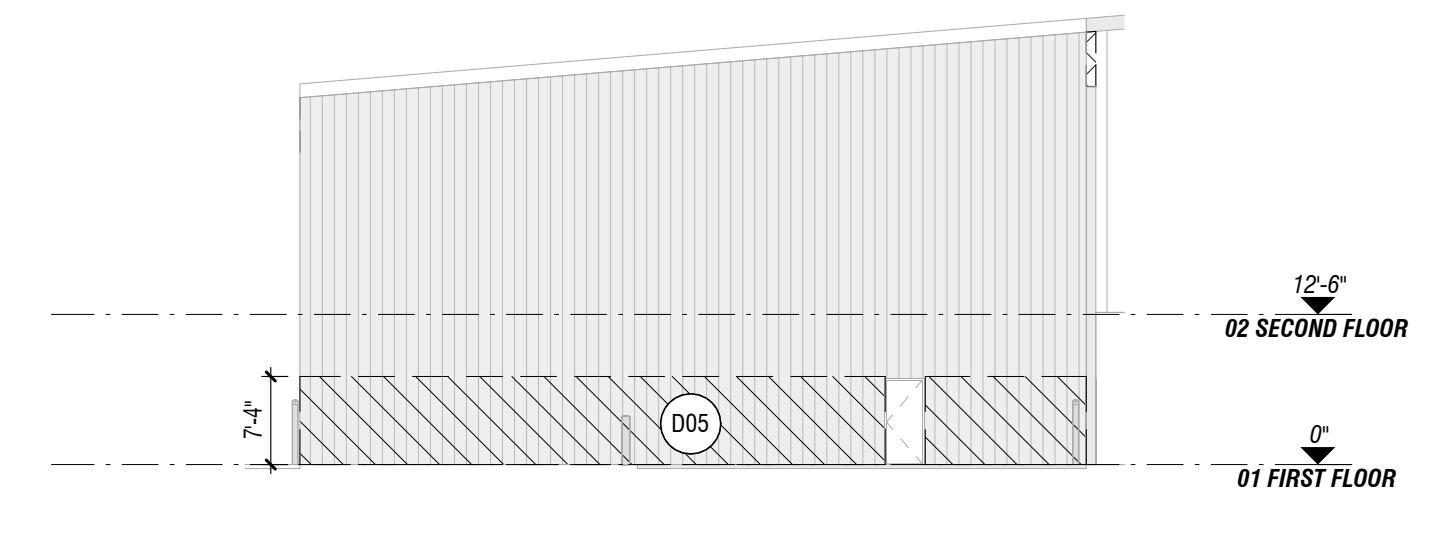


1A ALCOVE ELEVATION 1 (DEMO)
SCALE: 1/16" = 1'-0" SHEET: AD-2.1

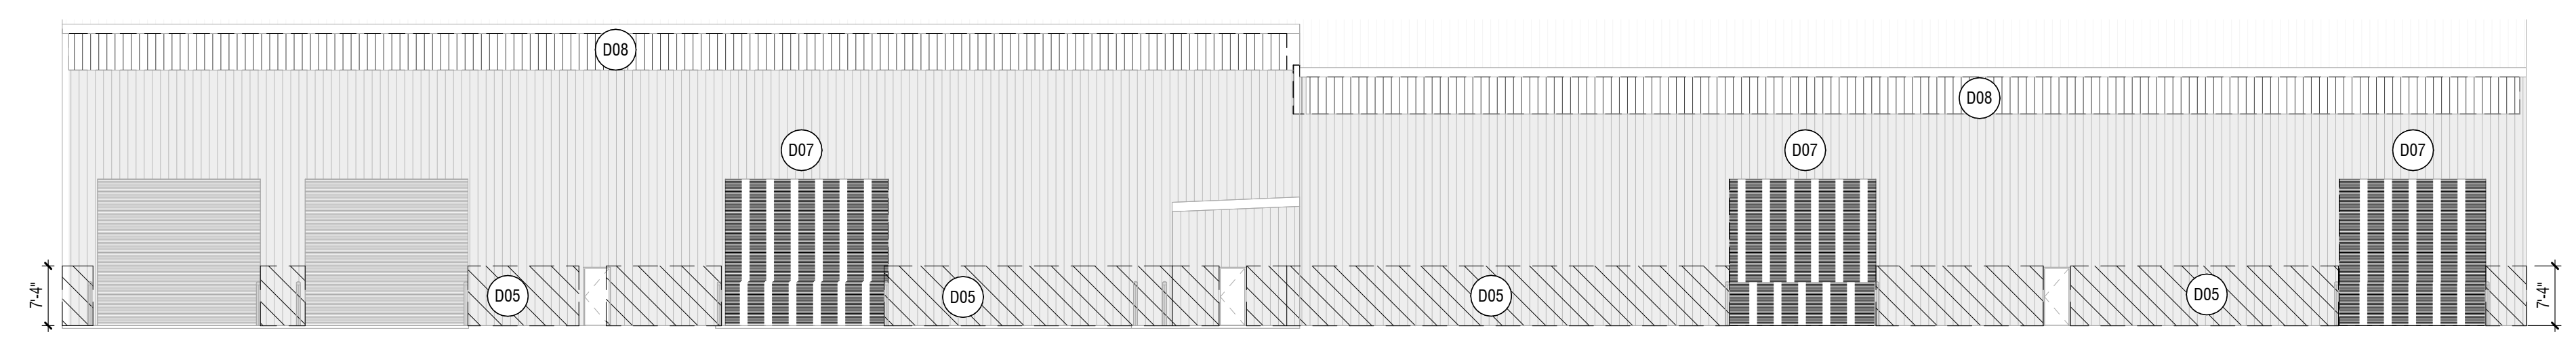


2 EAST ELEVATION (DEMO)
SCALE: 1/16" = 1'-0" SHEET: AD-2.1

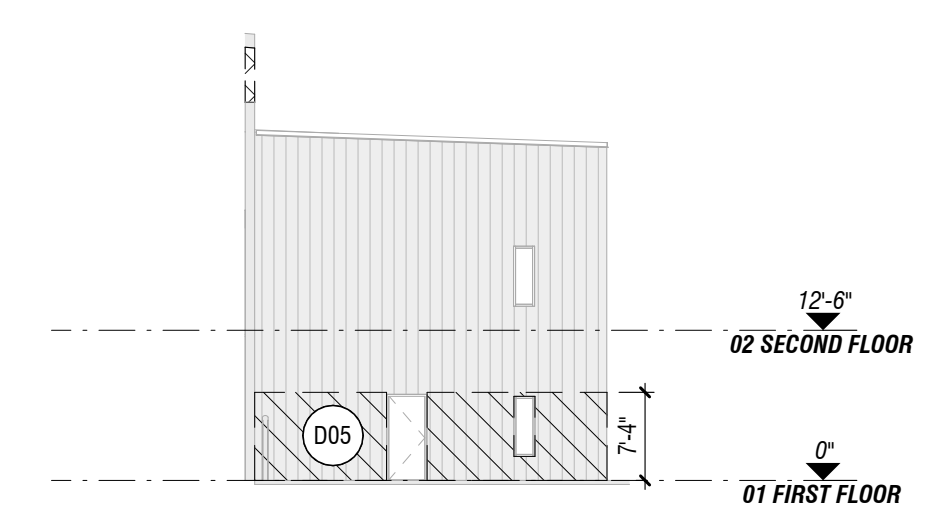

1B ALCOVE ELEVATION 2 (DEMO)
SCALE: 1/16" = 1'-0" SHEET: AD-2.1

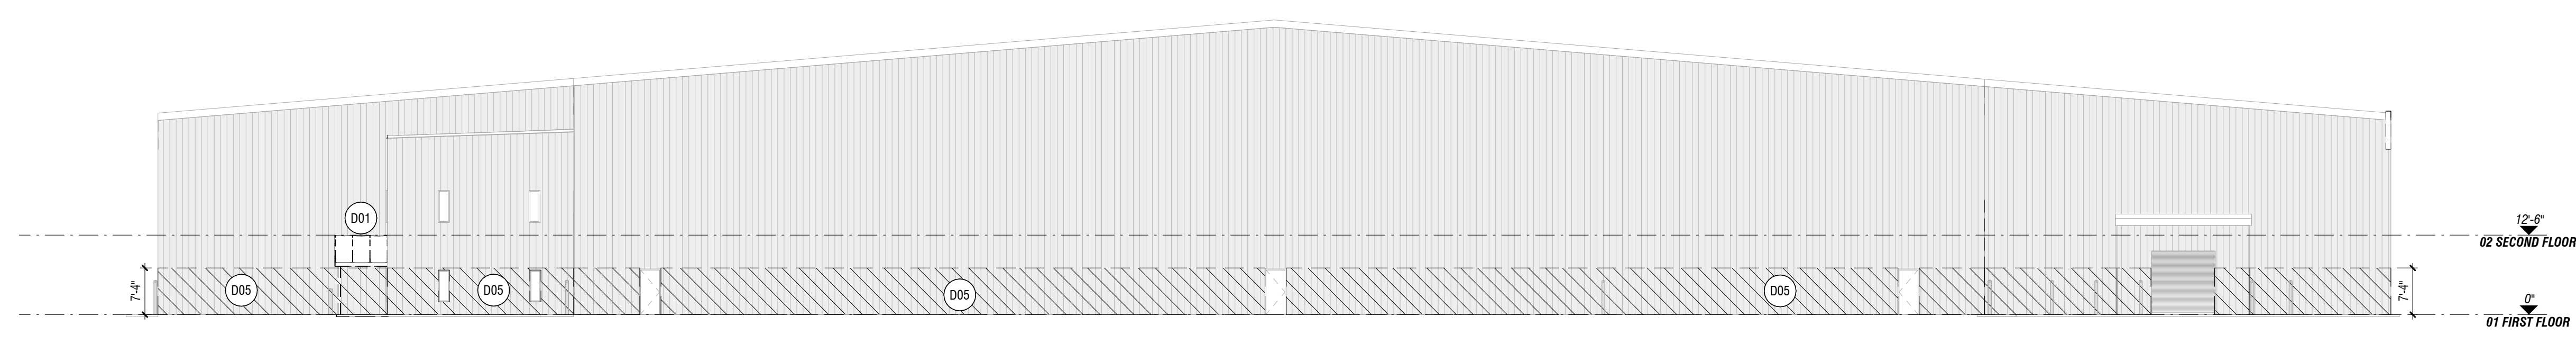


3 SOUTH ELEVATION (DEMO)
SCALE: 1/16" = 1'-0" SHEET: AD-2.1

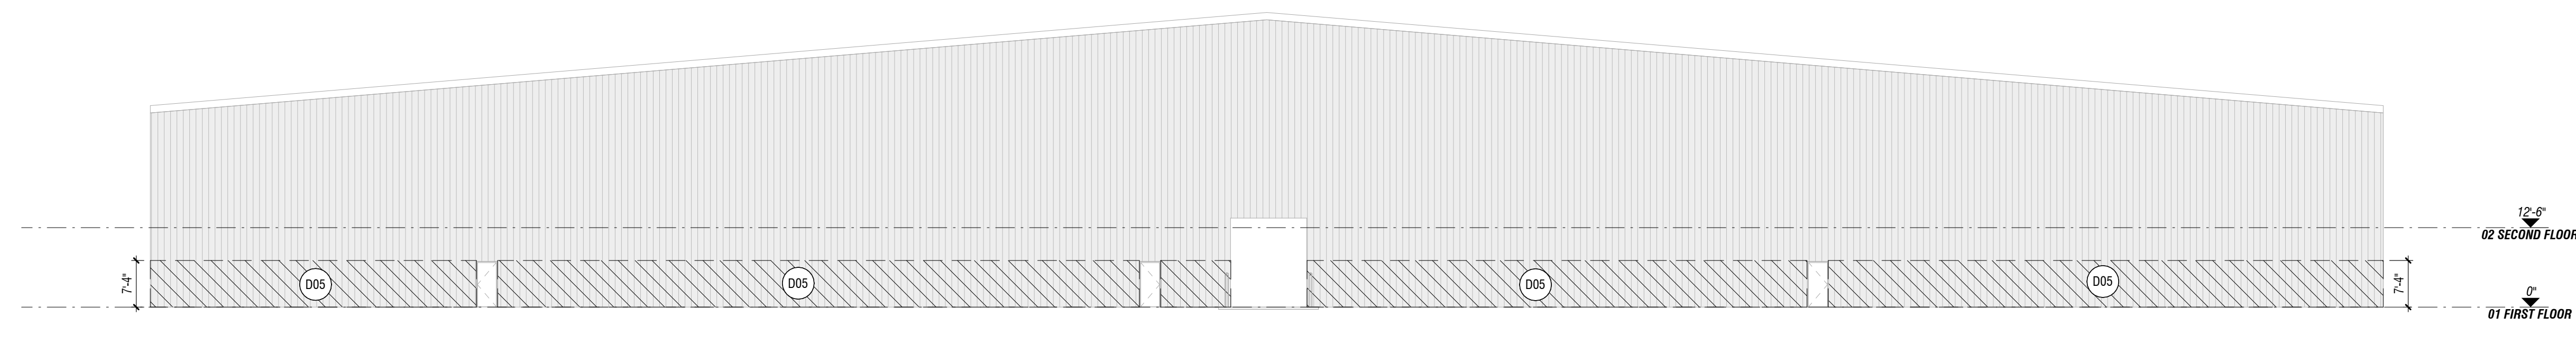

4 NORTH ELEVATION (DEMO)
SCALE: 1/16" = 1'-0" SHEET: AD-2.1

ATC RENOVATION
NEW RIVER COMMUNITY & TECHNICAL COLLEGE
527 Odd Rd.
Ghent, WV 25843

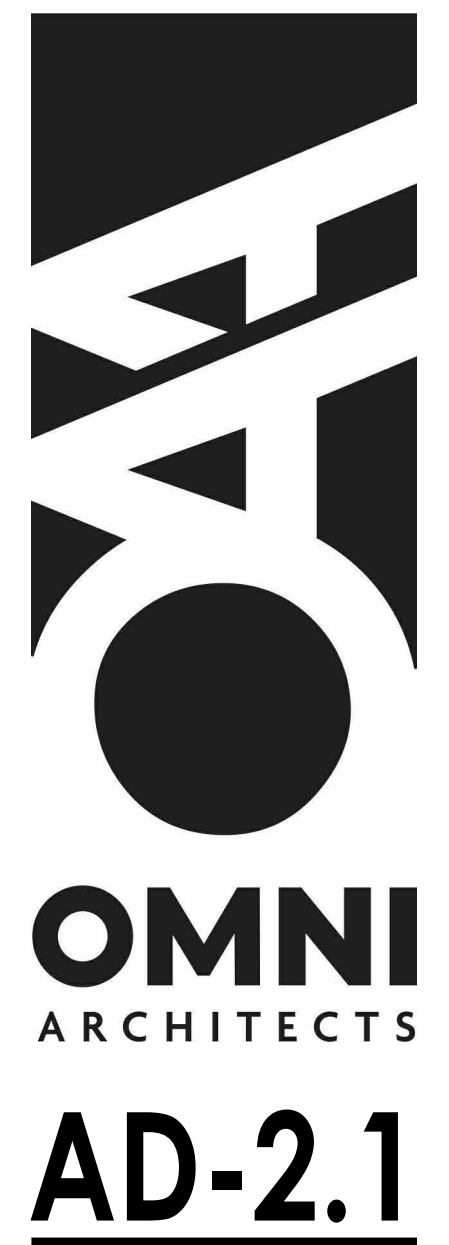


Copyright © All rights reserved. Reproduction in whole or in part is prohibited. This drawing is an instrument of service, is the property of the Architect and may not be used in any way without written permission of this firm.
Project No: 2024008.001 Drawn by: ---

EXTERIOR ELEVATIONS - DEMOLITION

KEYED DEMOLITION NOTES


| # | Note Text |
|-----|---|
| D01 | REMOVE EXISTING CANOPY IN ITS ENTIRETY |
| D02 | REMOVE STOREFRONT WINDOW |
| D03 | REMOVE PORTION OF METAL PANEL FOR NEW ADDITION VESTIBULE. SEE NEW WORK PLANS |
| D04 | REMOVE FULL GLASS DOOR AND FRAME |
| D05 | REMOVE METAL PANEL UP TO GIRT AT +/- 7'-4" AROUND ENTIRE PERIMETER. FIELD VERIFY GIRT HEIGHT. |
| D06 | REMOVE EXISTING SIDEWALK. SEE CIVIL. |
| D09 | REMOVE PORTION OF METAL STUD PARTITION AND DRYWALL. |
| D10 | REMOVE WAINSCOTING. PRESERVE FOR RETURNS AND EXTENSIONS ON RE-FINISHED WALLS. SCARF EXTENSIONS. |
| D11 | CUT AND REMOVE PORTION OF PARAPET CAP WHERE NEW WALL ADJOINS EXISTING. |

*NOTE: DEMOLITION NOTES D01, D02, D03, AND D04, D06, D09, D10, AND D11 THAT REFER TO EXTERIOR VESTIBULE AND CANOPY ALTERATIONS ARE ONLY IF ALTERNATE #1 IS APPROVED

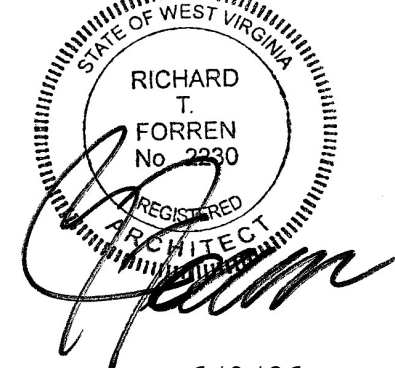


BID DOCUMENTS
06.09.2026

REVISIONS

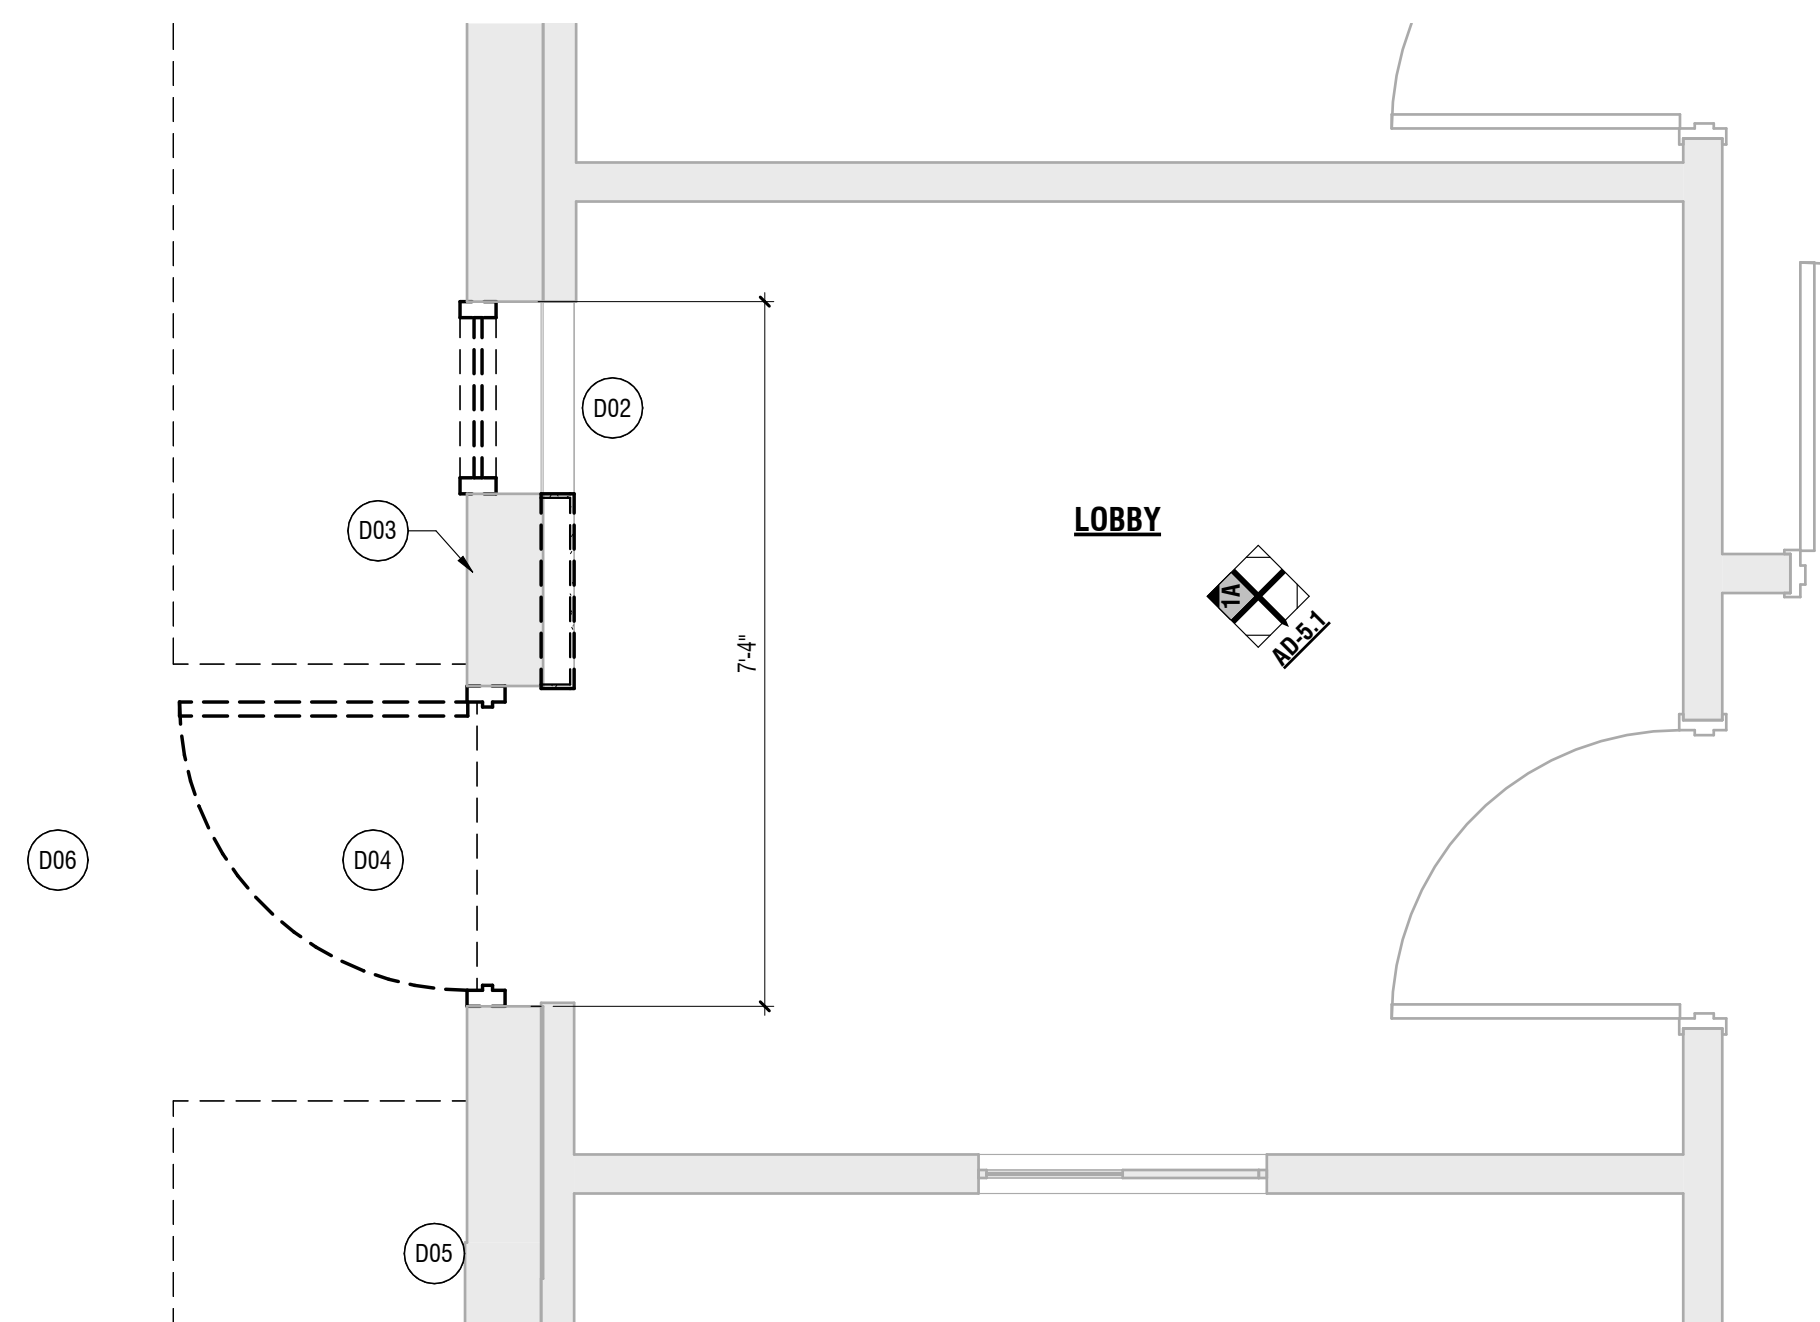


1 LOBBY ENLARGED DEMOLITION PLAN

SCALE: 1/2" = 1'-0" SHEET: AD-5.1

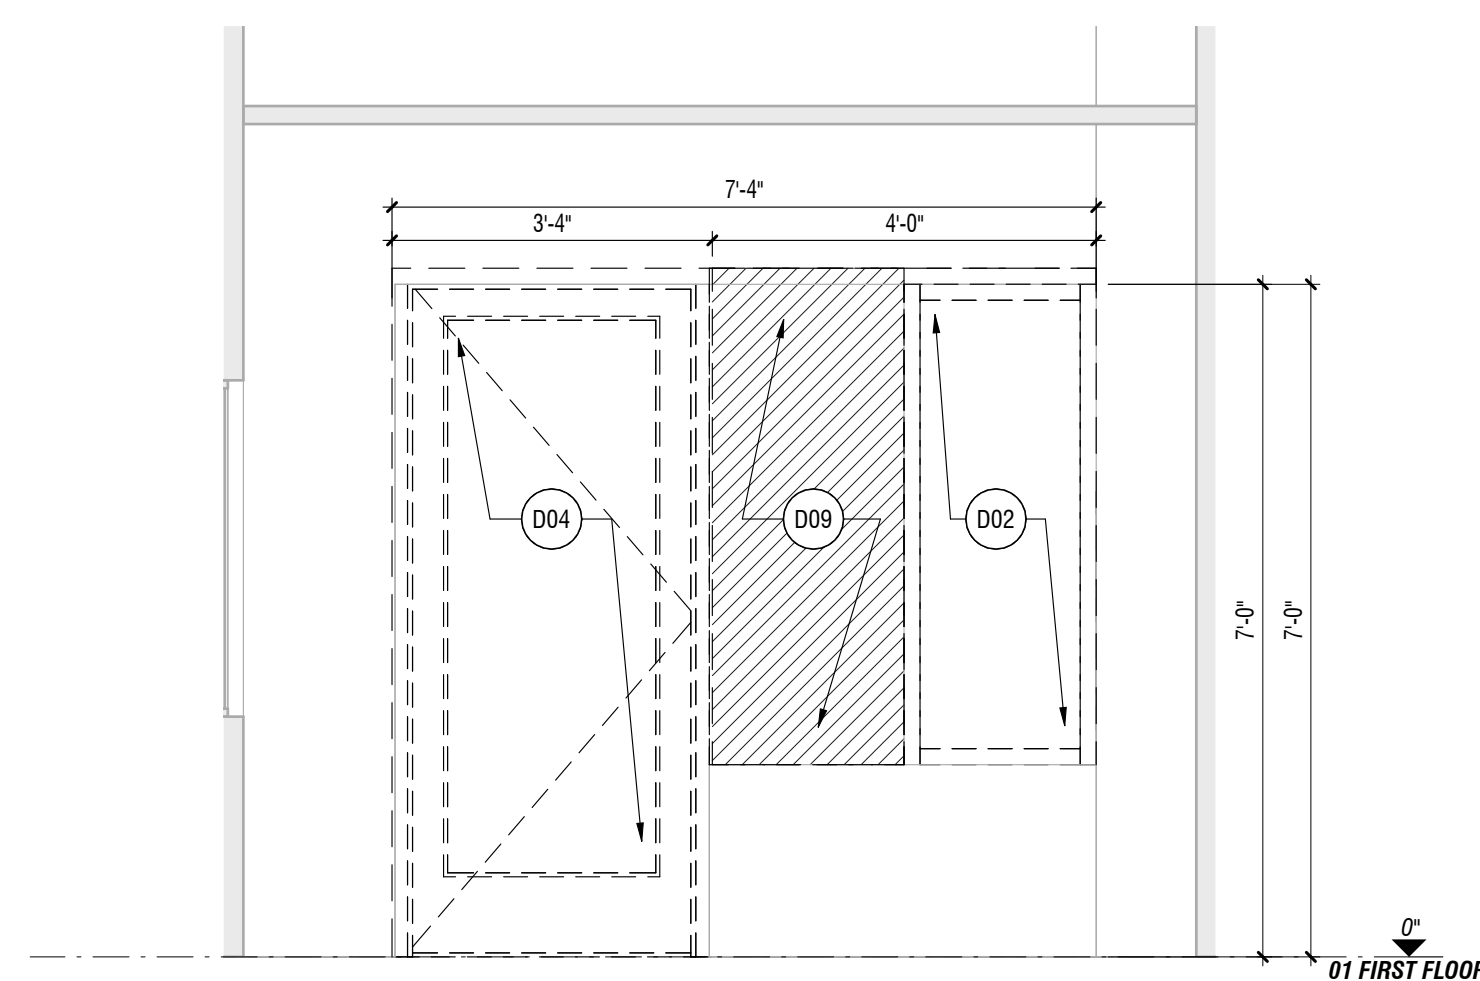


1A LOBBY INTERIOR DEMOLITION ELEVATION

SCALE: 1/2" = 1'-0" SHEET: AD-5.1

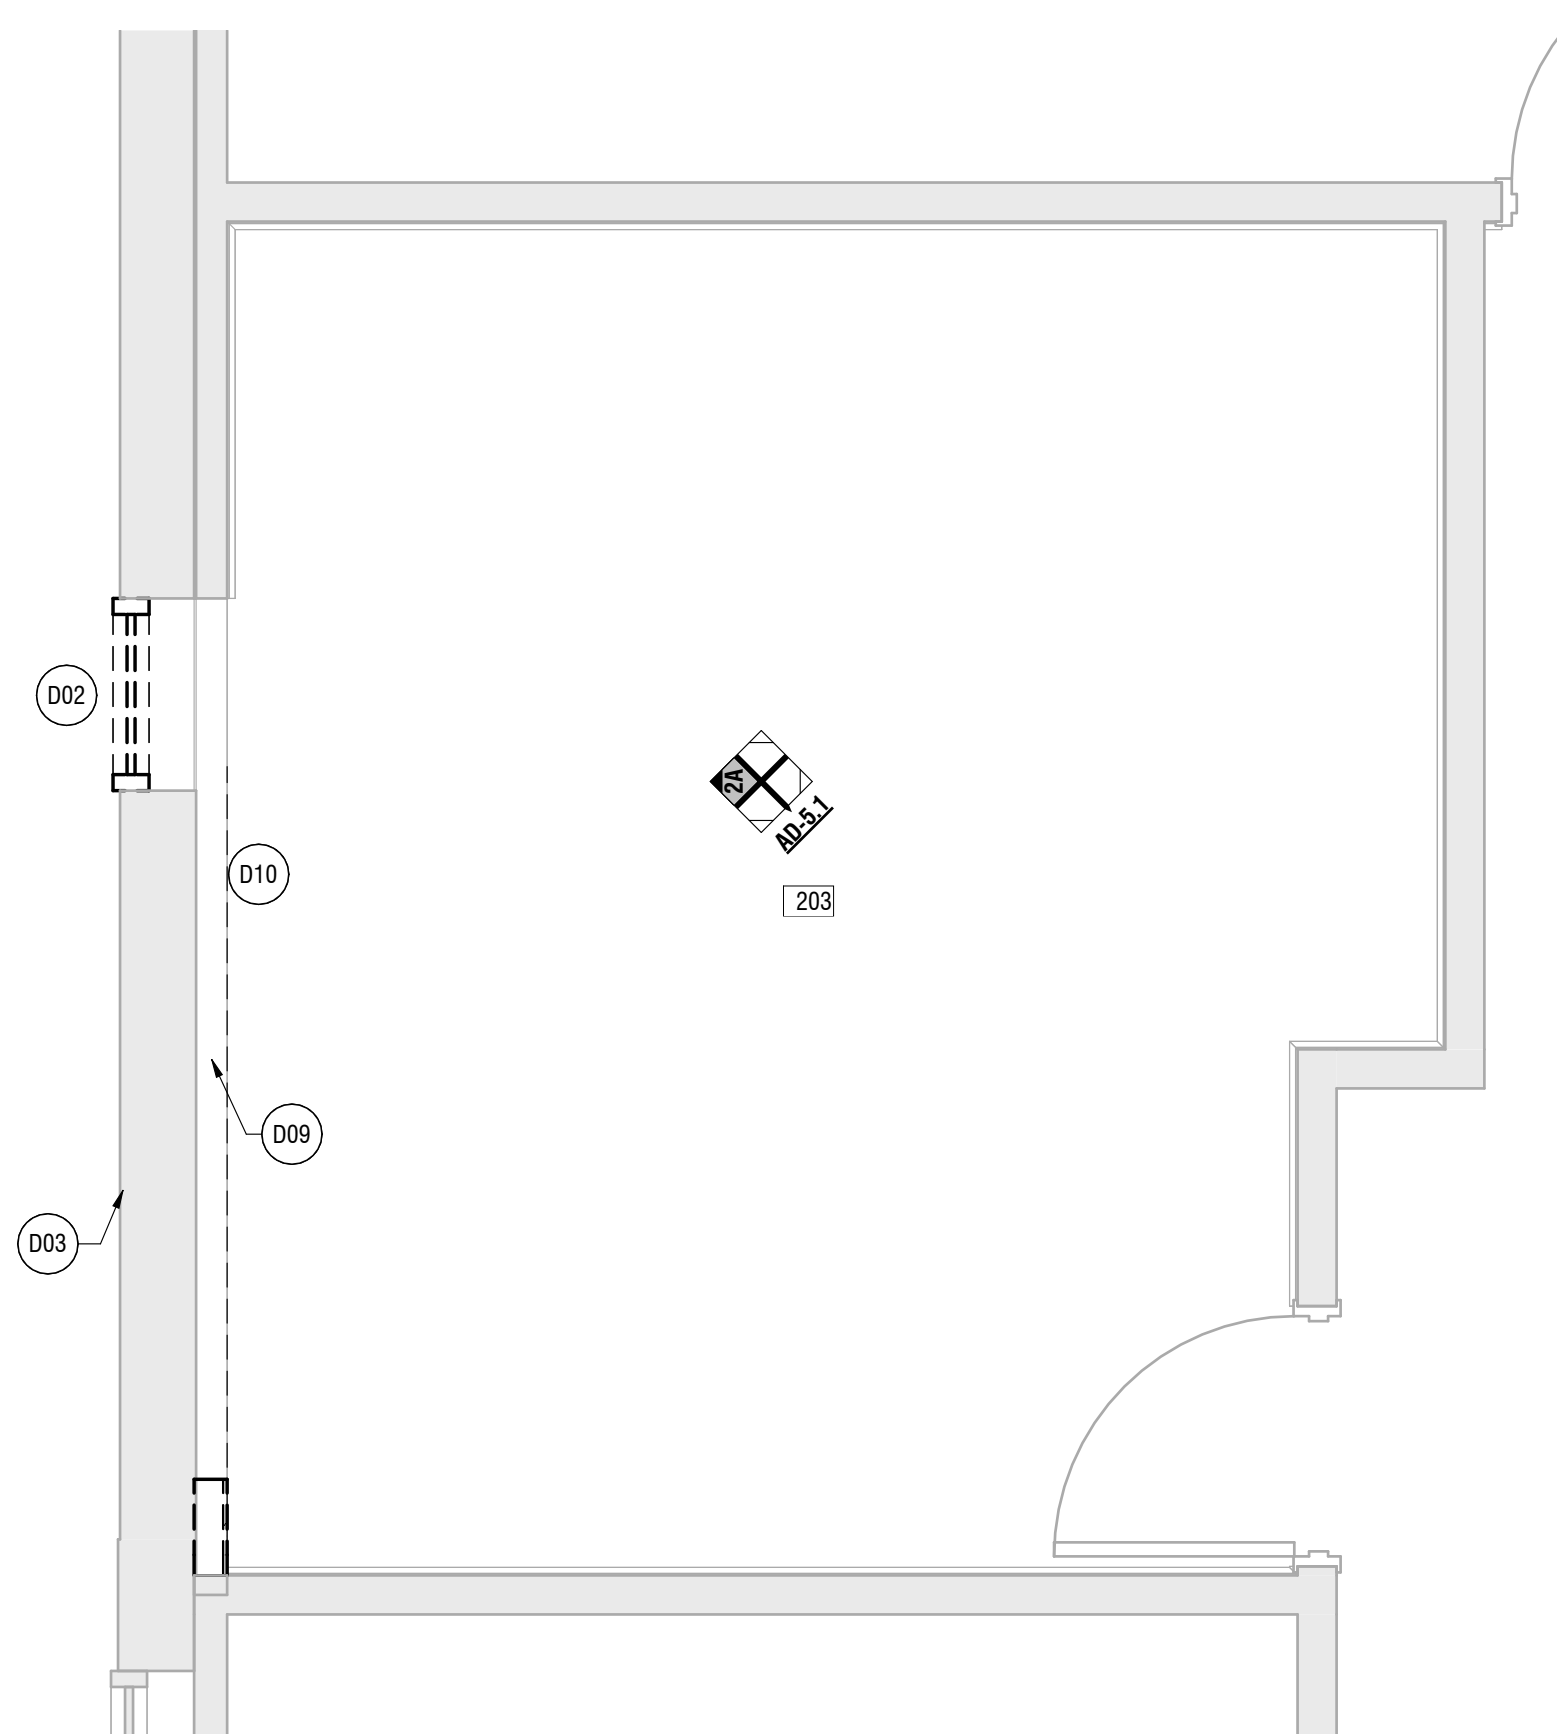


2 ROOM T203 ENLARGED DEMOLITION PLAN

SCALE: 1/2" = 1'-0" SHEET: AD-5.1

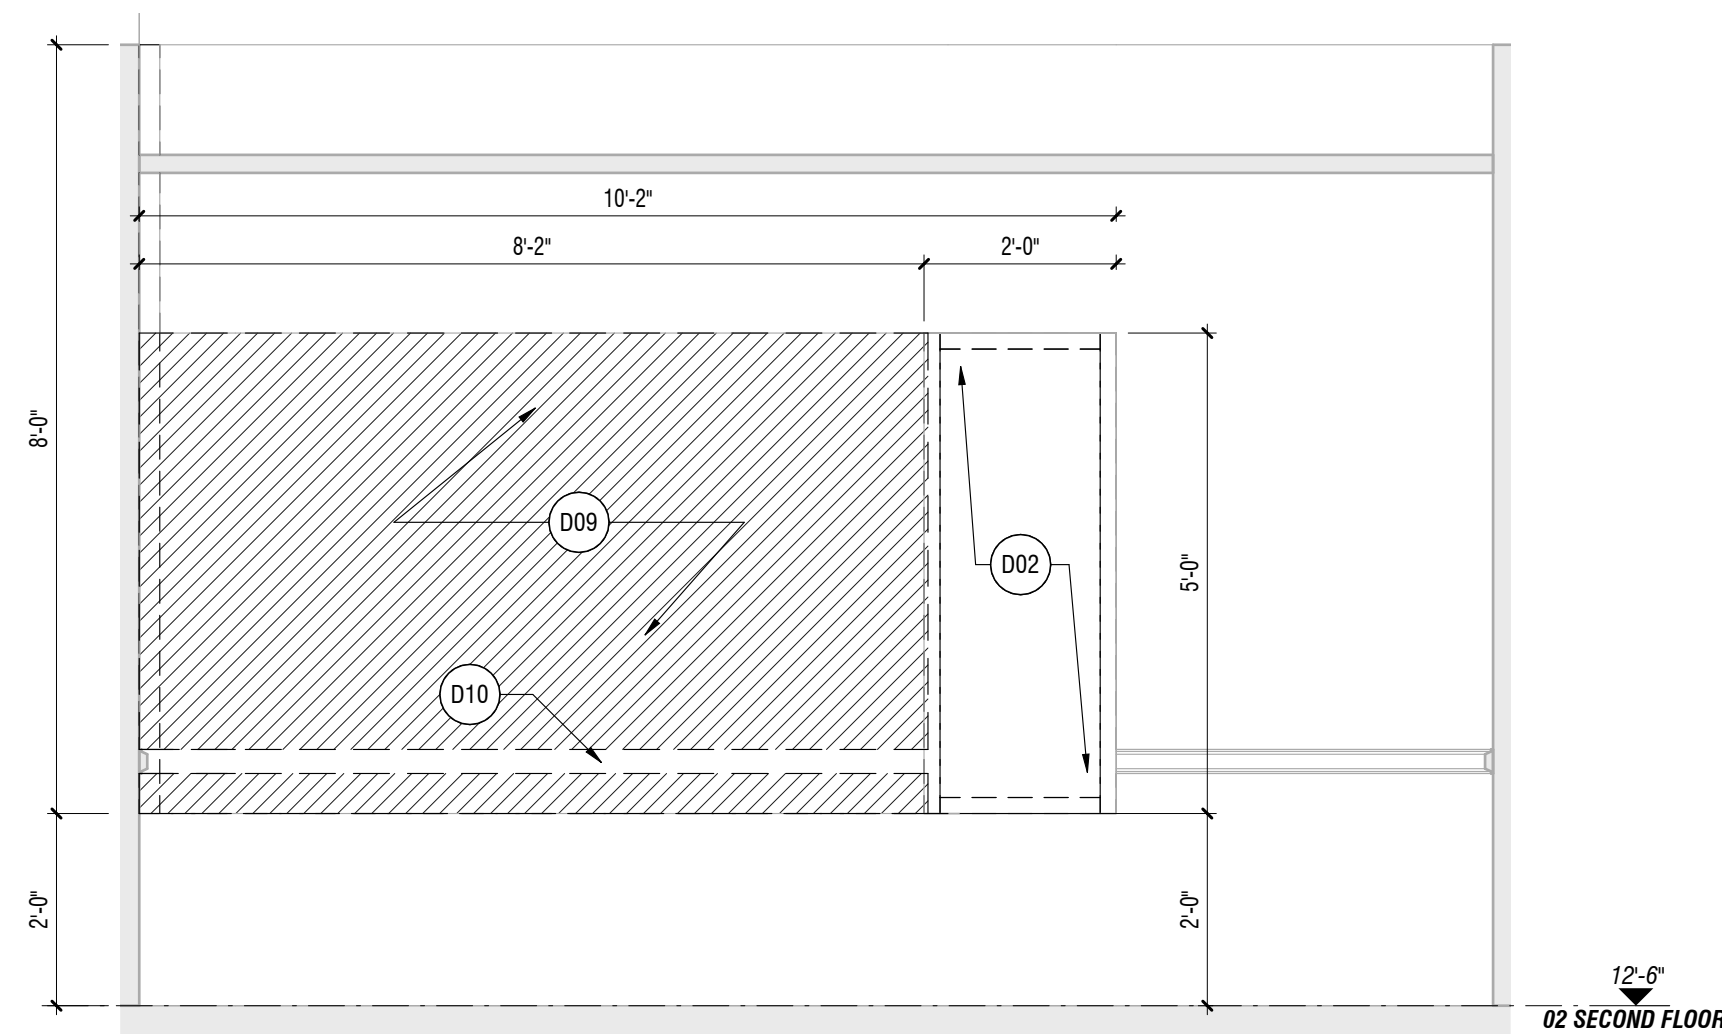

2A ROOM T203 INTERIOR DEMOLITION ELEVATION

SCALE: 1/2" = 1'-0" SHEET: AD-5.1

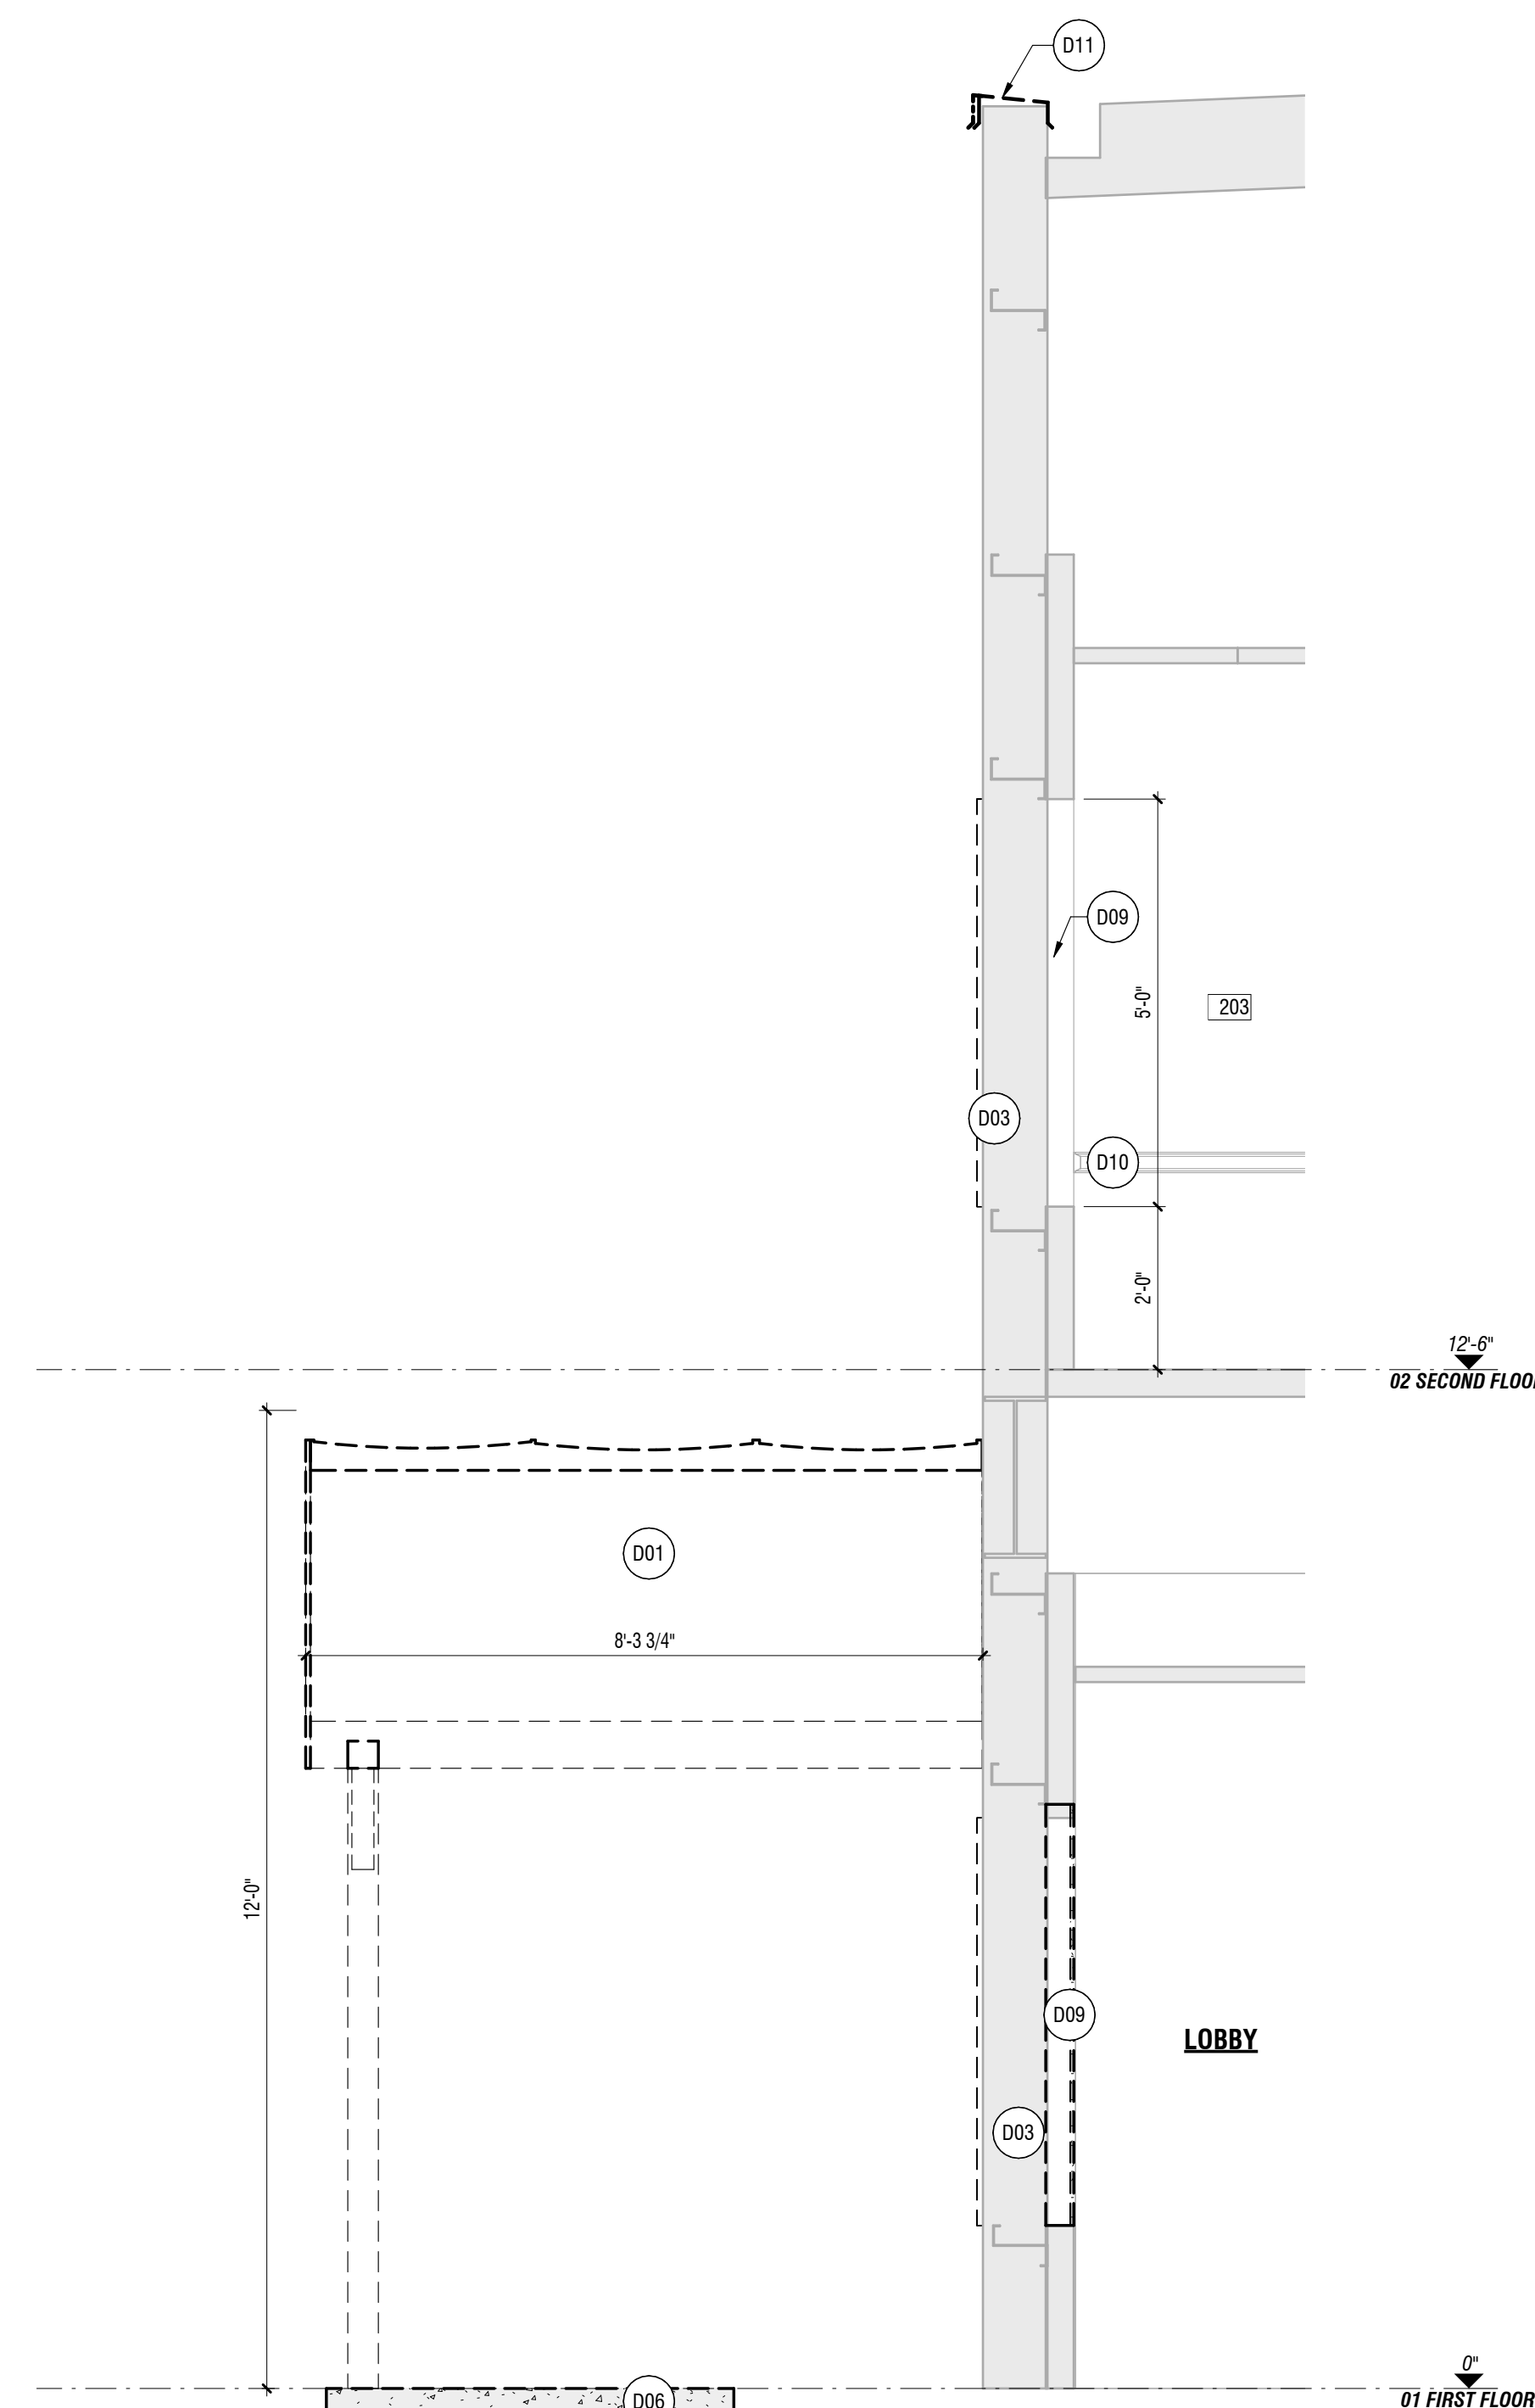

3 DEMOLITION SECTION

SCALE: 1/2" = 1'-0" SHEET: AD-5.1

ATC RENOVATION
NEW RIVER COMMUNITY & TECHNICAL COLLEGE
527 Odd Rd.
Chenoi, WV 25843







OMNI
ARCHITECTS

AD-5.1

Project No: 2024008.001 Drawn by: ---


DEMOLITION DETAILS - ALTERNATE #01

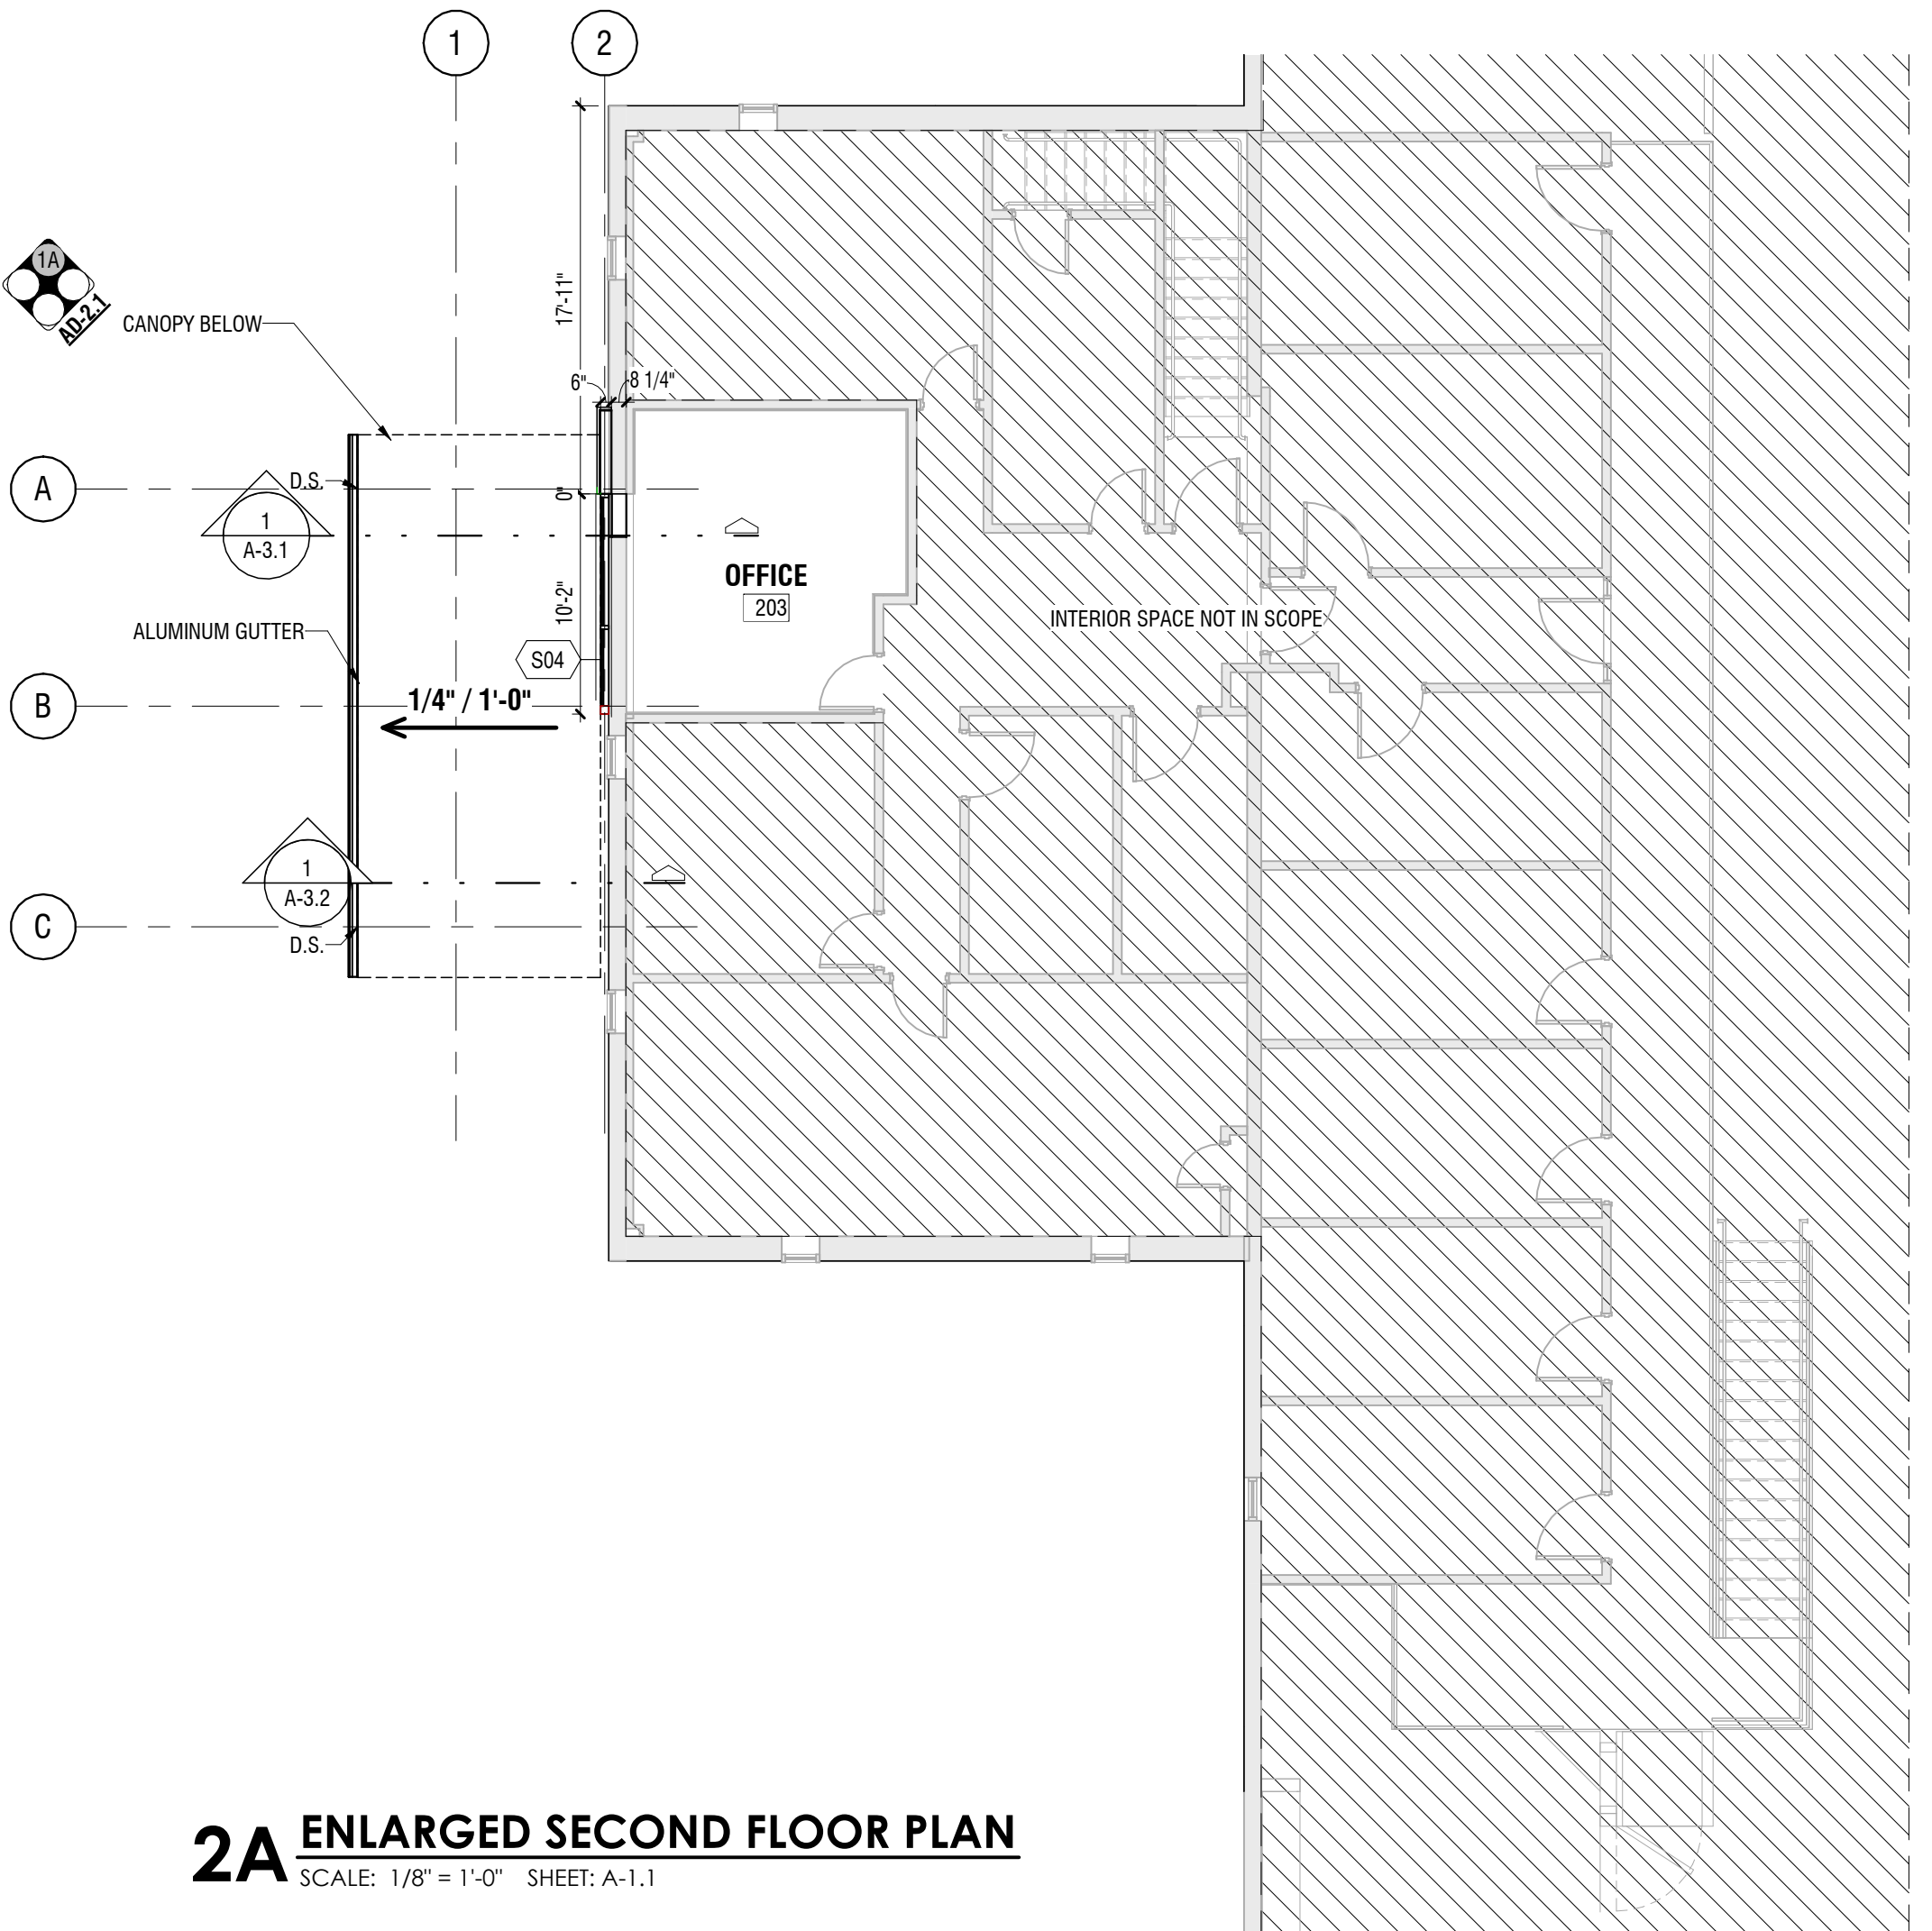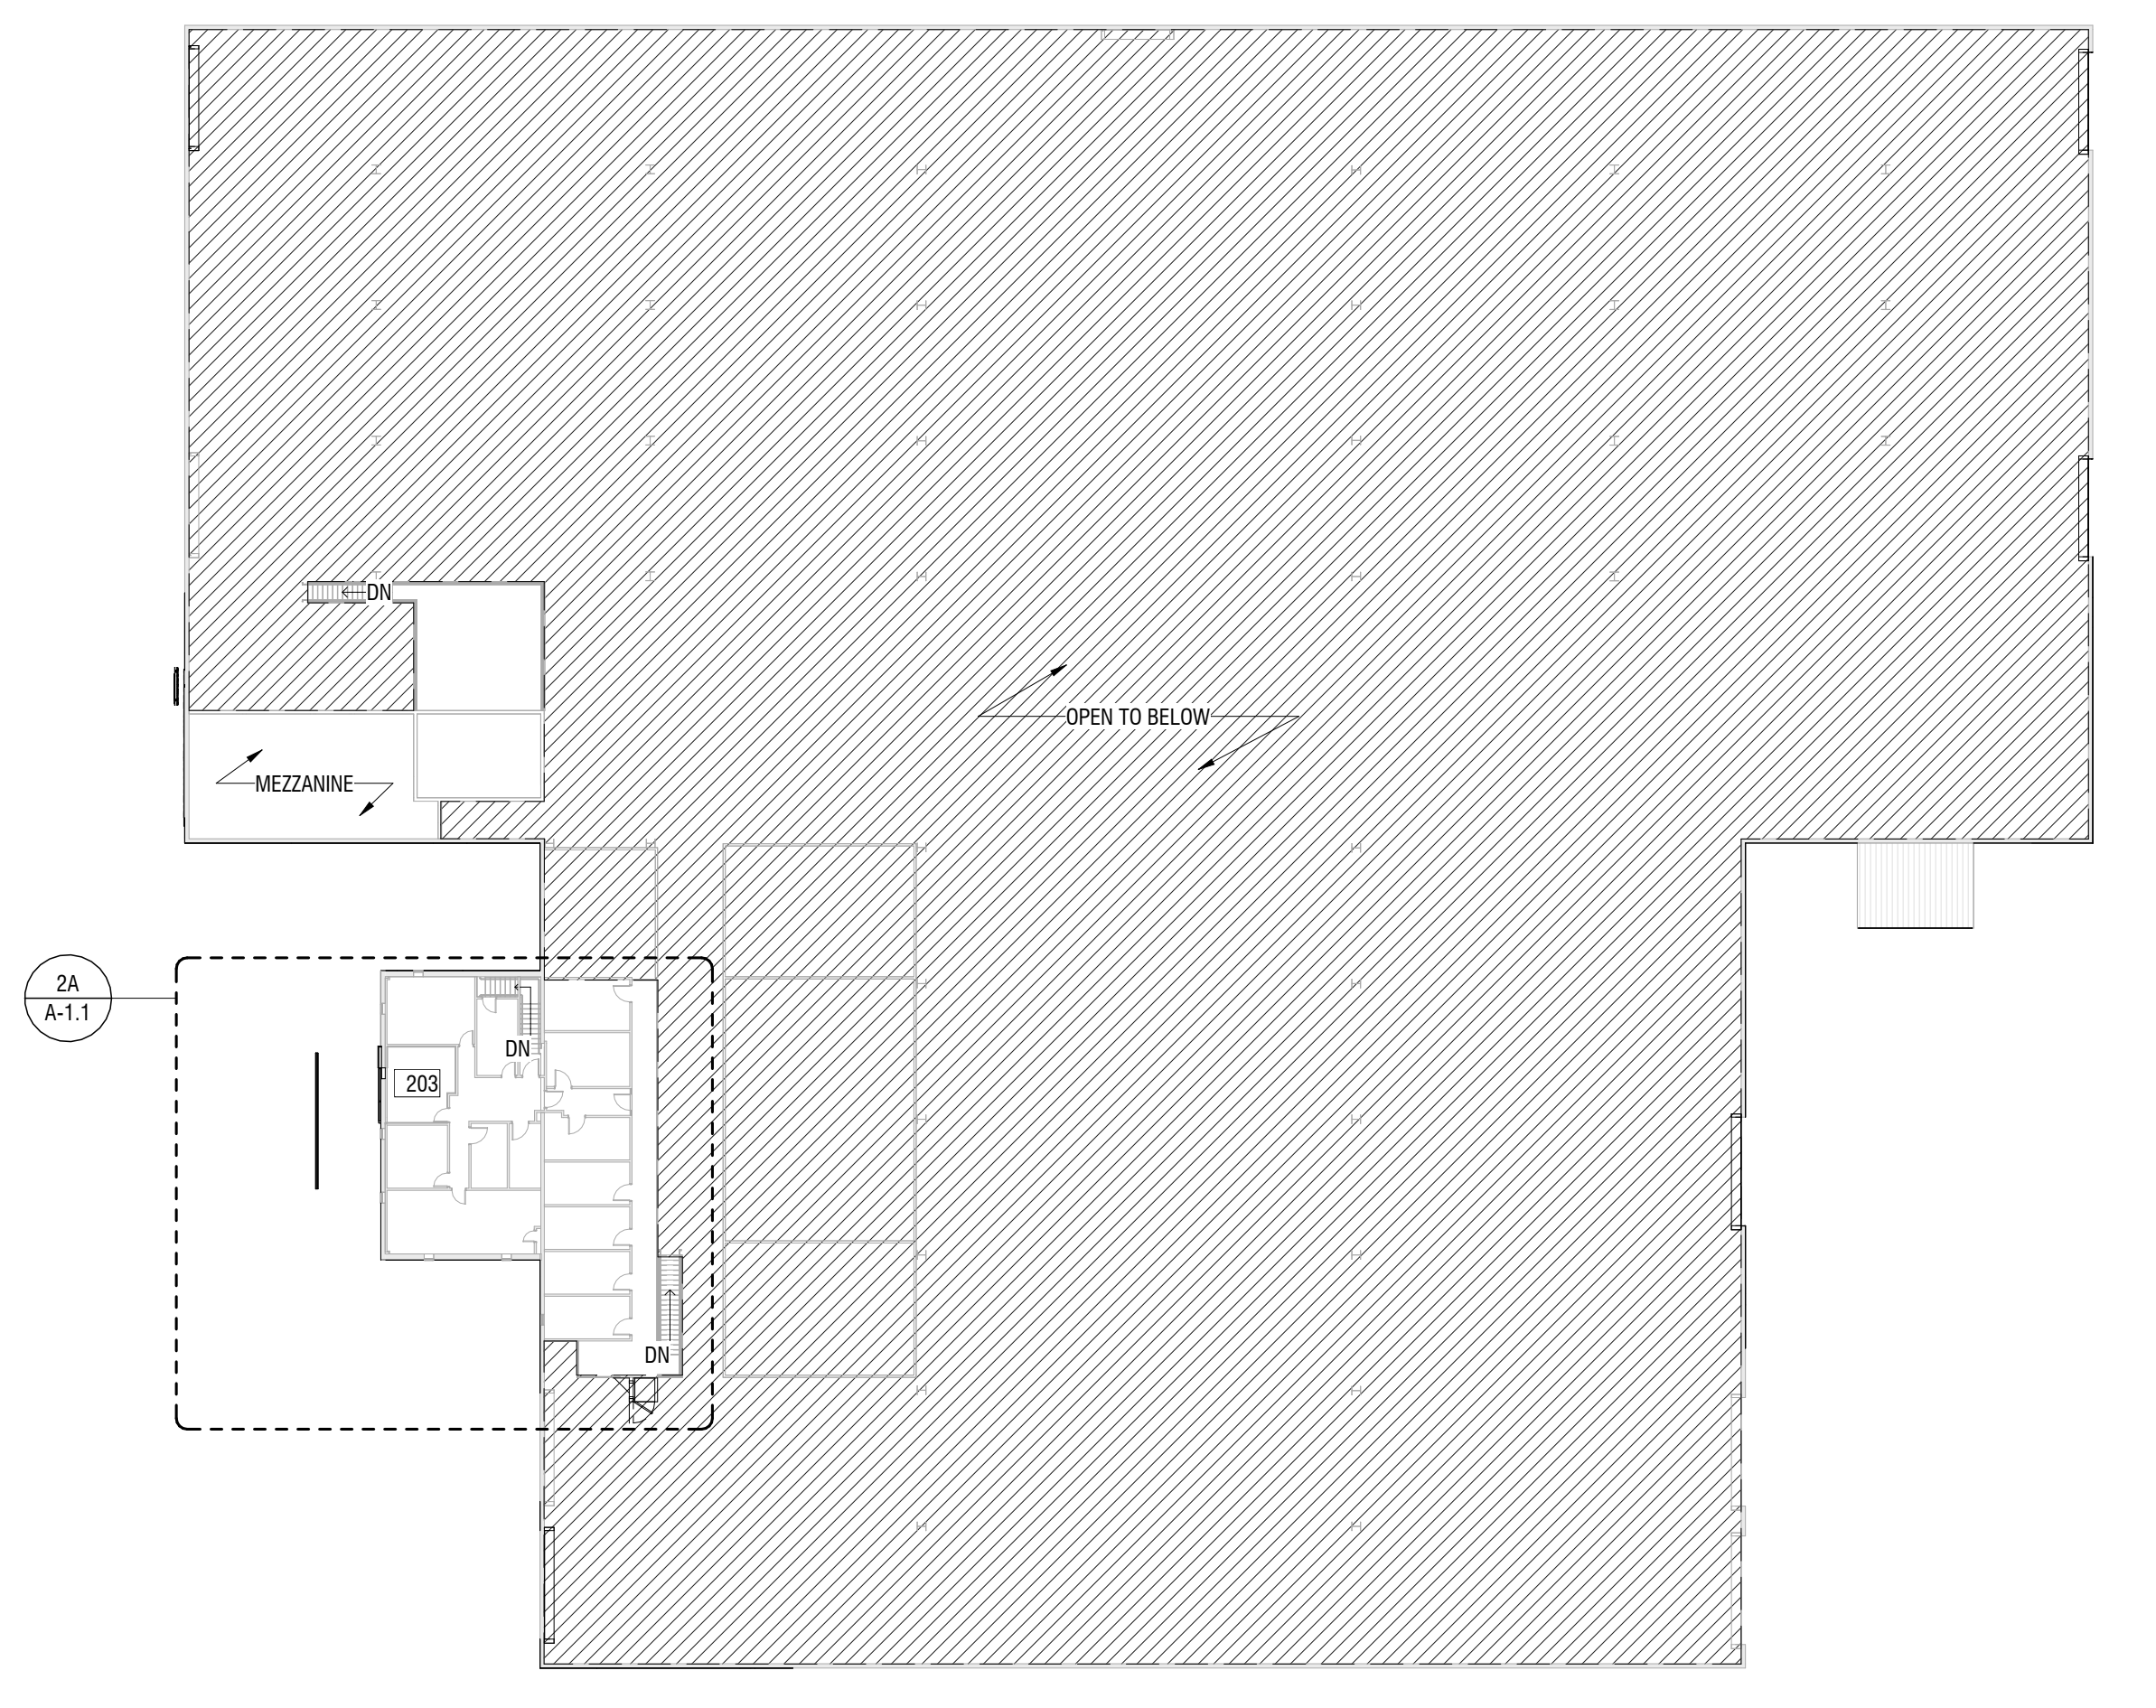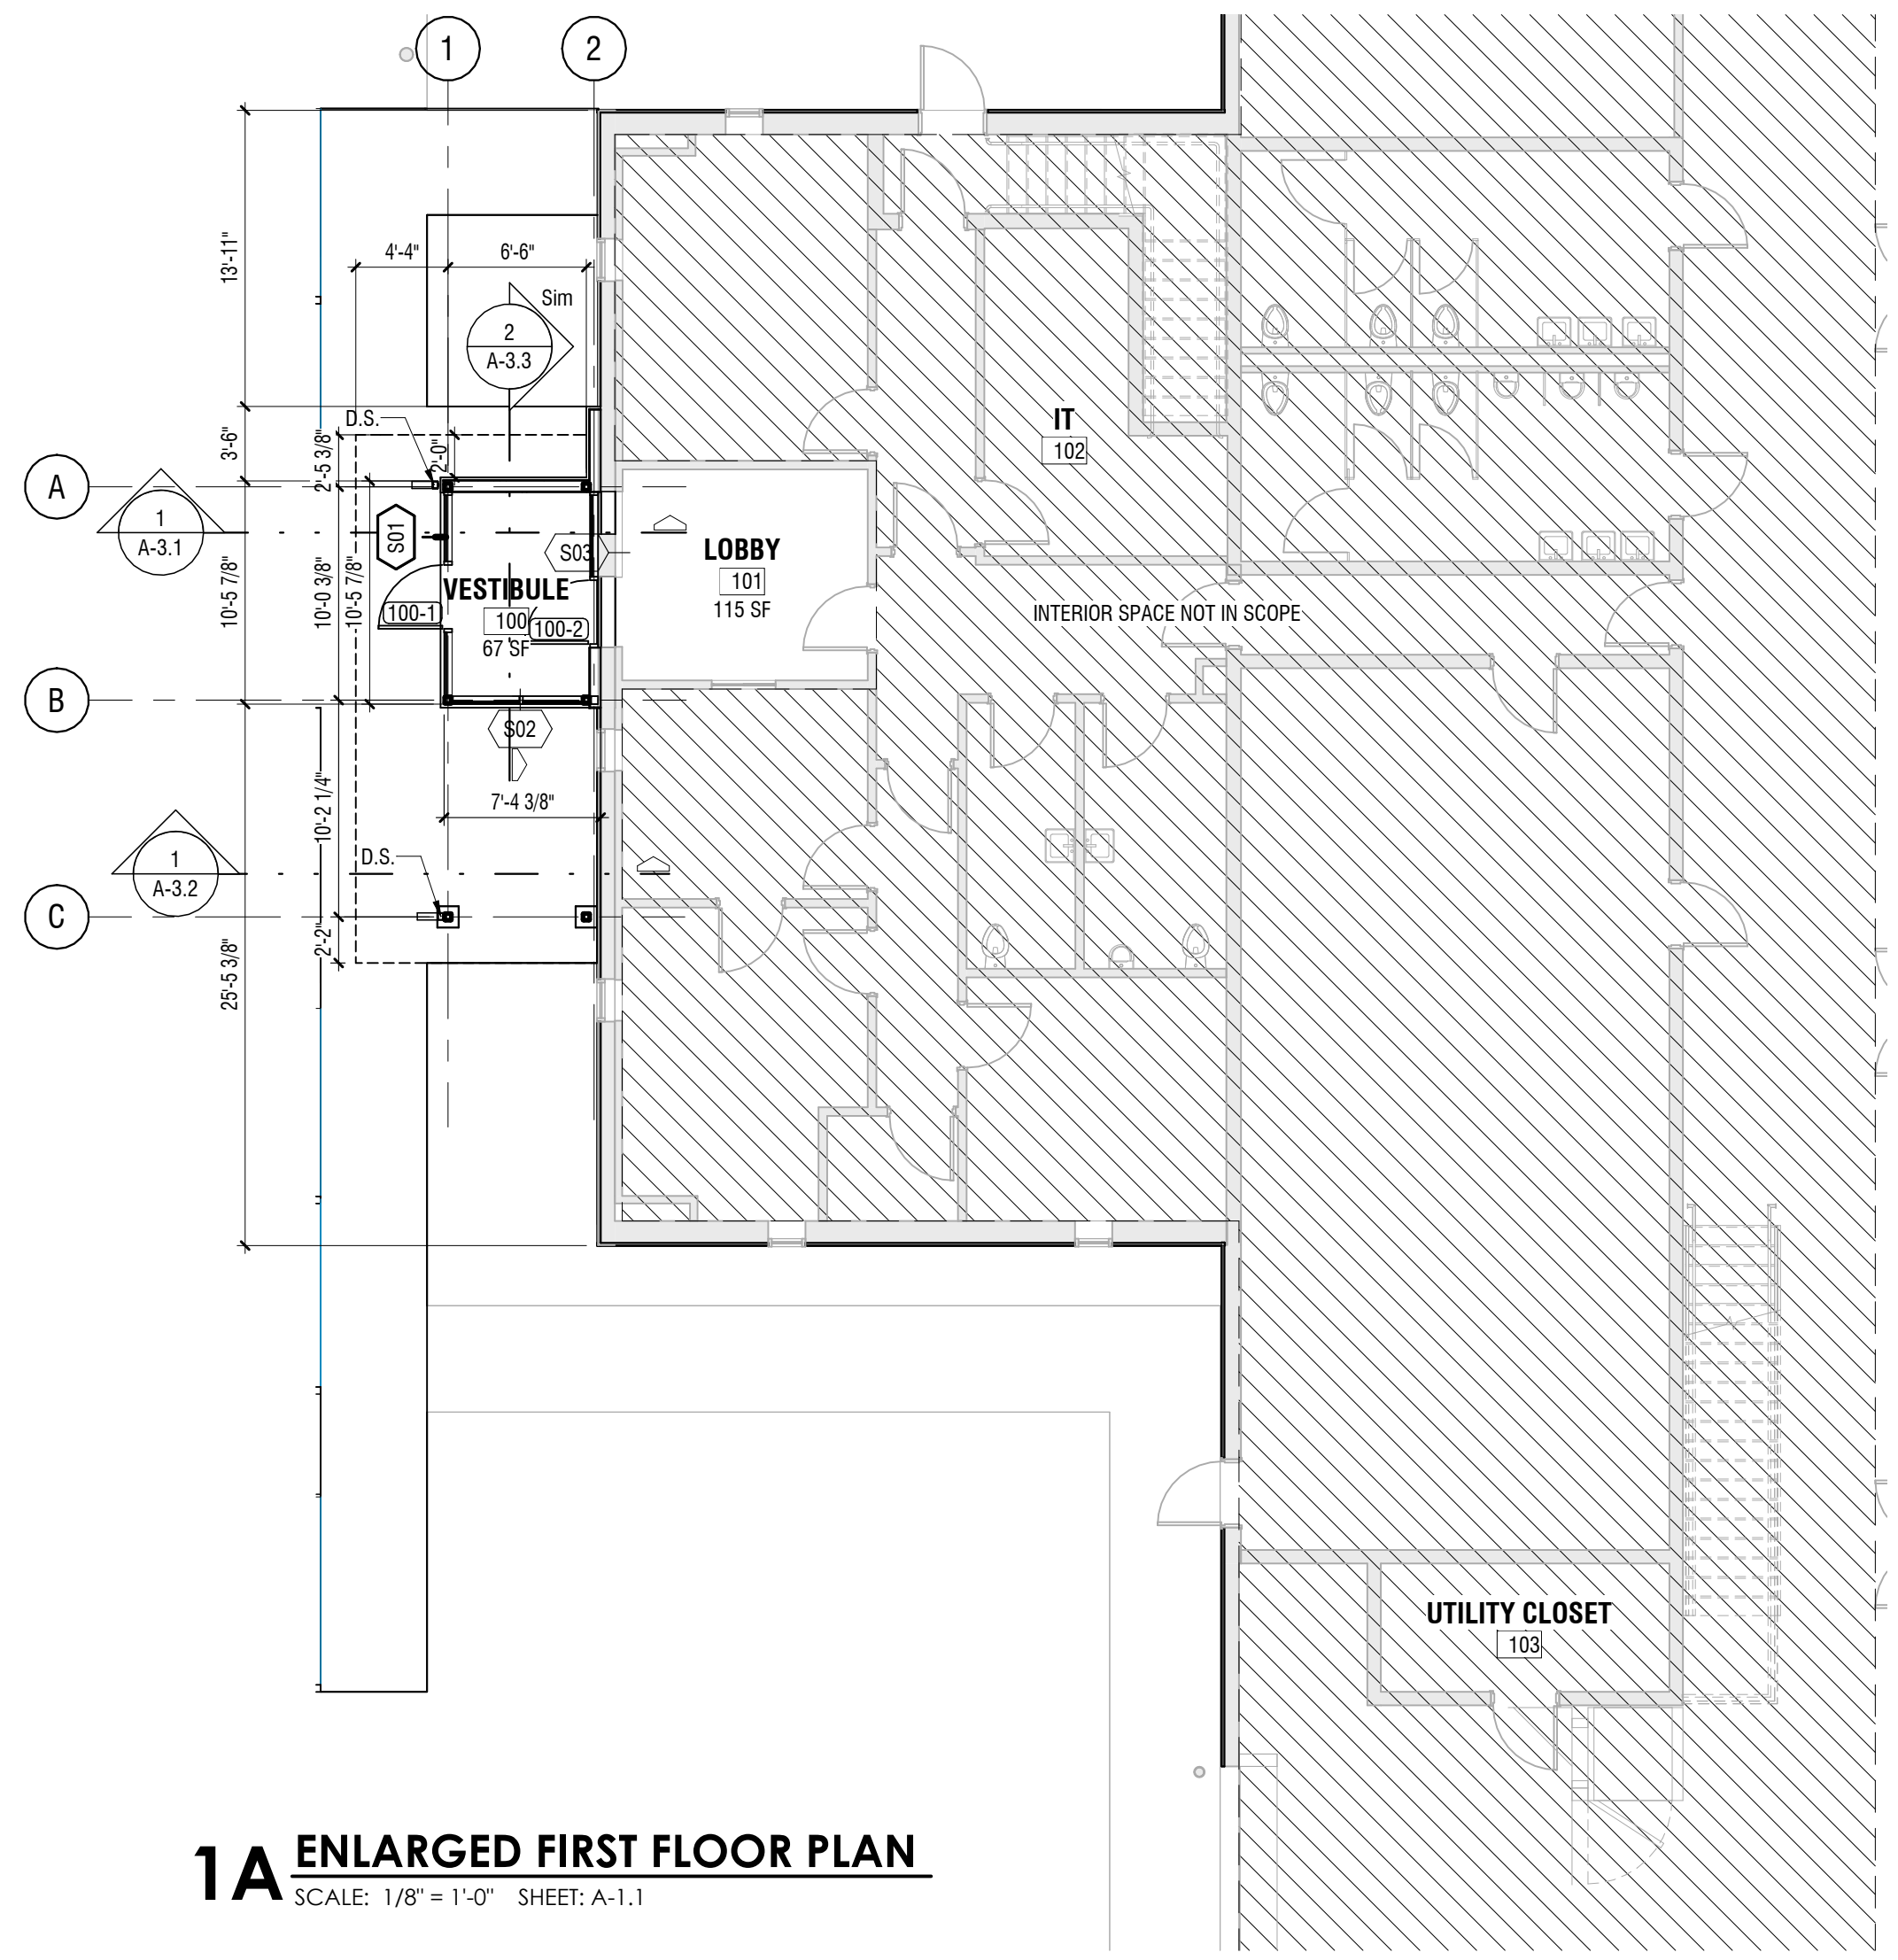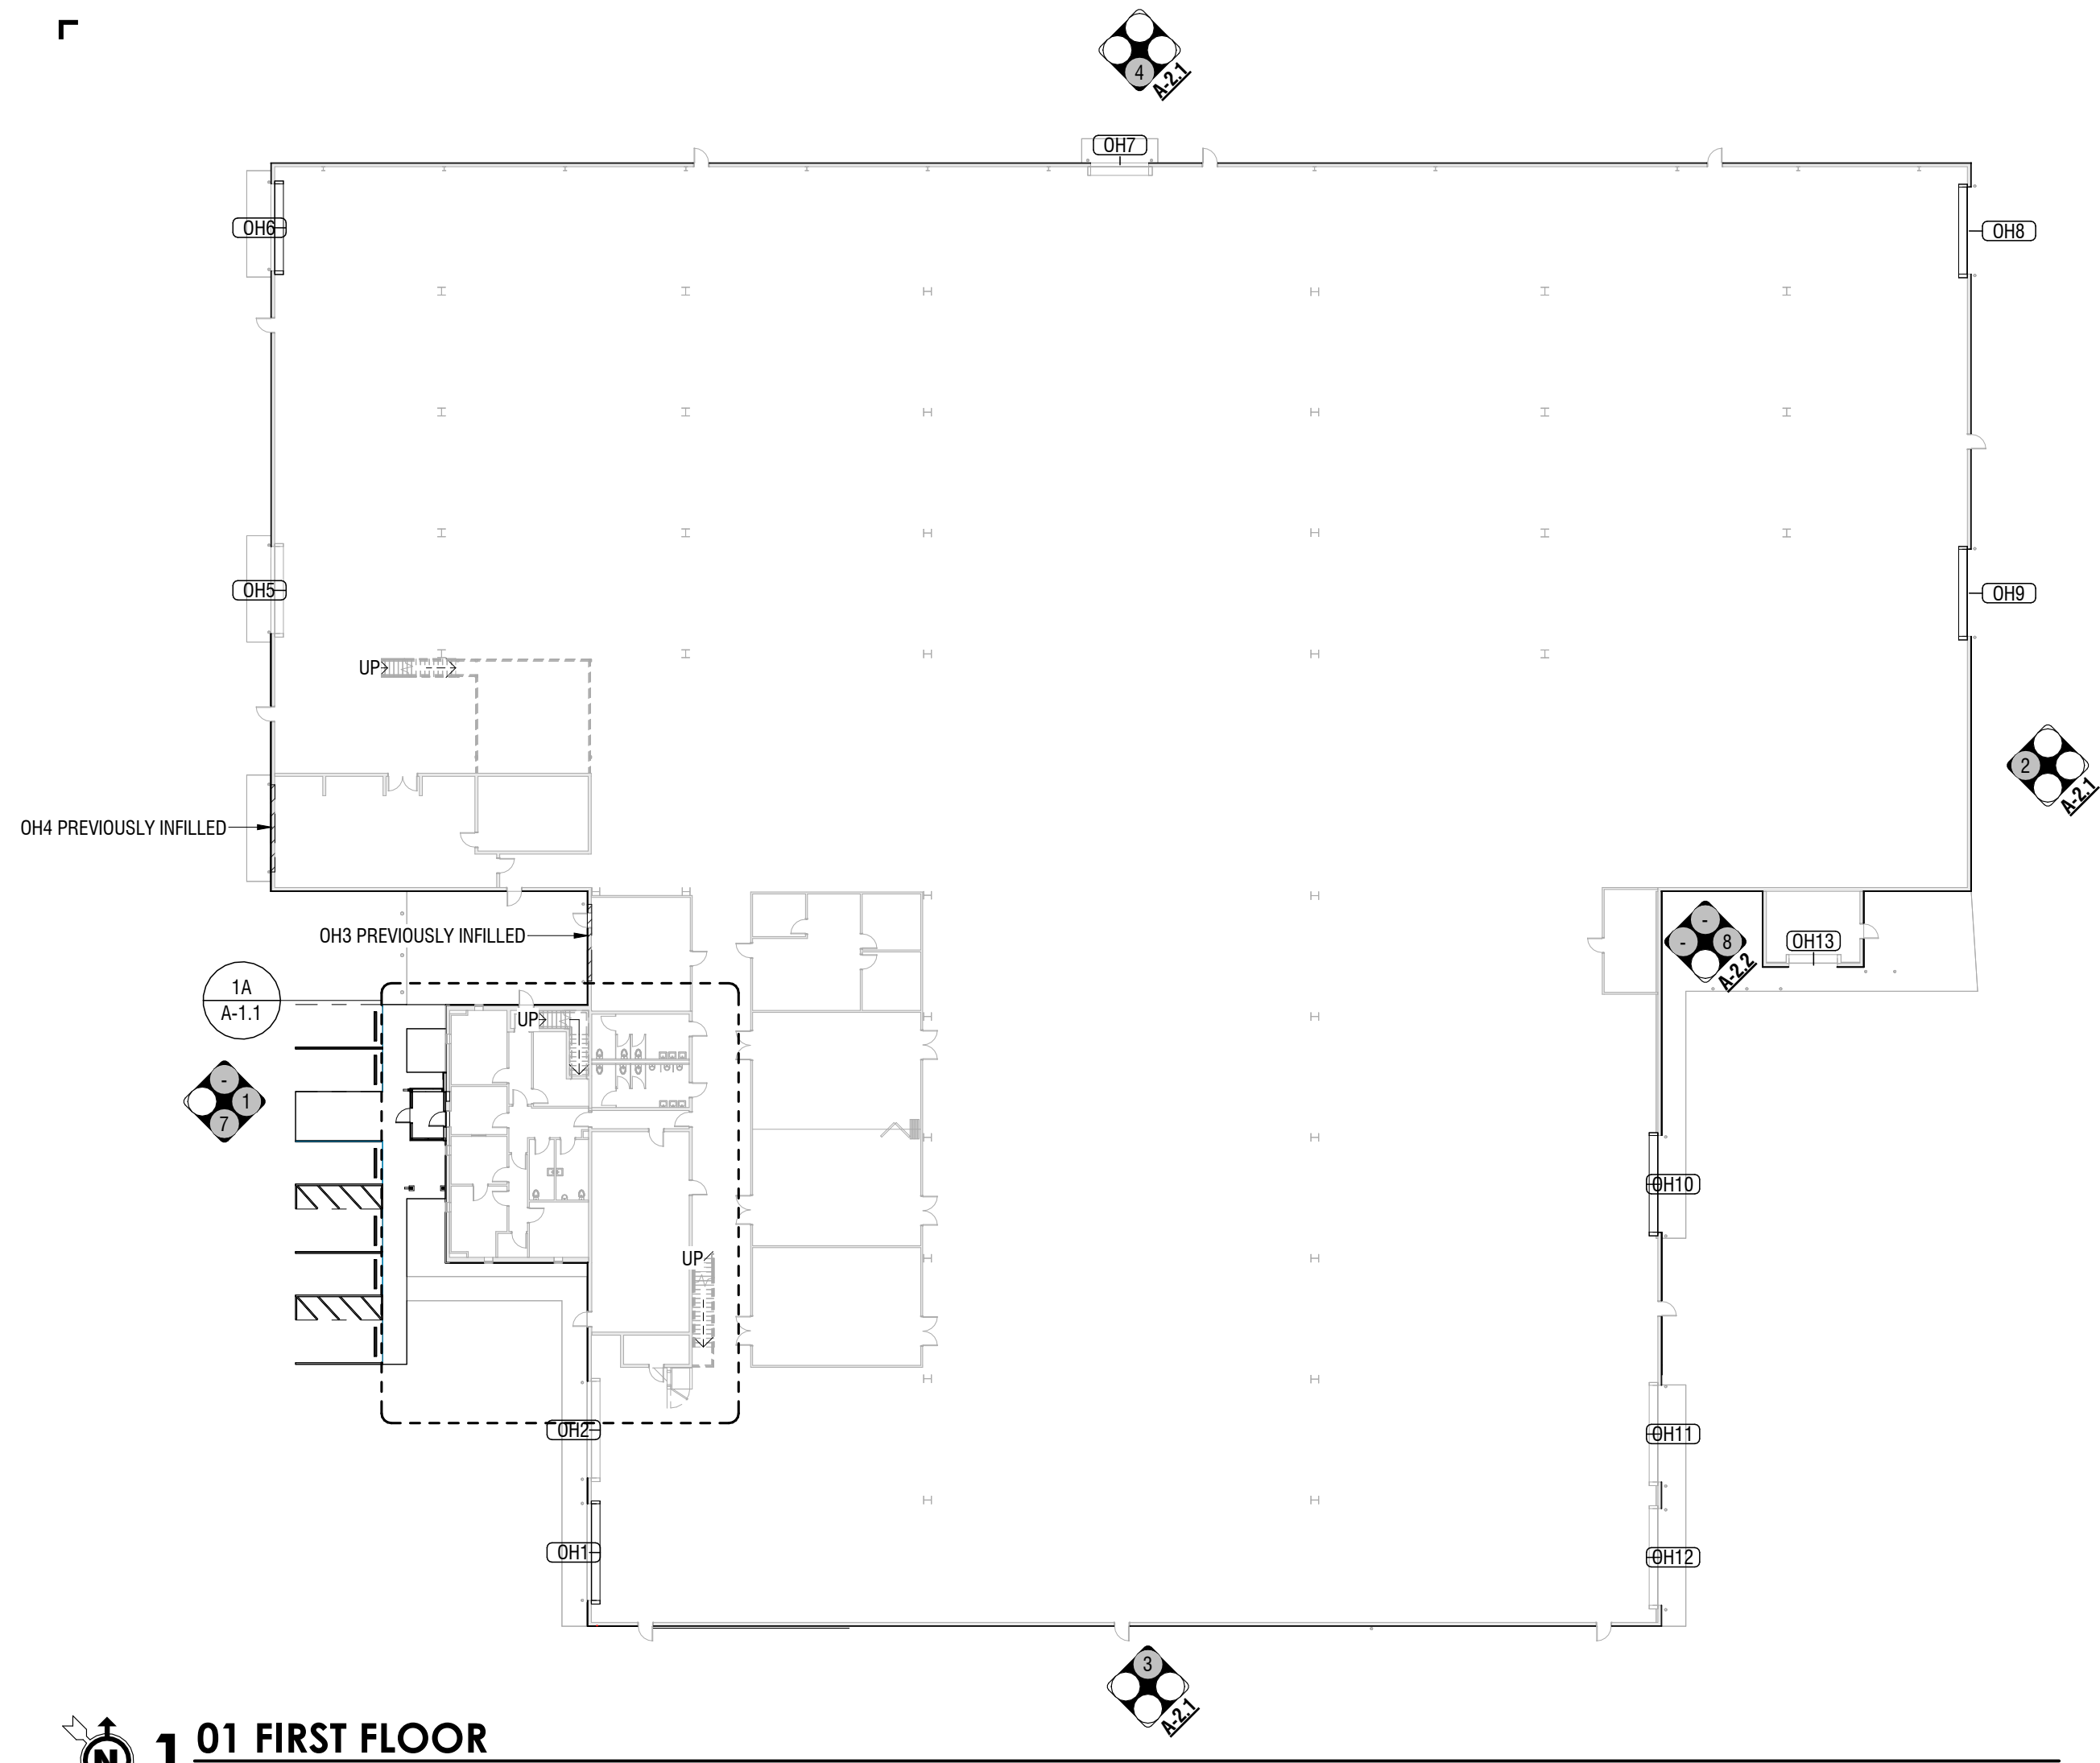

GENERAL PROJECT NOTES

- GENERAL NOTES APPLY TO ALL DRAWINGS**
- Do not scale the drawings.
 - Verify field conditions prior to commencement of each portion of the work.
 - Dimensions for door and window openings are shown nominal. Allow for 1/4-inch (10) shimming and sealant of exterior frames.
 - All dimensions are actual and are to face of studs, face of concrete walls, face of CMU walls, face of frames, or centerline of columns, unless noted otherwise.
 - General contractor shall coordinate all mechanical chase sizes with mechanical subcontractor.
 - The perimeter of each floor assembly shall be sealed with mineral wool insulation to prevent the passage of smoke between floors, even if the adjacent floors are of the same occupancy.
 - The owner shall be responsible for providing the contractor with rough-in information necessary to accommodate the installation of owner furnished and installed items.
 - The contractor shall include all owner furnished and installed items in the construction schedule, and shall coordinate with the owner to accommodate these items.
 - General contractor shall coordinate sizes and locations of concrete housekeeping pads with the mechanical and electrical equipment suppliers. Paint all edges of equipment pads safety yellow.
 - Safety glazing shall be required in the following locations. See IBC Chapter 24 for exceptions:
 - Doors
 - Windows (including sidelites and borrow lights) within 24" of any door where the glazing is less than 60" above the walking surface
 - Windows, when all of these conditions are met:
 - The exposed glazing is larger than 9sf
 - The bottom edge of glazing is less than 18" above the floor
 - The top edge of the glazing is greater than 36" above the floor
 - One or more walking surfaces are within 36" of the glazing plane
 - Glazing in guards and railings, including baluster and infill panels
 - Within 60" of a bathtub, hot tub, spa, whirlpool, or swimming pool if the bottom edge of the glazing is less than 60" above the walking or standing surface
 - Windows adjacent to stairways or walkways where the glazing is less than 60" above the walking surface
 - Fire department access panels (including all panes of a multi-pane insulated glass unit)

- BID ITEM: BUILDING EXTERIOR UPGRADES AND PAINTING**
- REPLACEMENT OF METAL PANEL FROM 0'-0" TO 7'-6" SEE ELEVATIONS FOR TYPE AND PROFILE
 - REPLACEMENT OF TRANSLUCENT PANELS ON EAST & WEST FACADES. SEE ELEVATIONS FOR EXACT HEIGHT AND LOCATIONS.
 - INSTALL NEW OVERHEAD DOORS. SEE SCHEDULE.
 - CLEAN (AS NECESSARY) AND PAINT ALL EXISTING BOLLARDS SAFETY YELLOW.
 - PAINT EXTERIOR OF BUILDING IN ITS ENTIRETY.
 - PAINT FACADES OF BUILDING AS INDICATED ON PAINT ELEVATIONS.
 - CLEAN AND PAINT ALL EXTERIOR SWING DOORS.
 - CLEAN AND PAINT OVERHEAD DOORS THAT ARE NOT REPLACED.
- ADD ALTERNATE NO. 1: NEW BUILDING ENTRY**
- DEMOLISH EXISTING CANOPY AND ASSOCIATED SUPPORTS.
 - DEMOLISH EXISTING OPENING TO CONSTRUCT NEW VESTIBULE
 - CONSTRUCT NEW VESTIBULE AND ENTRANCE CANOPY.
- ADD ALTERNATE NO. 2: NEW MONUMENT SIGN**
- MONUMENT SIGNAGE IN FRONT OF EXISTING GRAVEL PARKING LOT SEEN FROM I77
 - CIVIL WORK FOR ELECTRICAL CONDUIT TO SIGNAGE

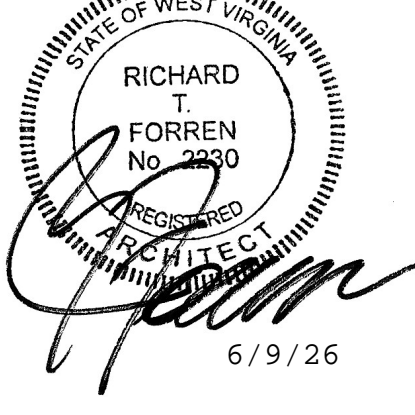

BID DOCUMENTS
06.09.2026
REVISIONS


ATC RENOVATION
NEW RIVER COMMUNITY & TECHNICAL COLLEGE
527 Odd Rd.
Ghent, WV 25843




OMNI ARCHITECTS

A-1.1
Copyright © All rights reserved. Reproduction in whole or in part is prohibited. This drawing is an instrument of service, is the property of the Architect and may not be used in any way without written permission of this firm.
Project No: 2024008.001 Drawn by: ---

FIRST AND SECOND FLOOR PLAN - NEW WORK

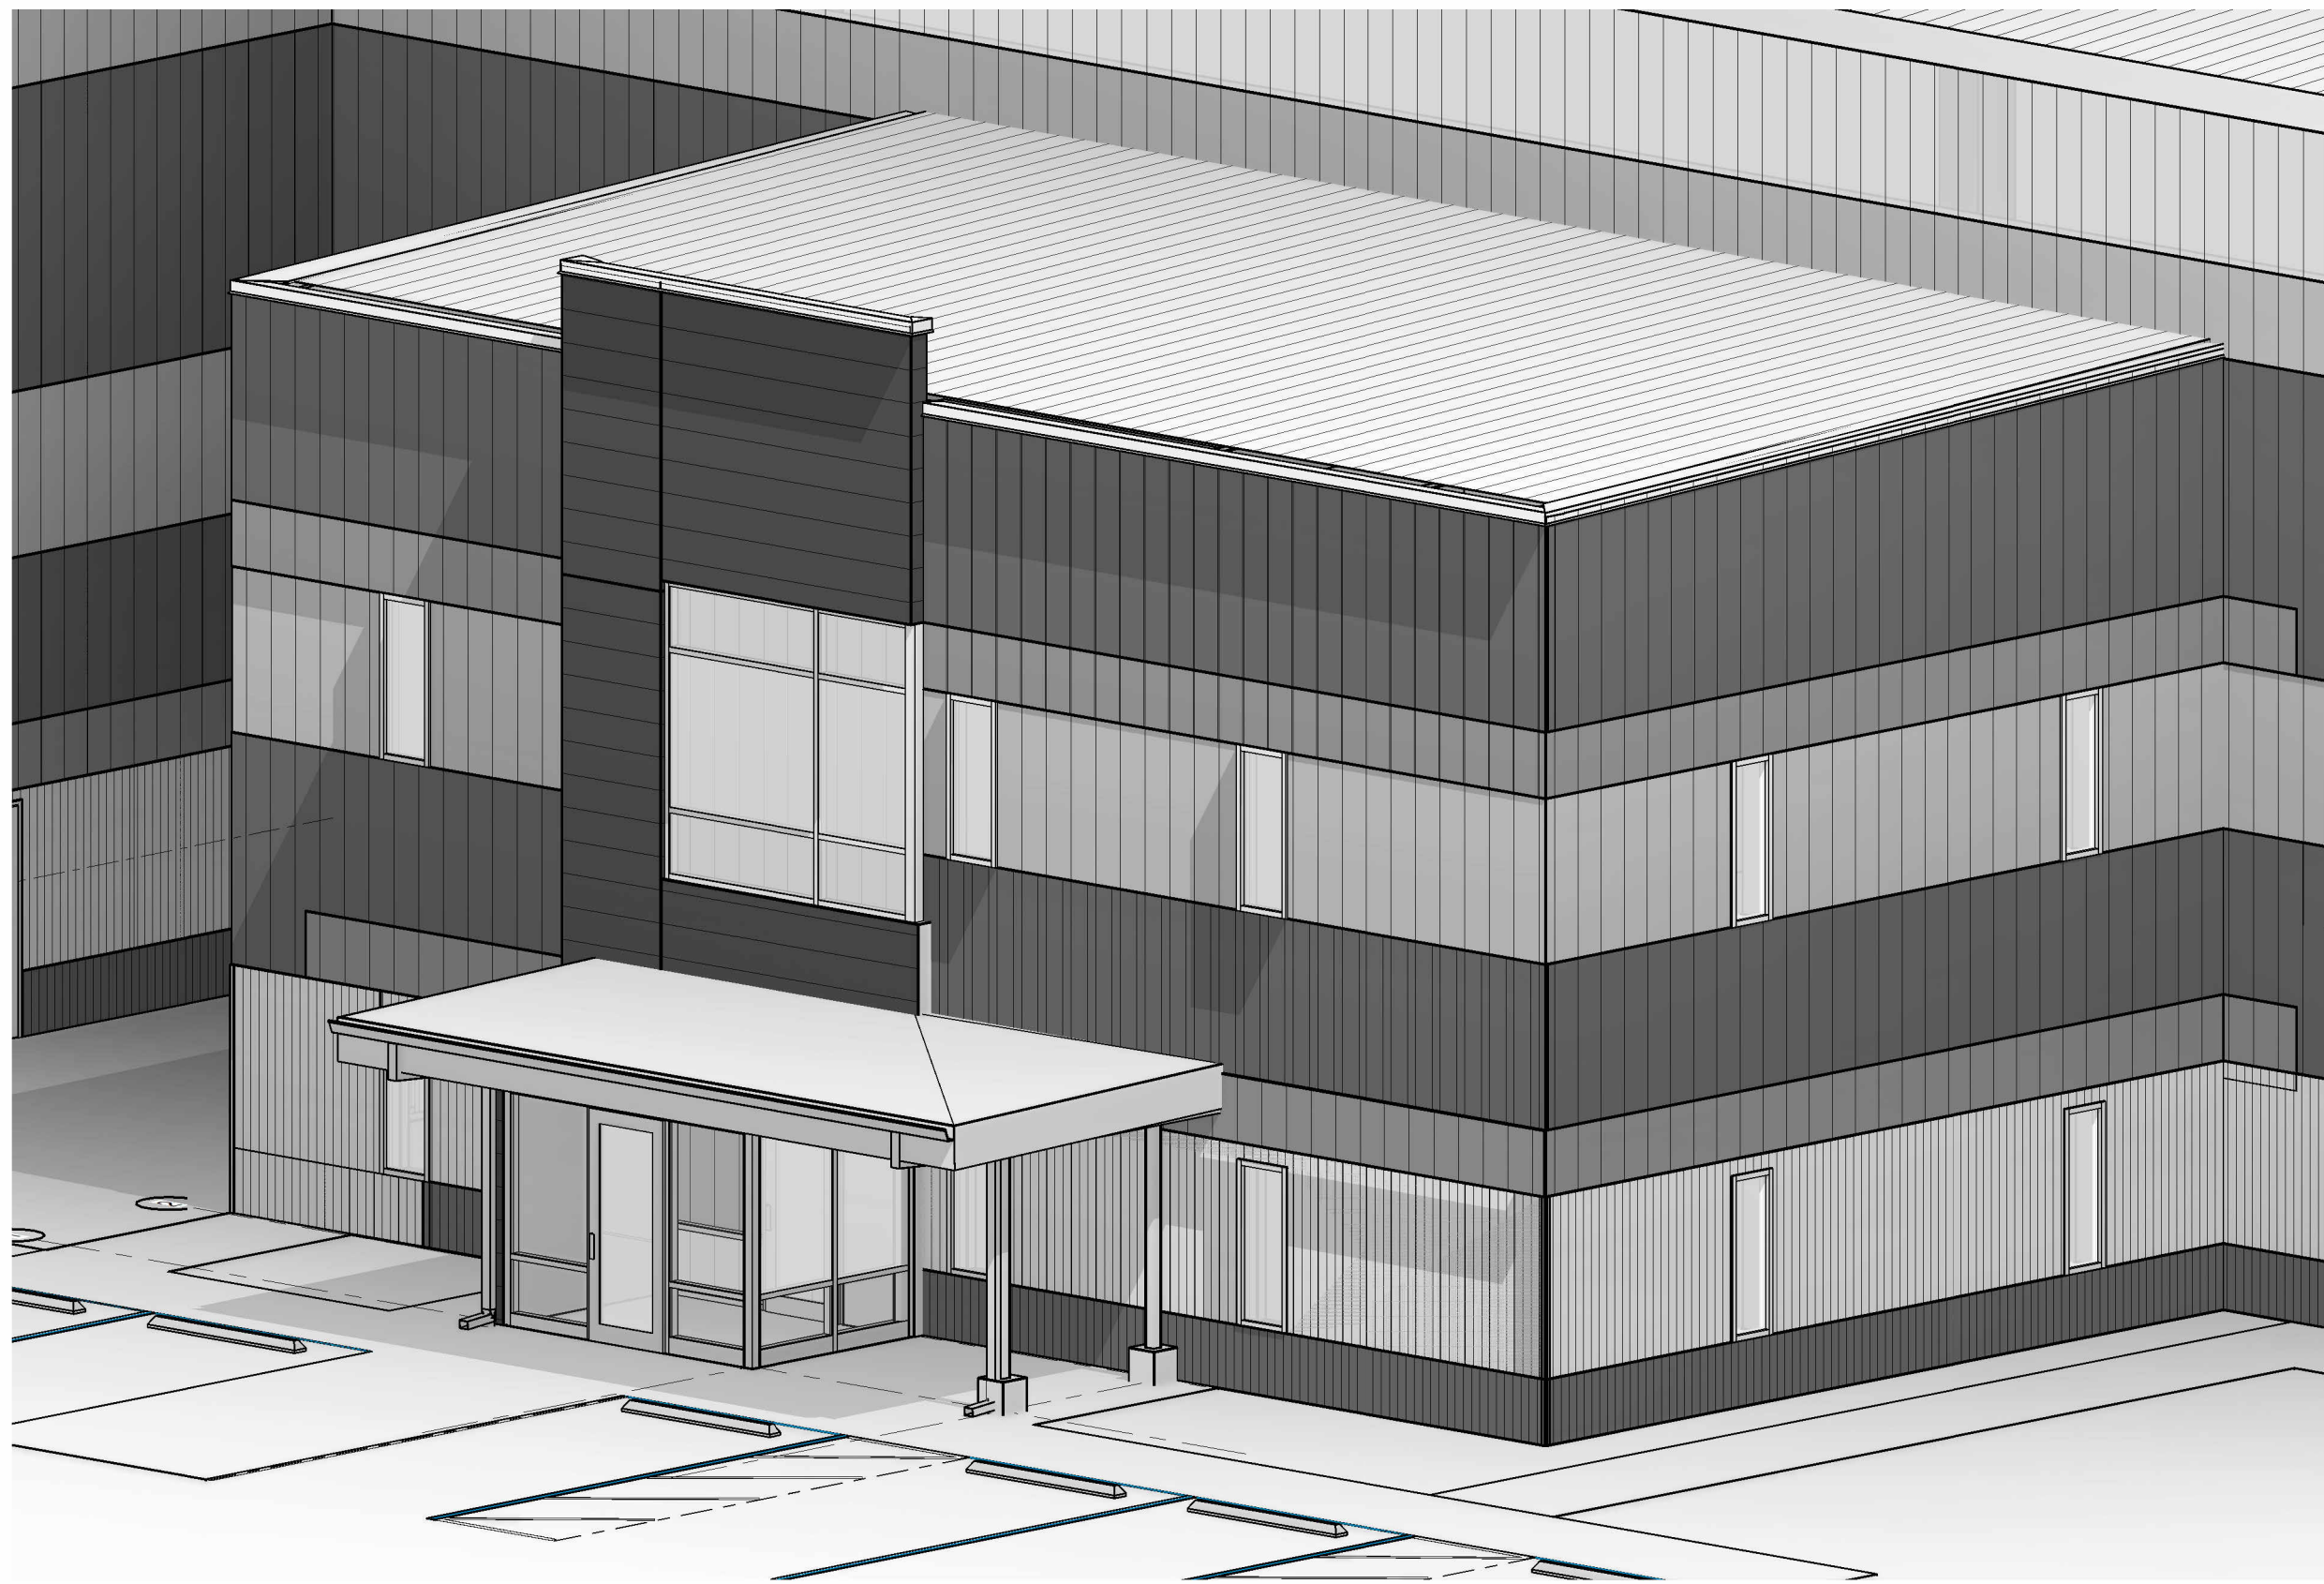


1 ENLARGED ENTRY PERSPECTIVE
SCALE: SHEET: A-2.0

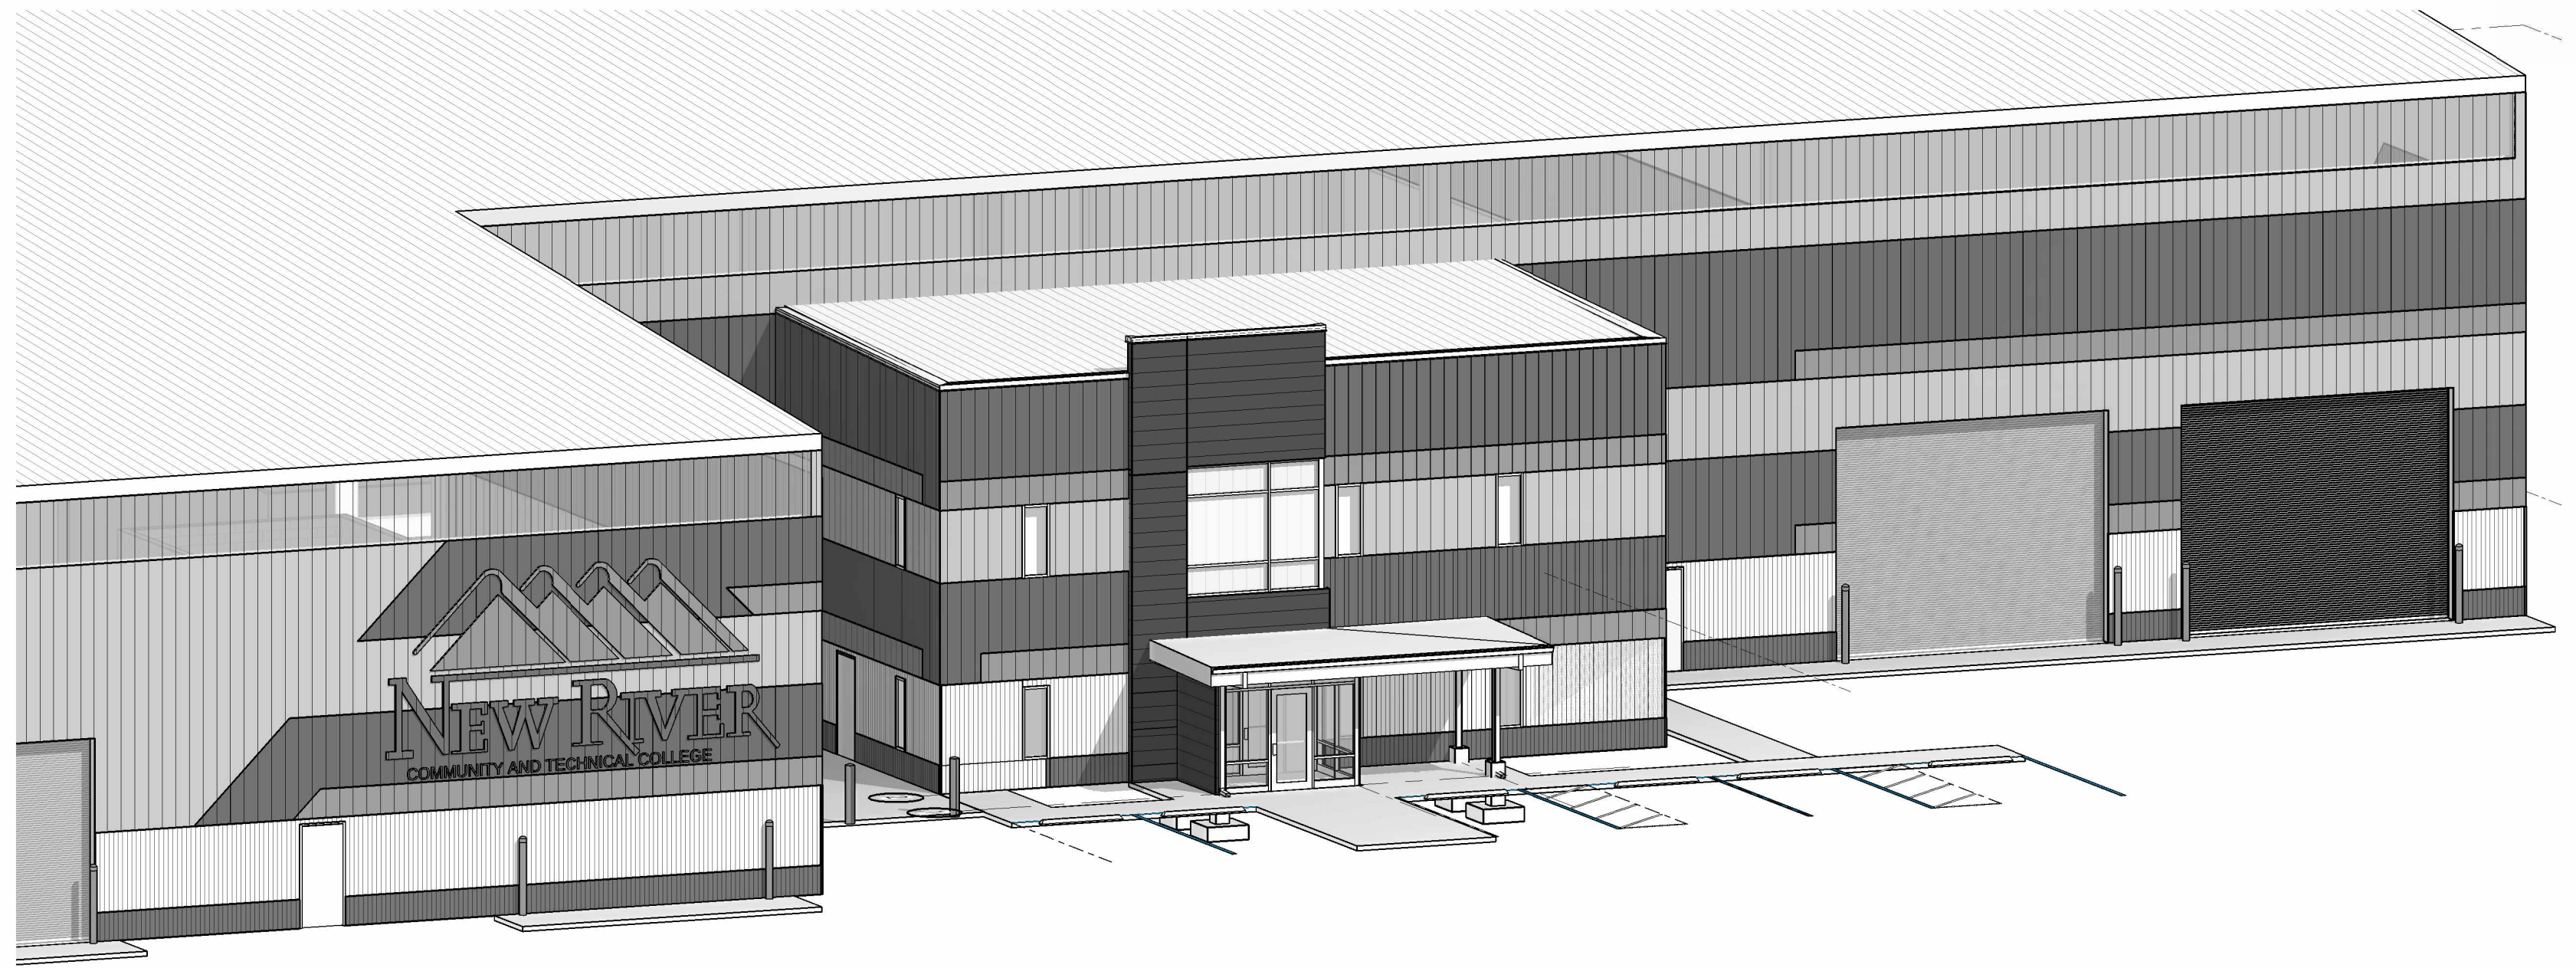


2 ENLARGED ENTRY PERSPECTIVE
SCALE: SHEET: A-2.0



3 FRONT PERSPECTIVE
SCALE: SHEET: A-2.0

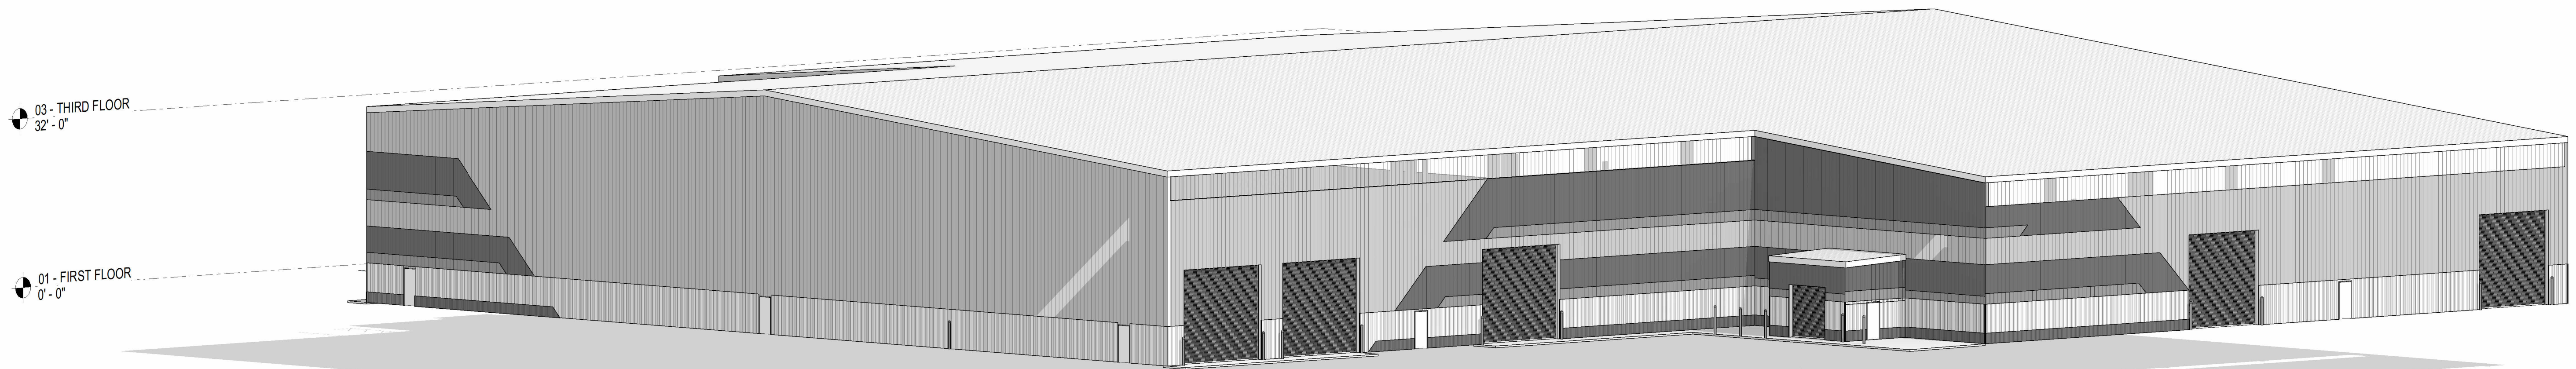

4 BACK PERSPECTIVE
SCALE: SHEET: A-2.0

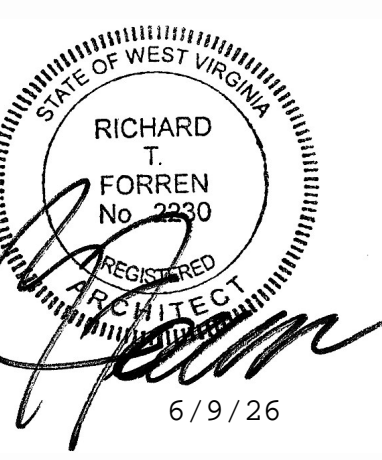

BID DOCUMENTS
06.09.2026
REVISIONS ▼

ATC RENOVATION
NEW RIVER COMMUNITY & TECHNICAL COLLEGE
527 Odd Rd.
Ghent, WV 25843




OMNI
ARCHITECTS

A-2.0

Copyright © All rights reserved. Reproduction in whole or in part is prohibited. This drawing is an instrument of service, is the property of the Architect and may not be used in any way without written permission of this firm.
Project No: 2024008.001 Drawn by: ---

3D VIEWS

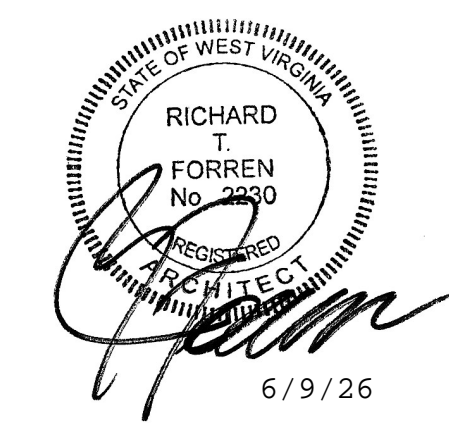

- BID ITEM: BUILDING EXTERIOR UPGRADES AND PAINTING**
- REPLACEMENT OF METAL PANEL FROM 0'-0" TO 7'-6". SEE ELEVATIONS FOR TYPE AND PROFILE.
 - REPLACEMENT OF TRANSLUCENT PANELS ON EAST & WEST FACADES. SEE ELEVATIONS FOR EXACT HEIGHT AND LOCATIONS.
 - INSTALL NEW OVERHEAD DOORS. SEE SCHEDULE.
 - CLEAN (AS NECESSARY) AND PAINT ALL EXISTING BOLLARDS SAFETY YELLOW.
 - PAINT EXTERIOR OF BUILDING IN ITS ENTIRETY.
 - PAINT FACADES OF BUILDING AS INDICATED ON PAINT ELEVATIONS.
 - CLEAN AND PAINT ALL EXTERIOR SWING DOORS.
 - CLEAN AND PAINT OVERHEAD DOORS THAT ARE NOT REPLACED.


BID DOCUMENTS
06.09.2026

- ADD ALTERNATE NO. 1 - NEW BUILDING ENTRY**
- DEMOLISH EXISTING CANOPY AND ASSOCIATED SUPPORTS.
 - DEMOLISH EXISTING OPENING TO CONSTRUCT NEW VESTIBULE.
 - CONSTRUCT NEW VESTIBULE AND ENTRANCE CANOPY.
- ADD ALTERNATE NO. 2 - NEW MONUMENT SIGN**
- MONUMENT SIGNAGE IN FRONT OF EXISTING GRAVEL PARKING LOT SEEN FROM I77.
 - CIVIL WORK FOR ELECTRICAL CONDUIT TO SIGNAGE.


REVISIONS

KEYED ELEVATION NOTES


| # | Note Text |
|-----|--|
| E01 | CLEAN AS NECESSARY AND PAINT ALL EXISTING BOLLARDS SAFETY YELLOW |
| E02 | PAINT EXTERIOR SIGNAGE ONTO METAL PANEL. PROVIDE DOWN LIGHTING FOR SIGNAGE COORDINATE WITH ELECTRICAL DRAWINGS. CONTRACTOR TO COORDINATE SIGNAGE DESIGN AND FONT WITH OWNER. |
| E04 | REPLACE AND INSTALL NEW TRANSLUCENT PANELS, REPAIR INTERIOR INSULATION AT WINDOWS IF NECESSARY |
| E05 | NEW OVERHEAD DOOR AS SCHEDULED |

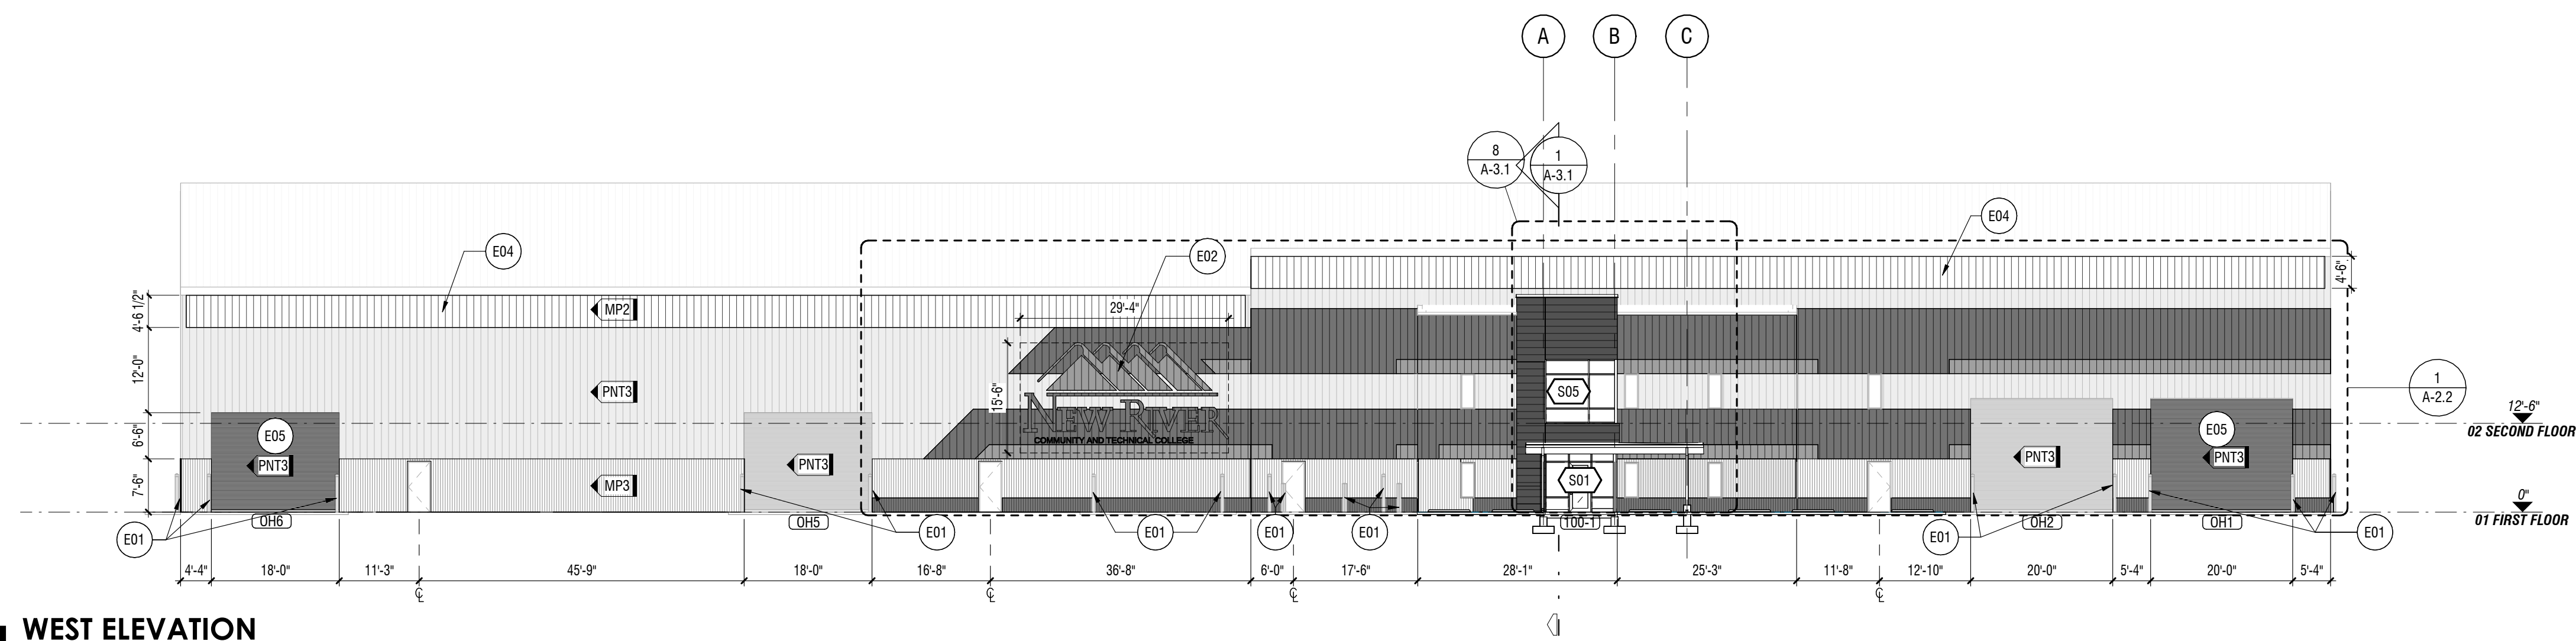


1 WEST ELEVATION
SCALE: 1/16" = 1'-0" SHEET: A-2.1

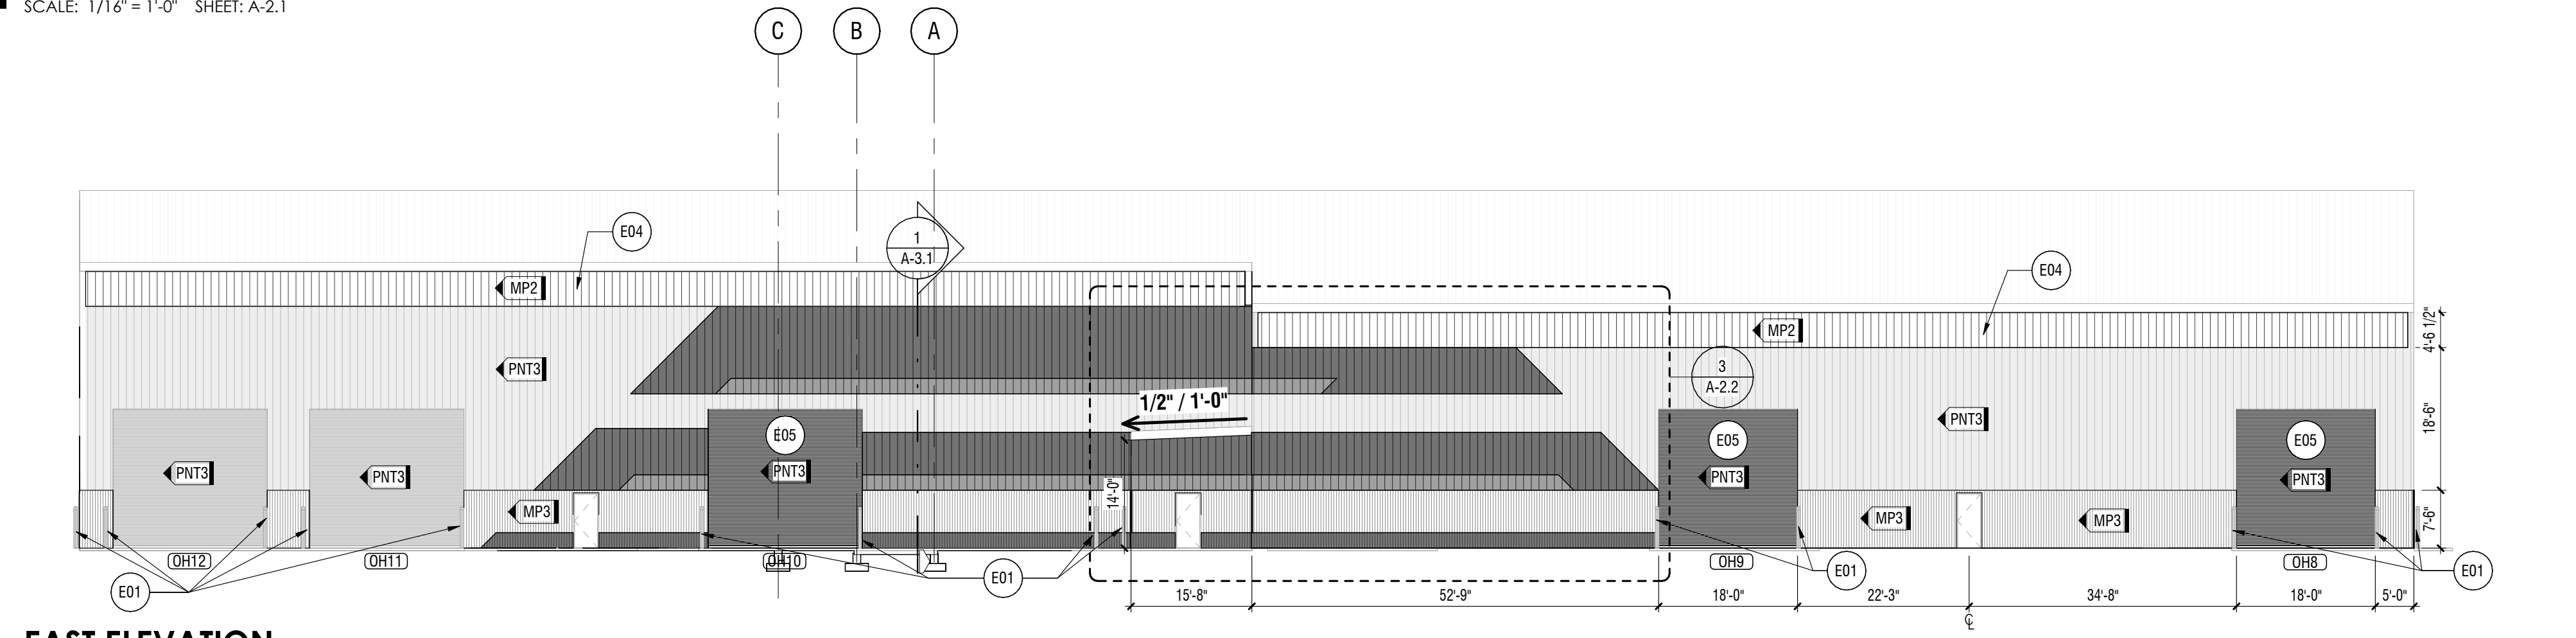

2 EAST ELEVATION
SCALE: 1/16" = 1'-0" SHEET: A-2.1

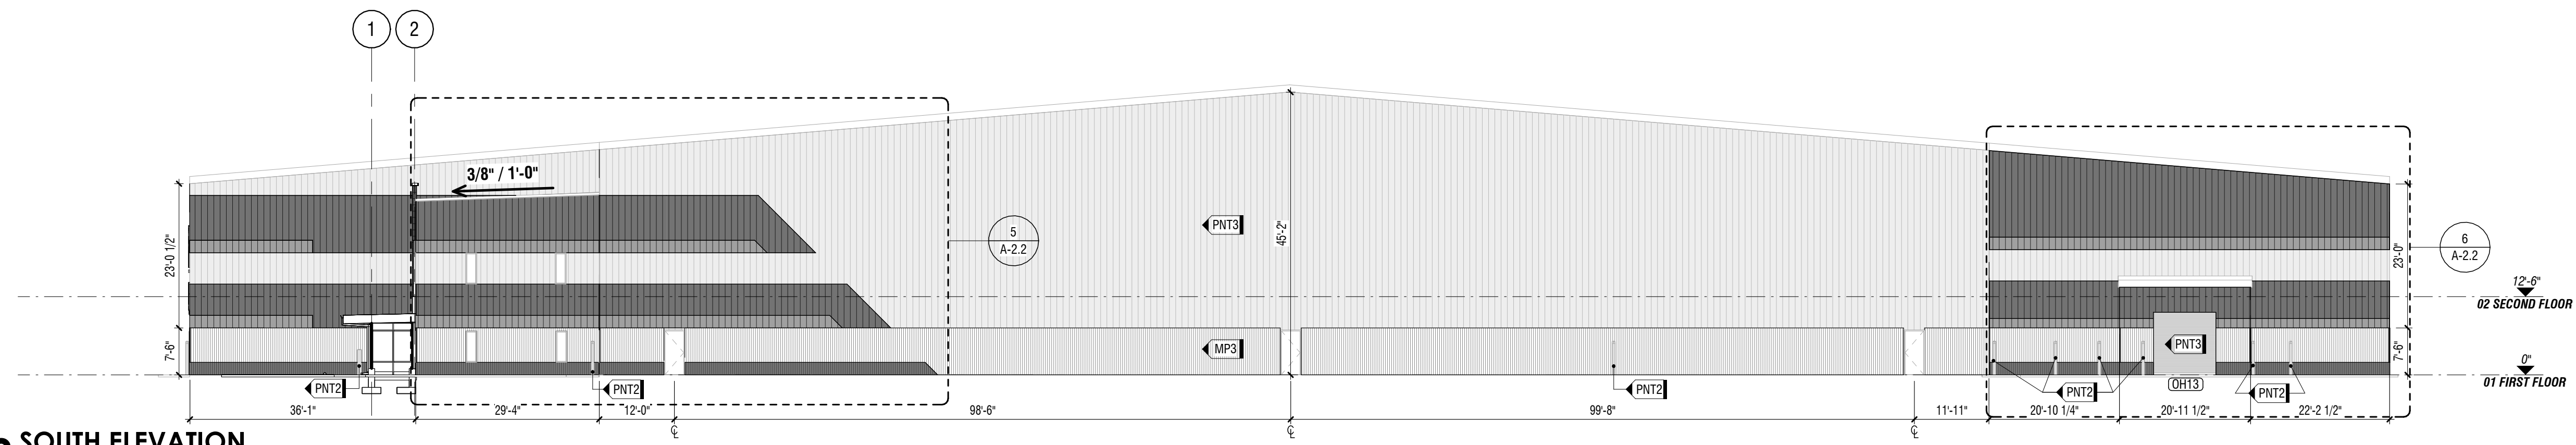

3 SOUTH ELEVATION
SCALE: 1/16" = 1'-0" SHEET: A-2.1

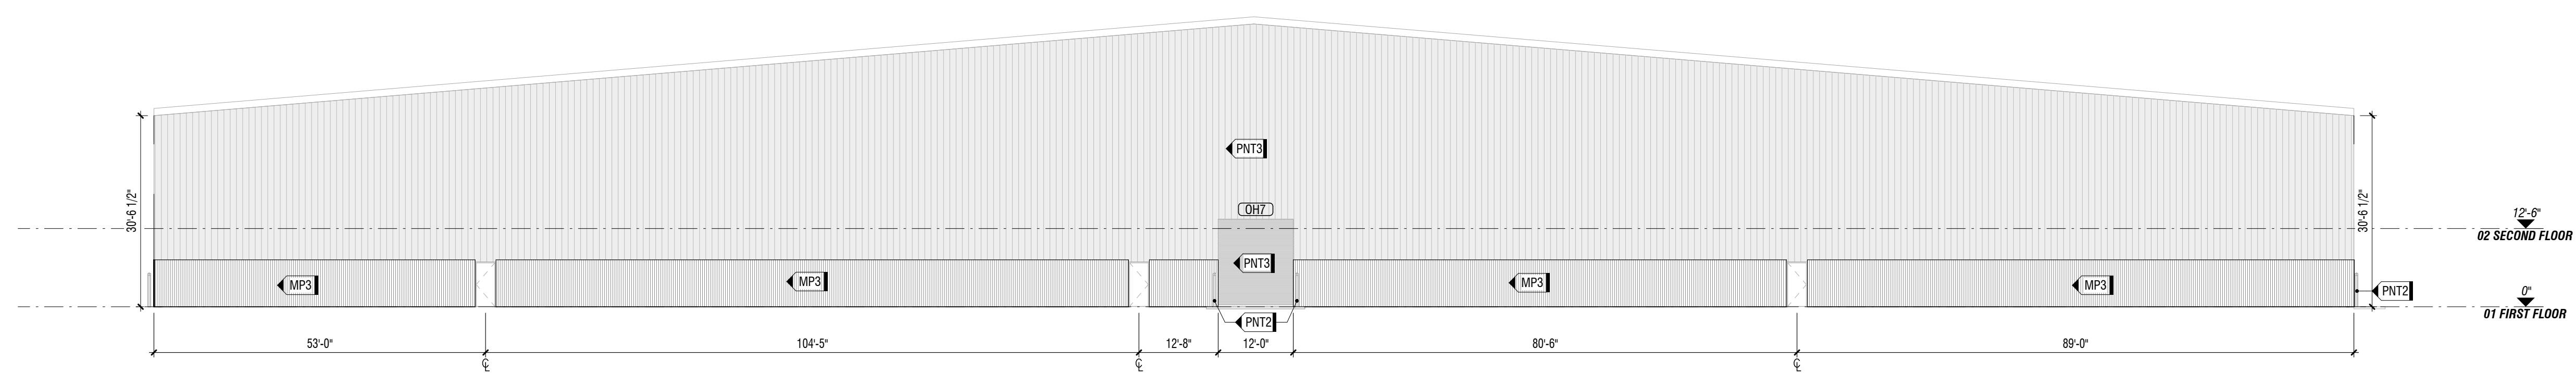

4 NORTH ELEVATION
SCALE: 1/16" = 1'-0" SHEET: A-2.1

ATC RENOVATION
NEW RIVER COMMUNITY & TECHNICAL COLLEGE
527 Odd Rd.
Ghent, WV 25843

EXTERIOR ELEVATIONS



A-2.1

Copyright © All rights reserved. Reproduction in whole or in part is prohibited. This drawing is an instrument of service, is the property of the Architect and may not be used in any way without written permission of this firm.
Project No: 2024008.001 Drawn by: ---


FINISH NOTES

- A. Finish notes apply to all finish sheets.
- B. All existing exterior swing doors and overhead doors to be cleaned, scraped as necessary, and painted PNT3. Paint frames to match adjacent walls as indicated in paint elevations.
- C. Building to be painted PNT3 unless noted otherwise, see exterior paint elevations.
- D. All existing bollards to be cleaned, scraped, and painted safety yellow.
- E. Signage is indicated as dashed, coordinate location with exterior elevations. Coordinate with electrical drawings.
- F. ALTERNATE #01 - Vestibule finishes:
 Flooring: Resilient Plank Flooring 12x24" stagger install, Patcraft Earthen Mountain 00170-V2
 Rubber base: 4" Traditional base Johnsonite T48 Welsh Castle CB
 Paint Color: Sherwin Williams SW9139 Debonair - Eggshell Finish
 G. ALTERNATE #01 - Interior Paint color for lobby and office to match existing. Repaint entire rooms.

EXTERIOR MATERIAL LEGEND

- PAINT:**
- PNT1 BLUE PAINT**
SHERWIN WILLIAMS
SW 6516
"DOWN POUR"
 - PNT2 GREEN PAINT**
SHERWIN WILLIAMS
SW 6459
"JADITE"
 - PNT3 GREY PAINT**
SHERWIN WILLIAMS
SW 6235
"FOGGY DAY"
- METAL PANEL:**
- MP1 METAL PANEL INSTALLED HORIZONTALLY**
BASIS OF DESIGN: CENTRIA
IW-10A
COLOR MATCH SCHOOL BLUE (PATATONE 286C)
 - MP2 TRANSLUCENT WALL PANEL**
BASIS OF DESIGN: TO MATCH EXISTING PROFILE
TRANSLUCENT WALL PANEL
CLEAR TRANSLUCENT
 - MP3 METAL PANEL**
BASIS OF DESIGN: VARGO PRUDEN OR PROVEN EQUAL
RFR™ WALL PANEL
PAINT TO MATCH PNT3 AND PNT1 WHERE
INDICATED ON PAINT ELEVATIONS

NOTE: EXTERIOR COLOR SELECTIONS ARE TO BE VERIFIED IN SHOP DRAWINGS WITH OWNERS APPROVAL.

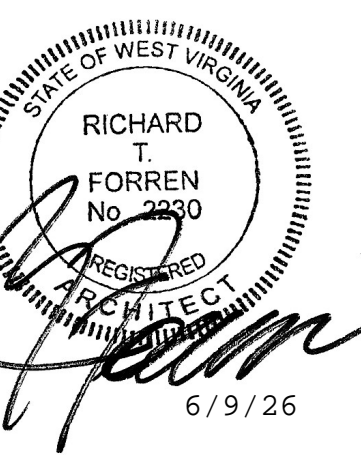


BID DOCUMENTS
06.09.2026
REVISIONS



1 WEST PAINT ELEVATION


SCALE: 1/8" = 1'-0" SHEET: A-2.2

NOTE: IF ALTERNATE #01 IS NOT ACCEPTED PAINT SCHEME TO BE ENTIRE FRONT AND EXISTING CANOPY TO REMAIN.

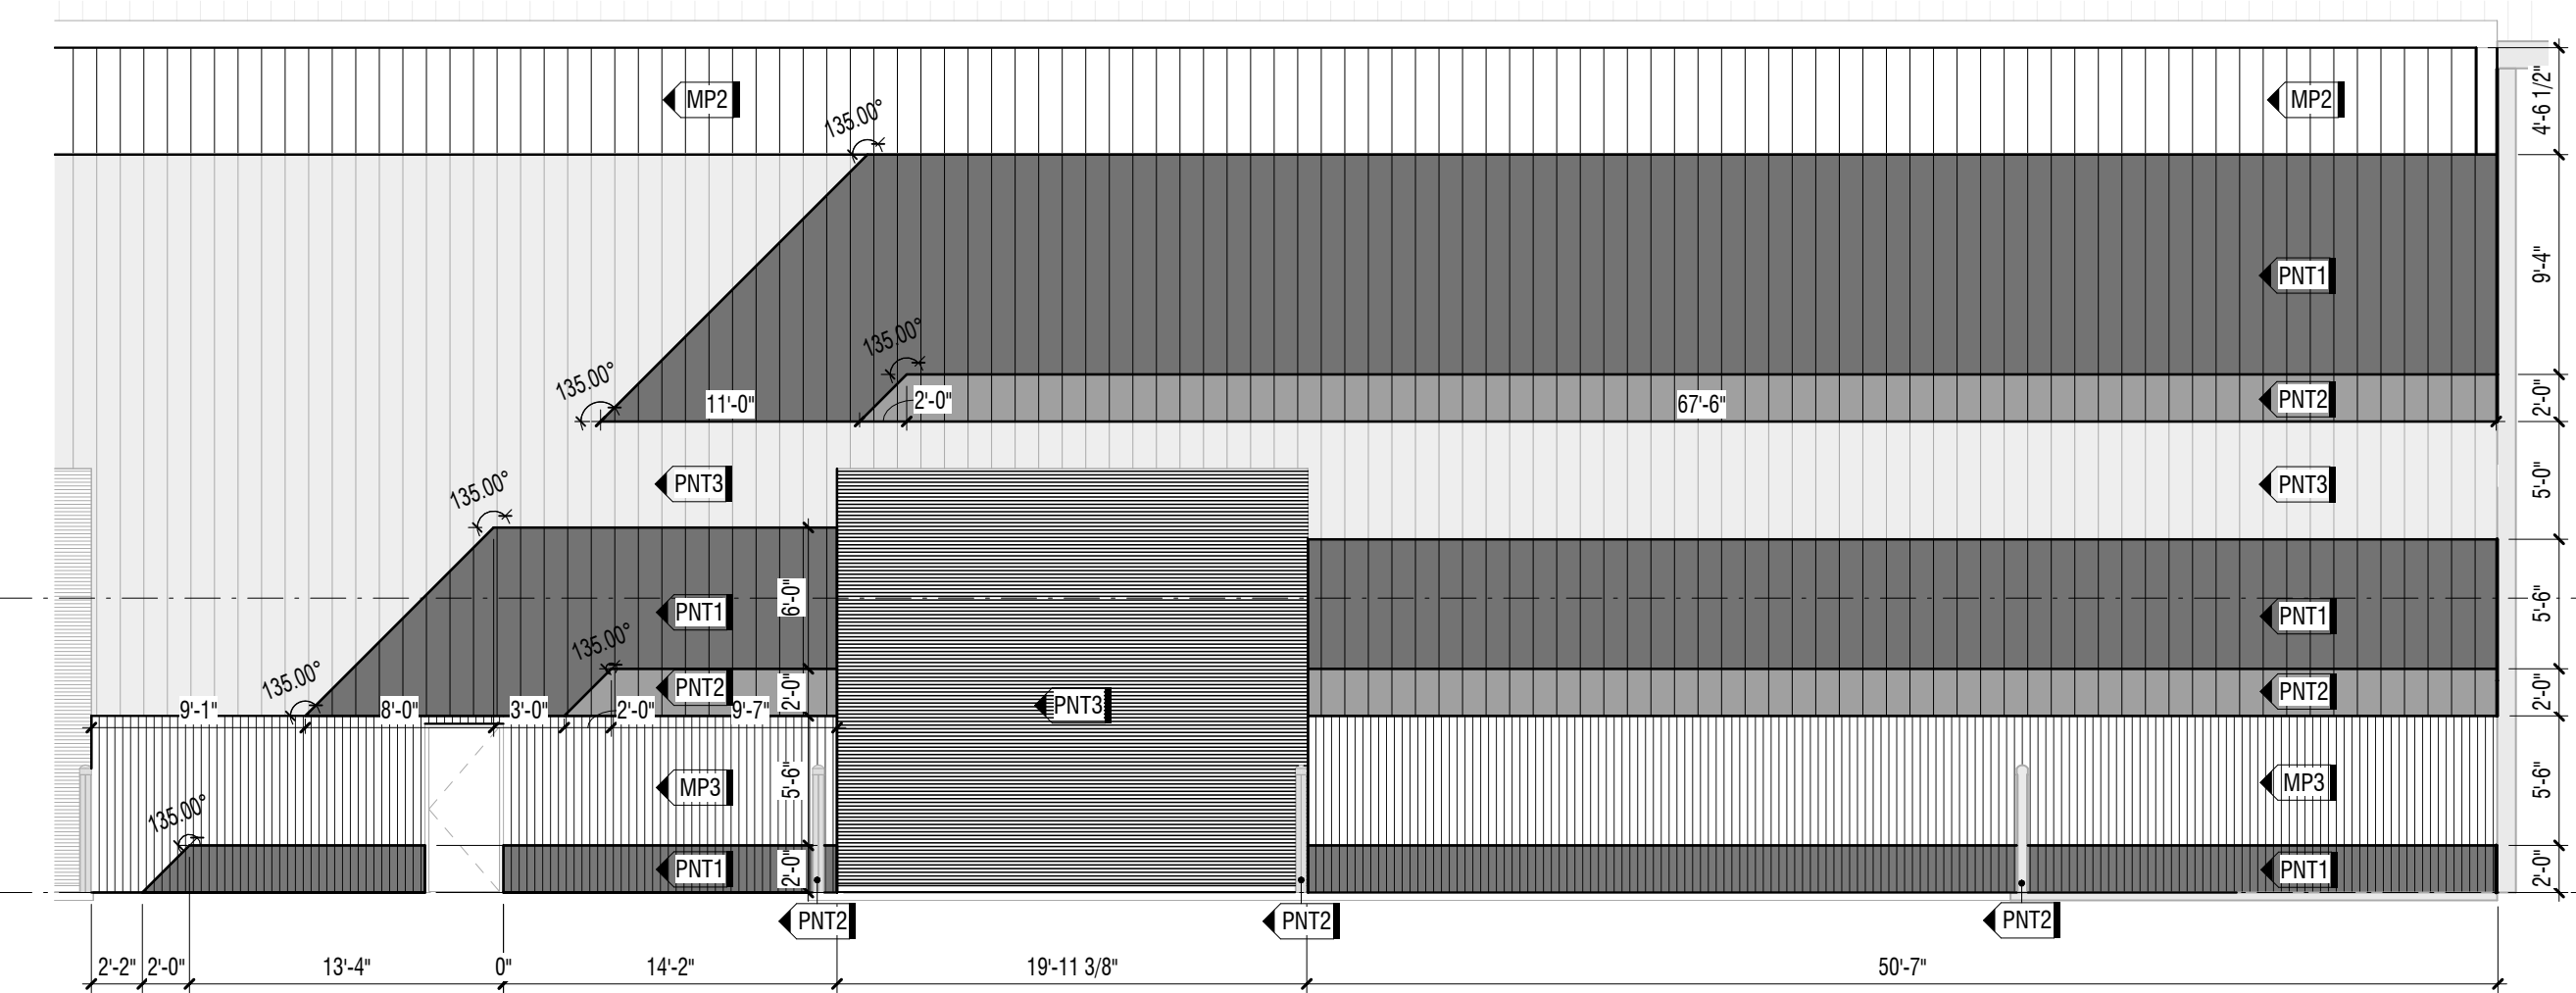


2 EAST PAINT ELEVATION 1

SCALE: 1/8" = 1'-0" SHEET: A-2.2

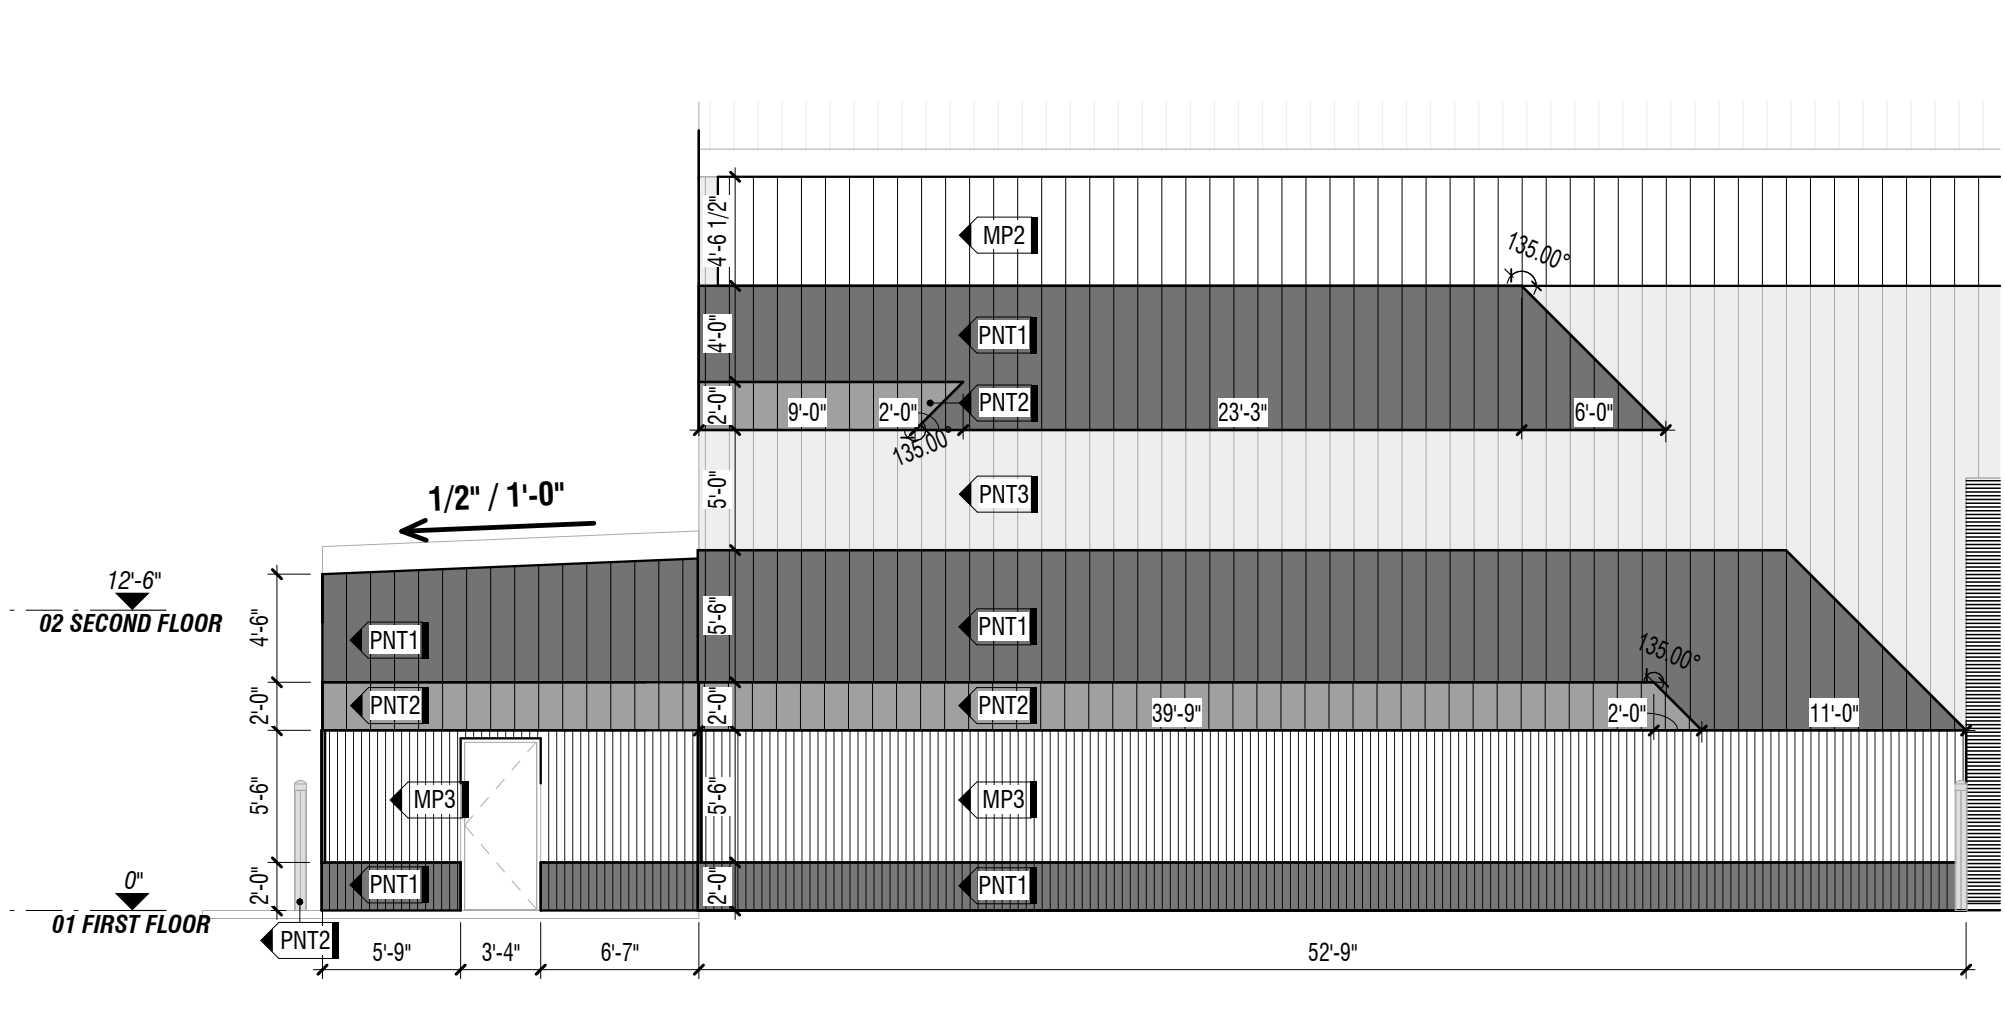


3 EAST PAINT ELEVATION 2

SCALE: 1/8" = 1'-0" SHEET: A-2.2

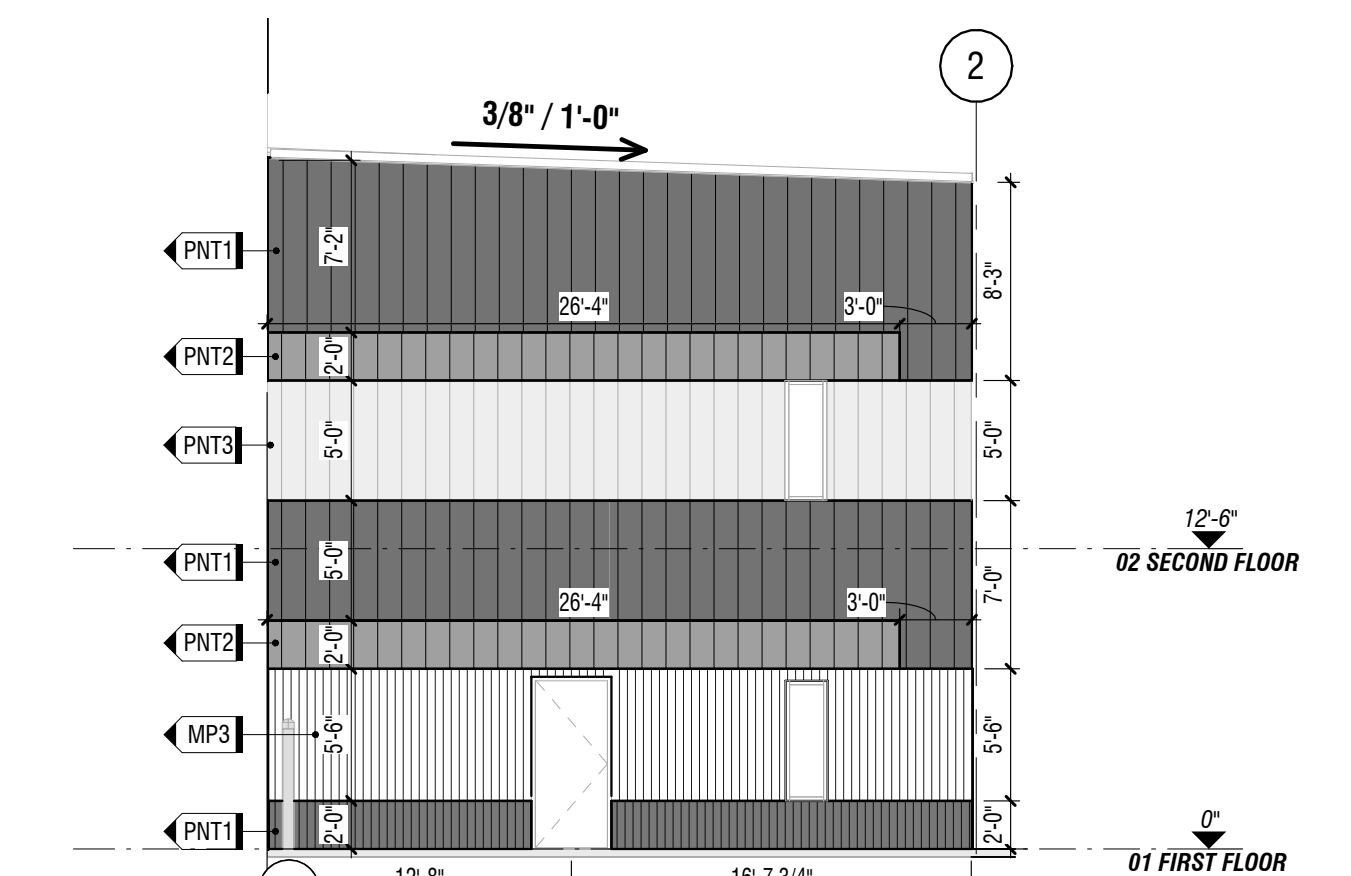


7 ALCOVE ELEVATION 2

SCALE: 1/8" = 1'-0" SHEET: A-2.2

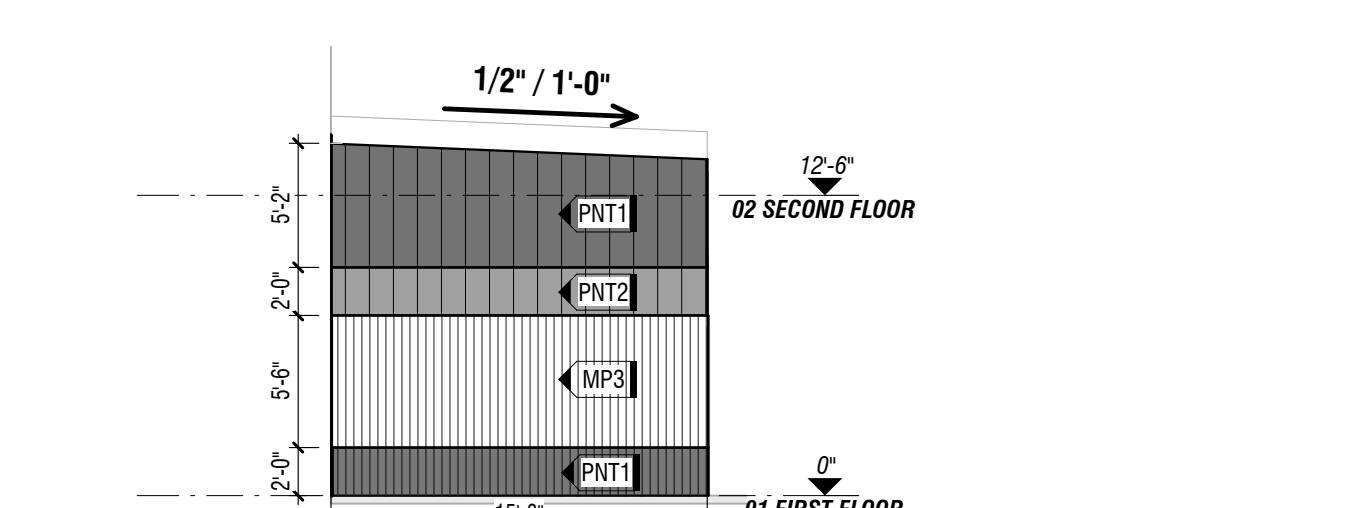


8 EAST ALCOVE ELEVATION

SCALE: 1/8" = 1'-0" SHEET: A-2.2

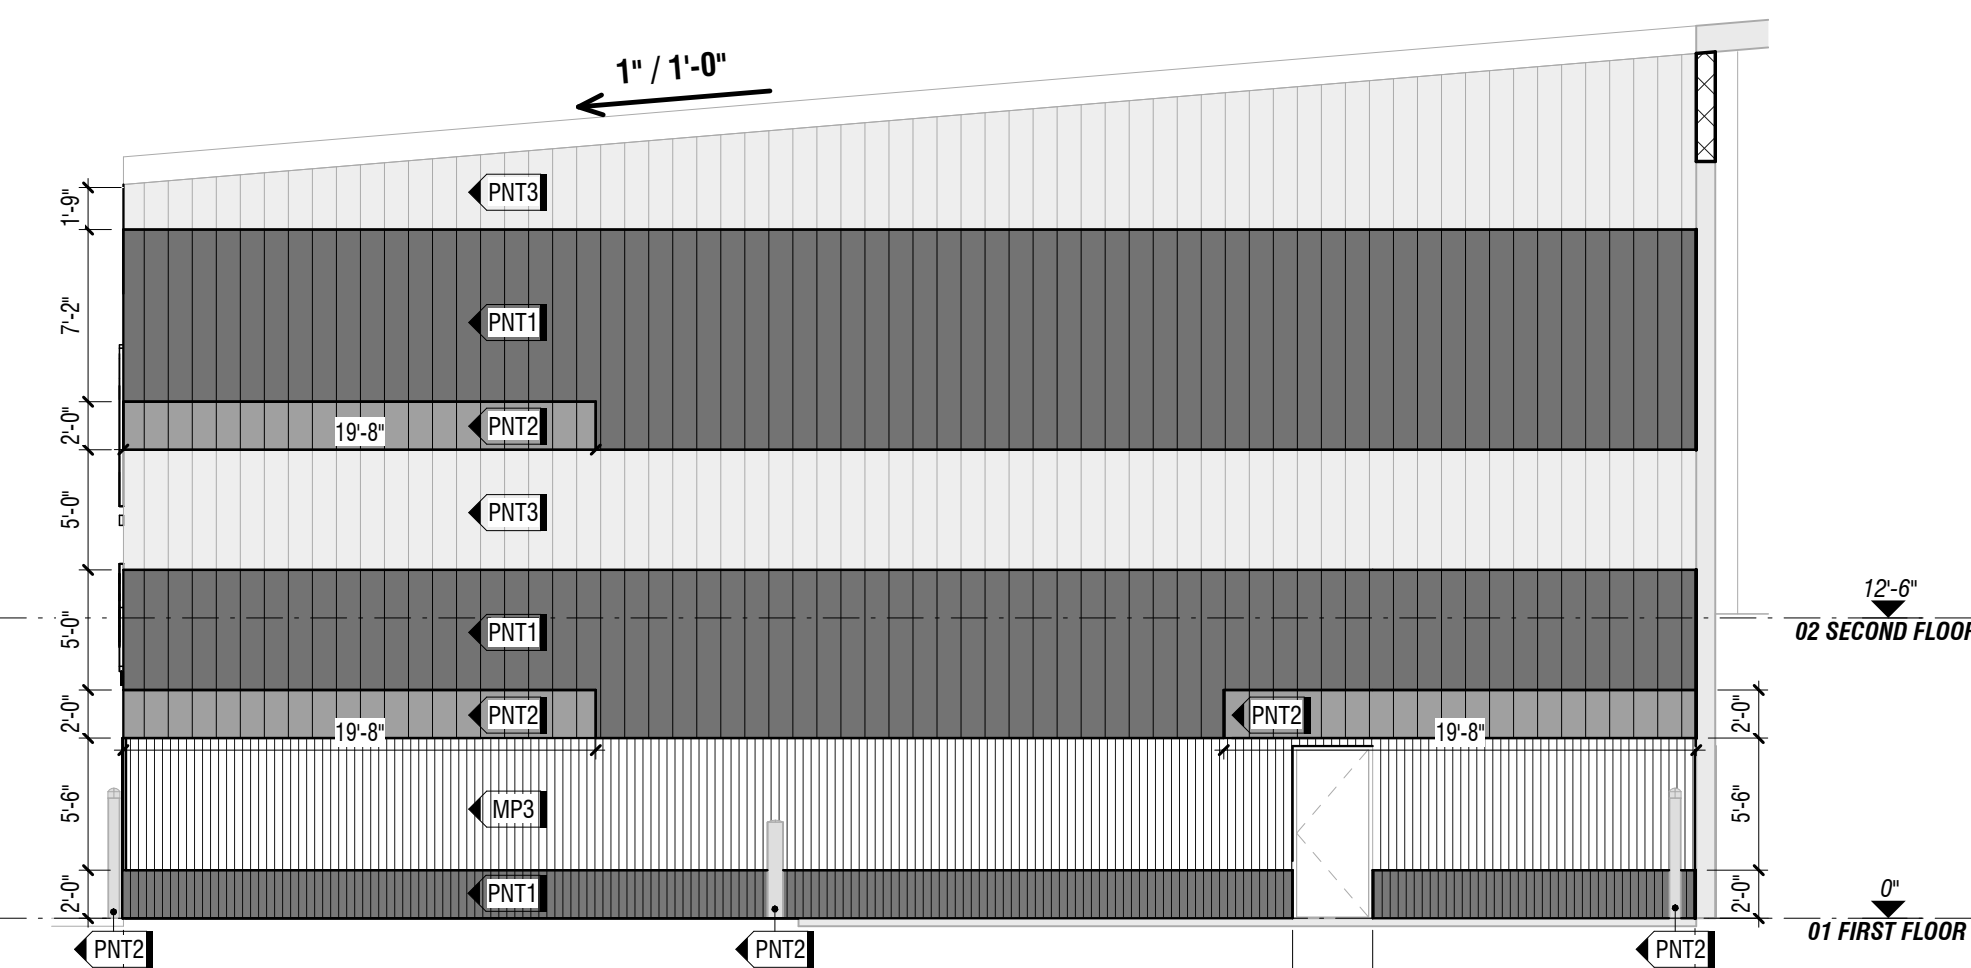


4 ALCOVE PAINT ELEVATION 1

SCALE: 1/8" = 1'-0" SHEET: A-2.2

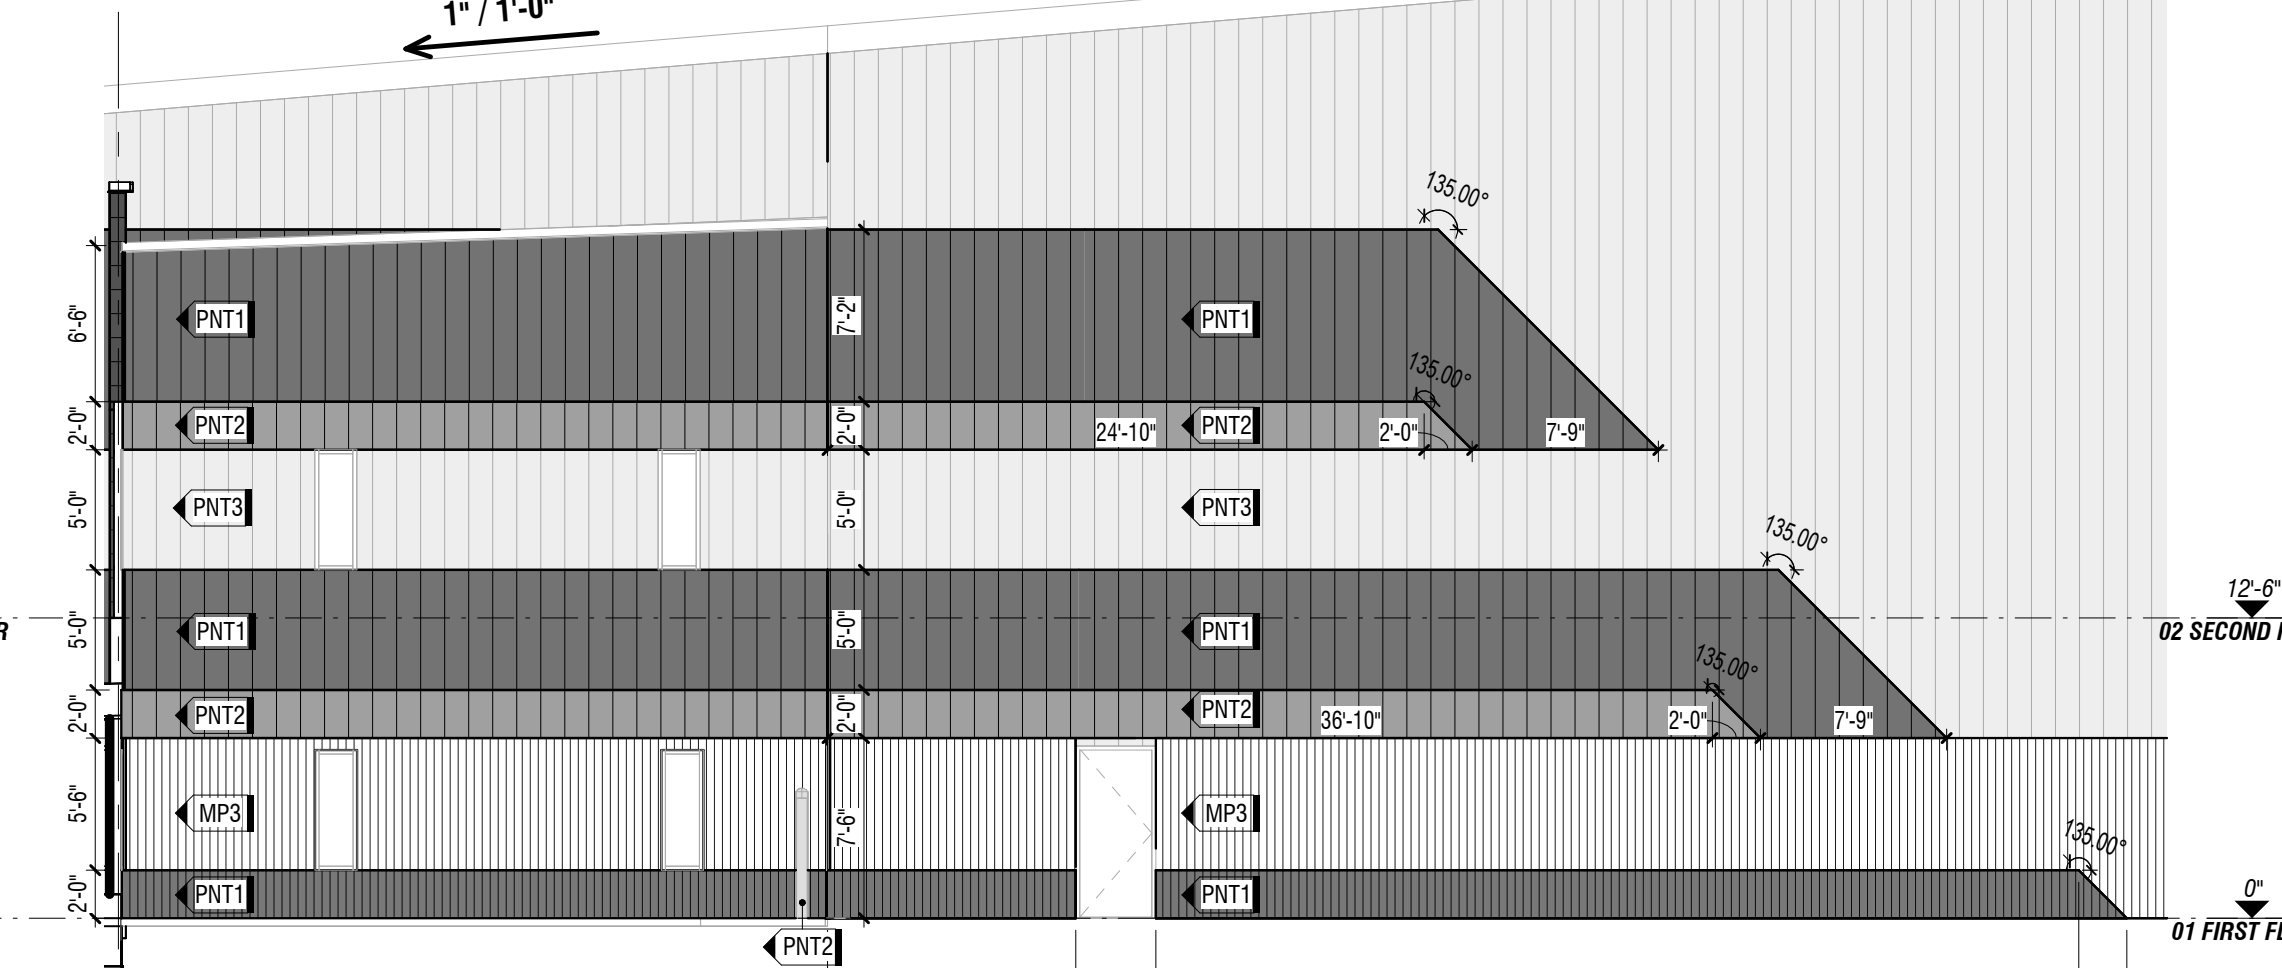

5 SOUTH PAINT ELEVATION 1

SCALE: 1/8" = 1'-0" SHEET: A-2.2

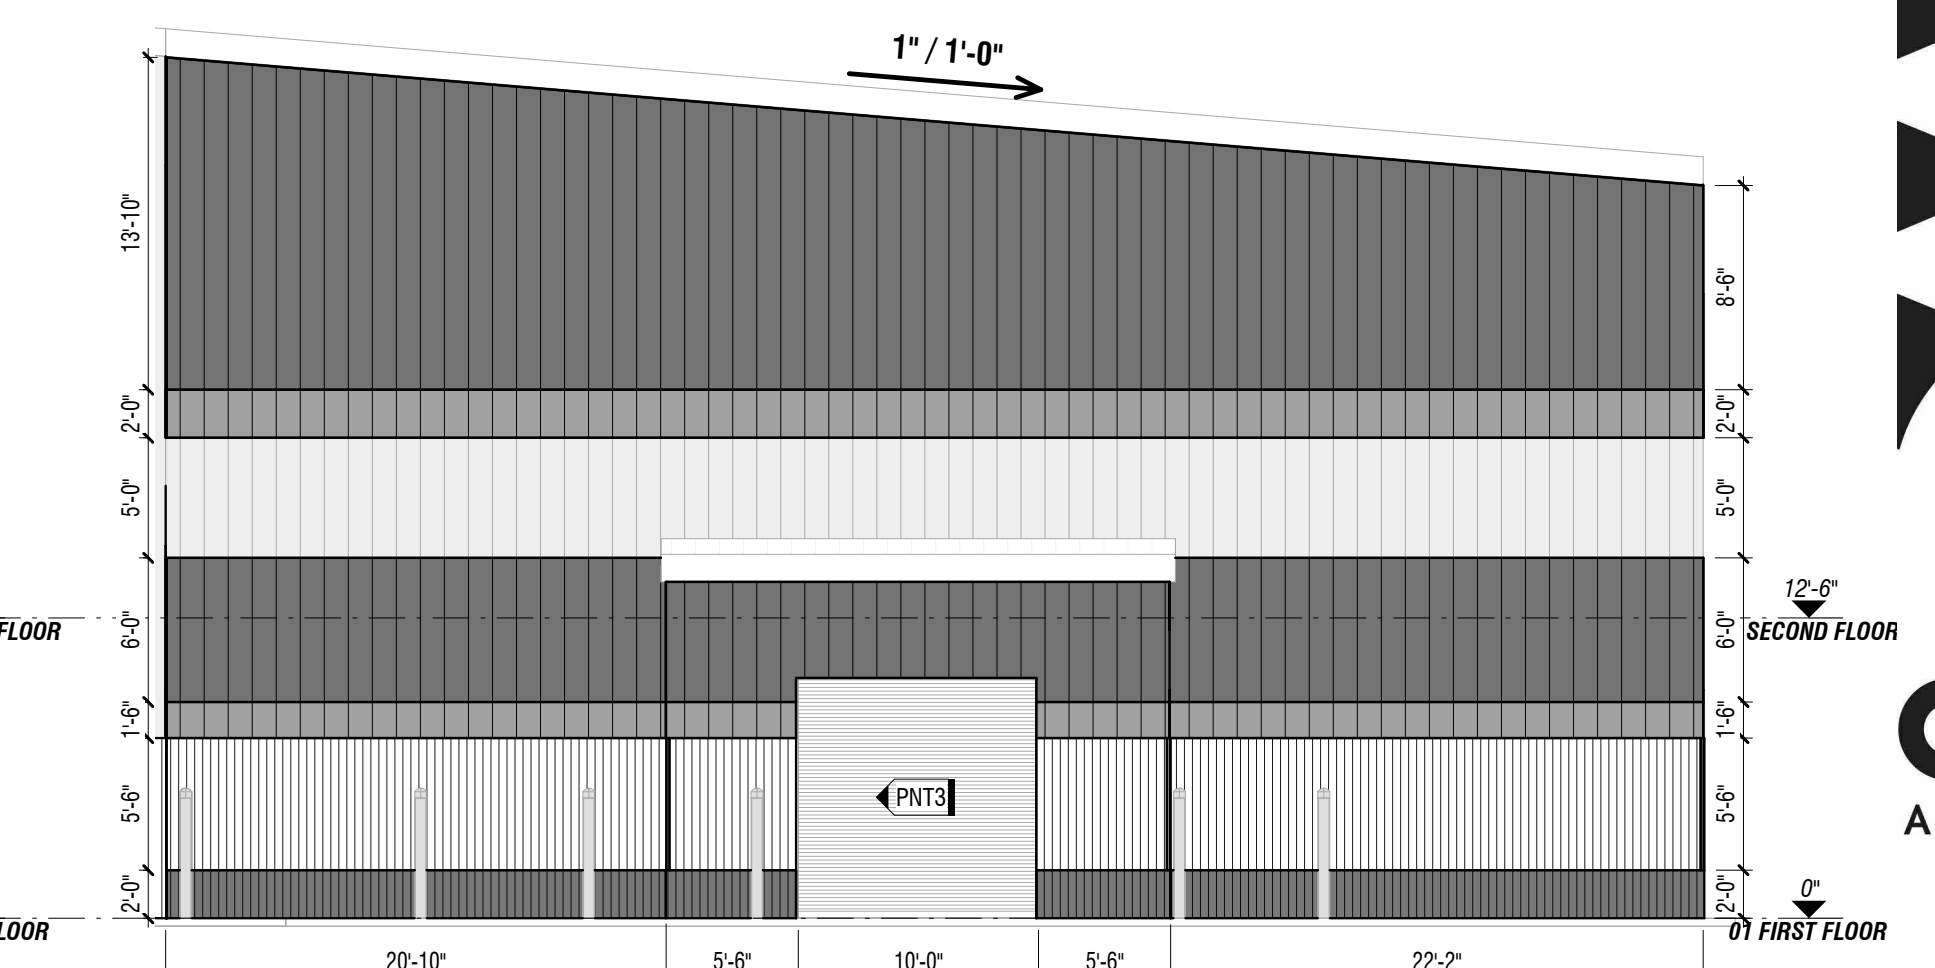


6 SOUTH PAINT ELEVATION 2

SCALE: 1/8" = 1'-0" SHEET: A-2.2


ATC RENOVATION
NEW RIVER COMMUNITY & TECHNICAL COLLEGE
527 Odd Rd.
Ghent, WV 25843



Copyright © All rights reserved. Reproduction in whole or in part is prohibited. This drawing is an instrument of service, is the property of the Architect and may not be used in any way without written permission of this firm.
Project No: 2024008.001 Drawn by: ---

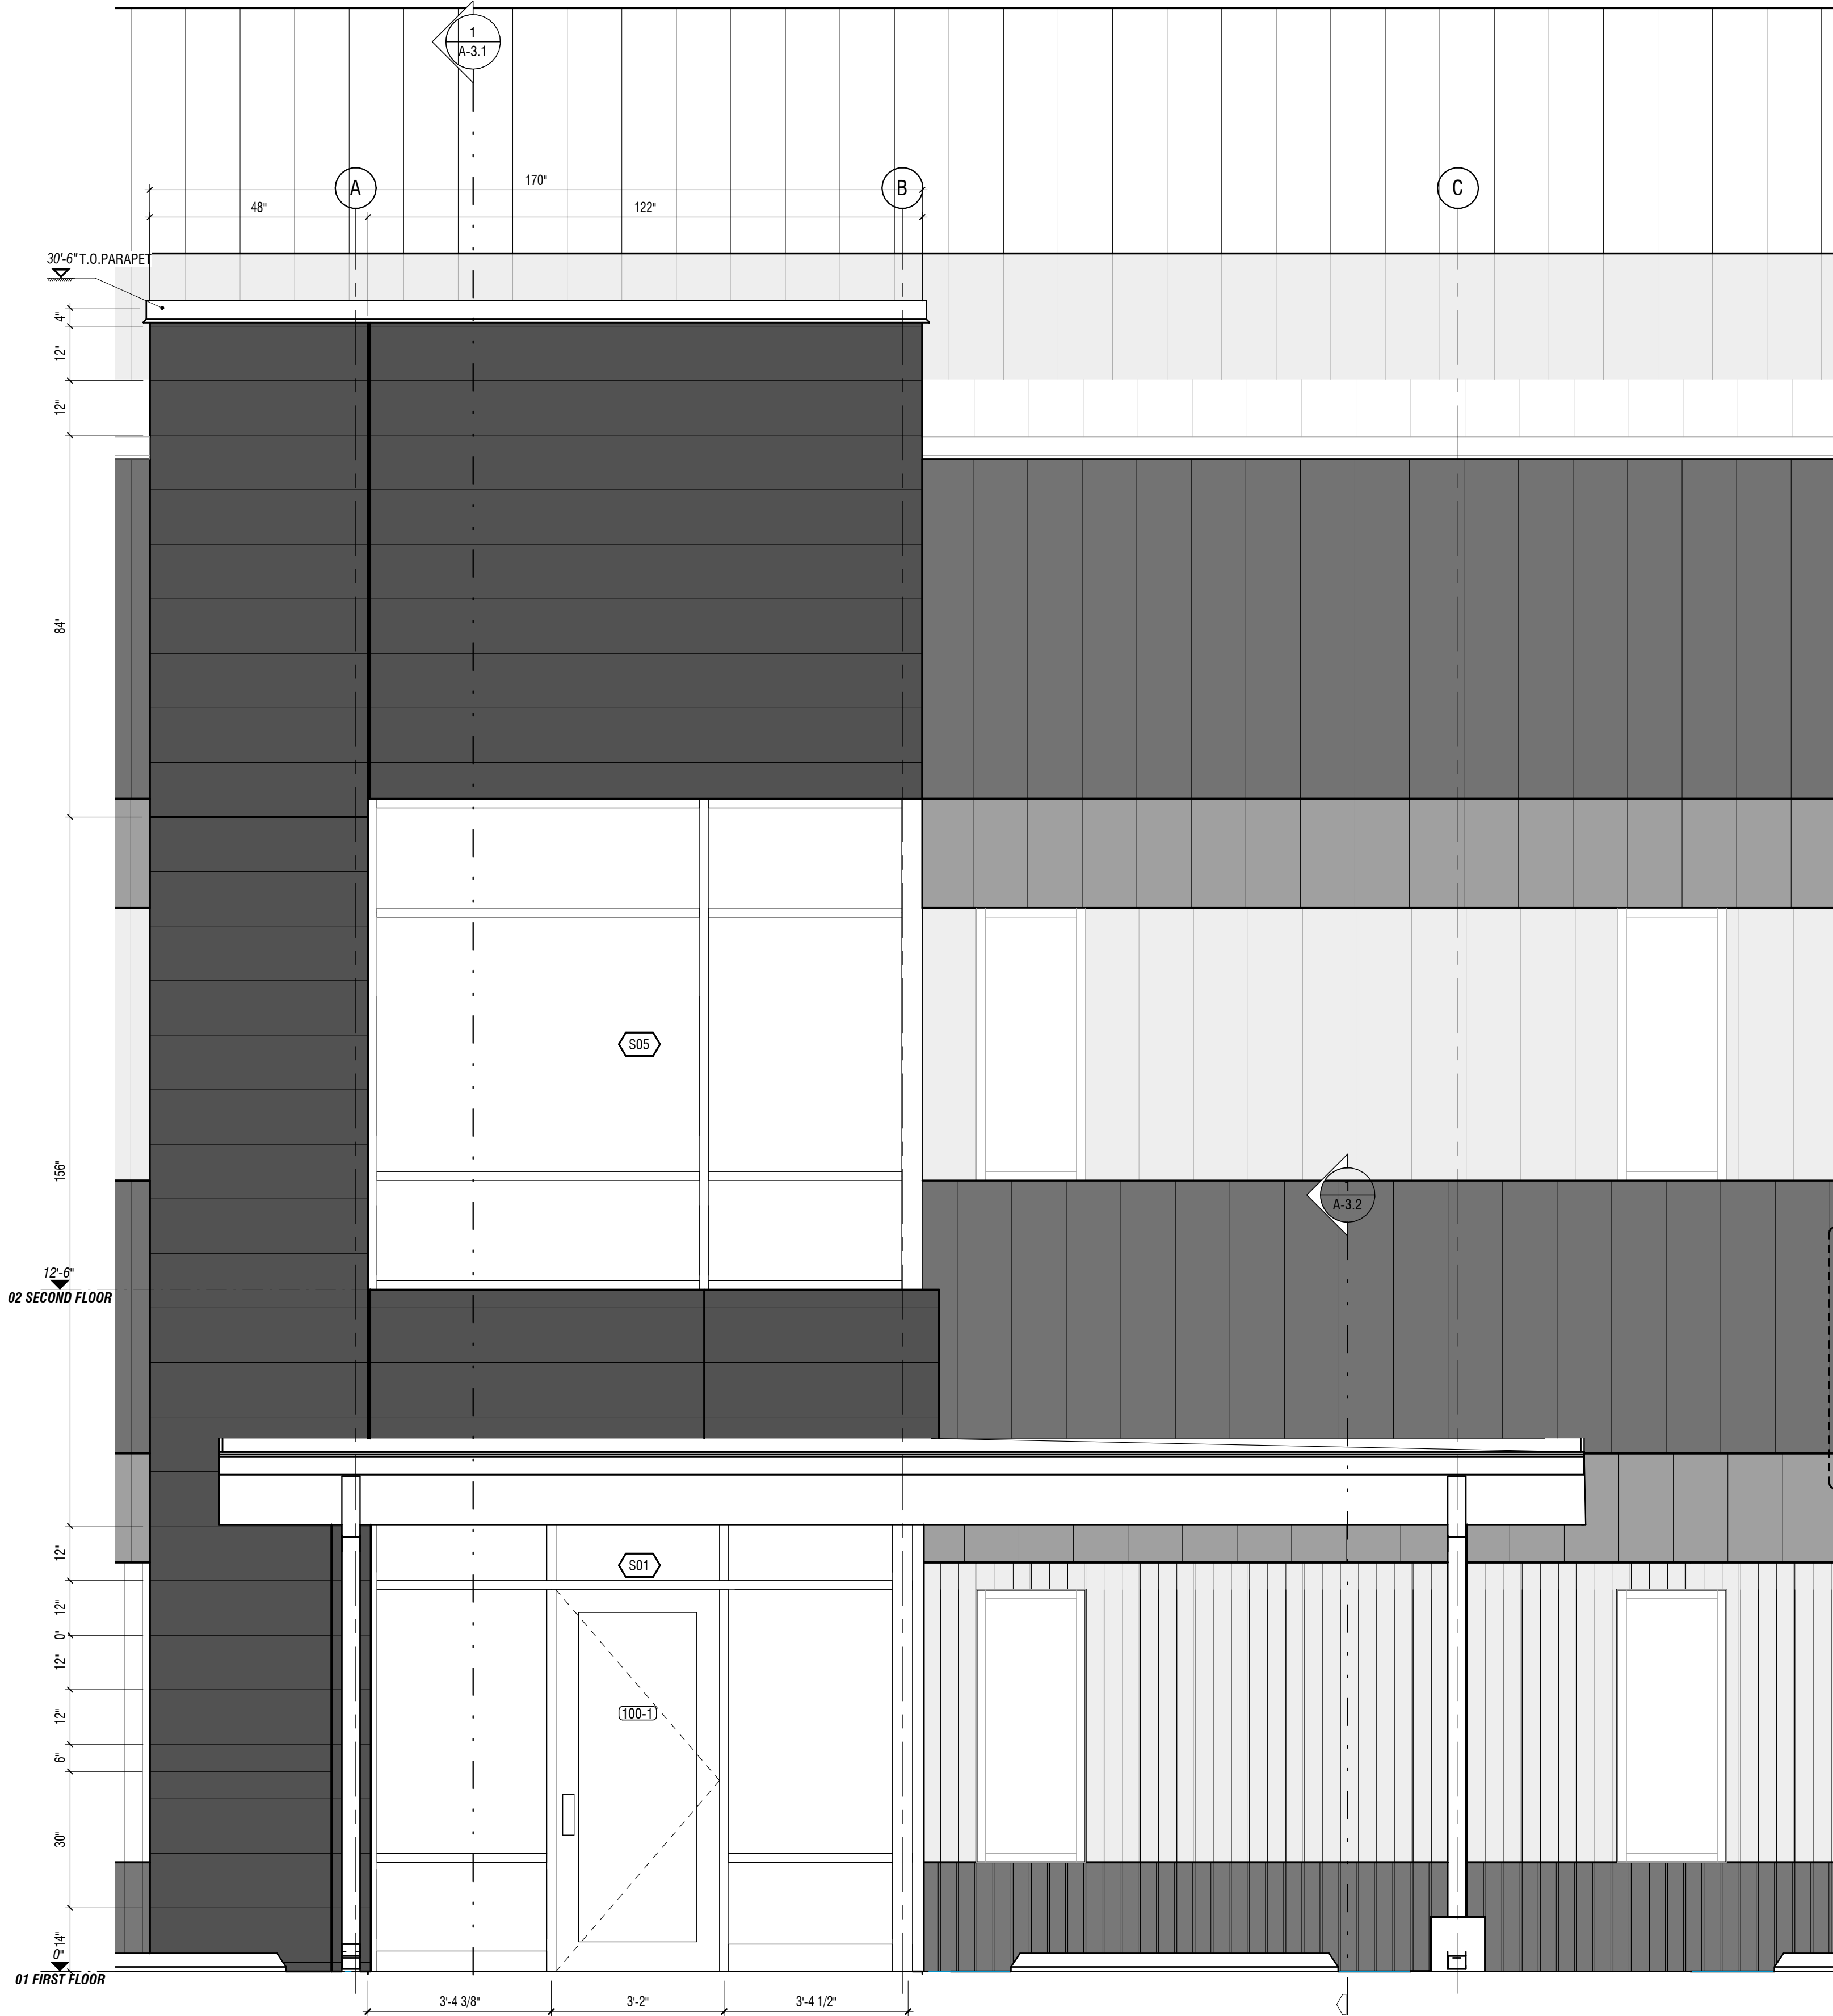


8 WEST ELEVATION - VESTIBULE
 SCALE: 1/2" = 1'-0" SHEET: A-3.1

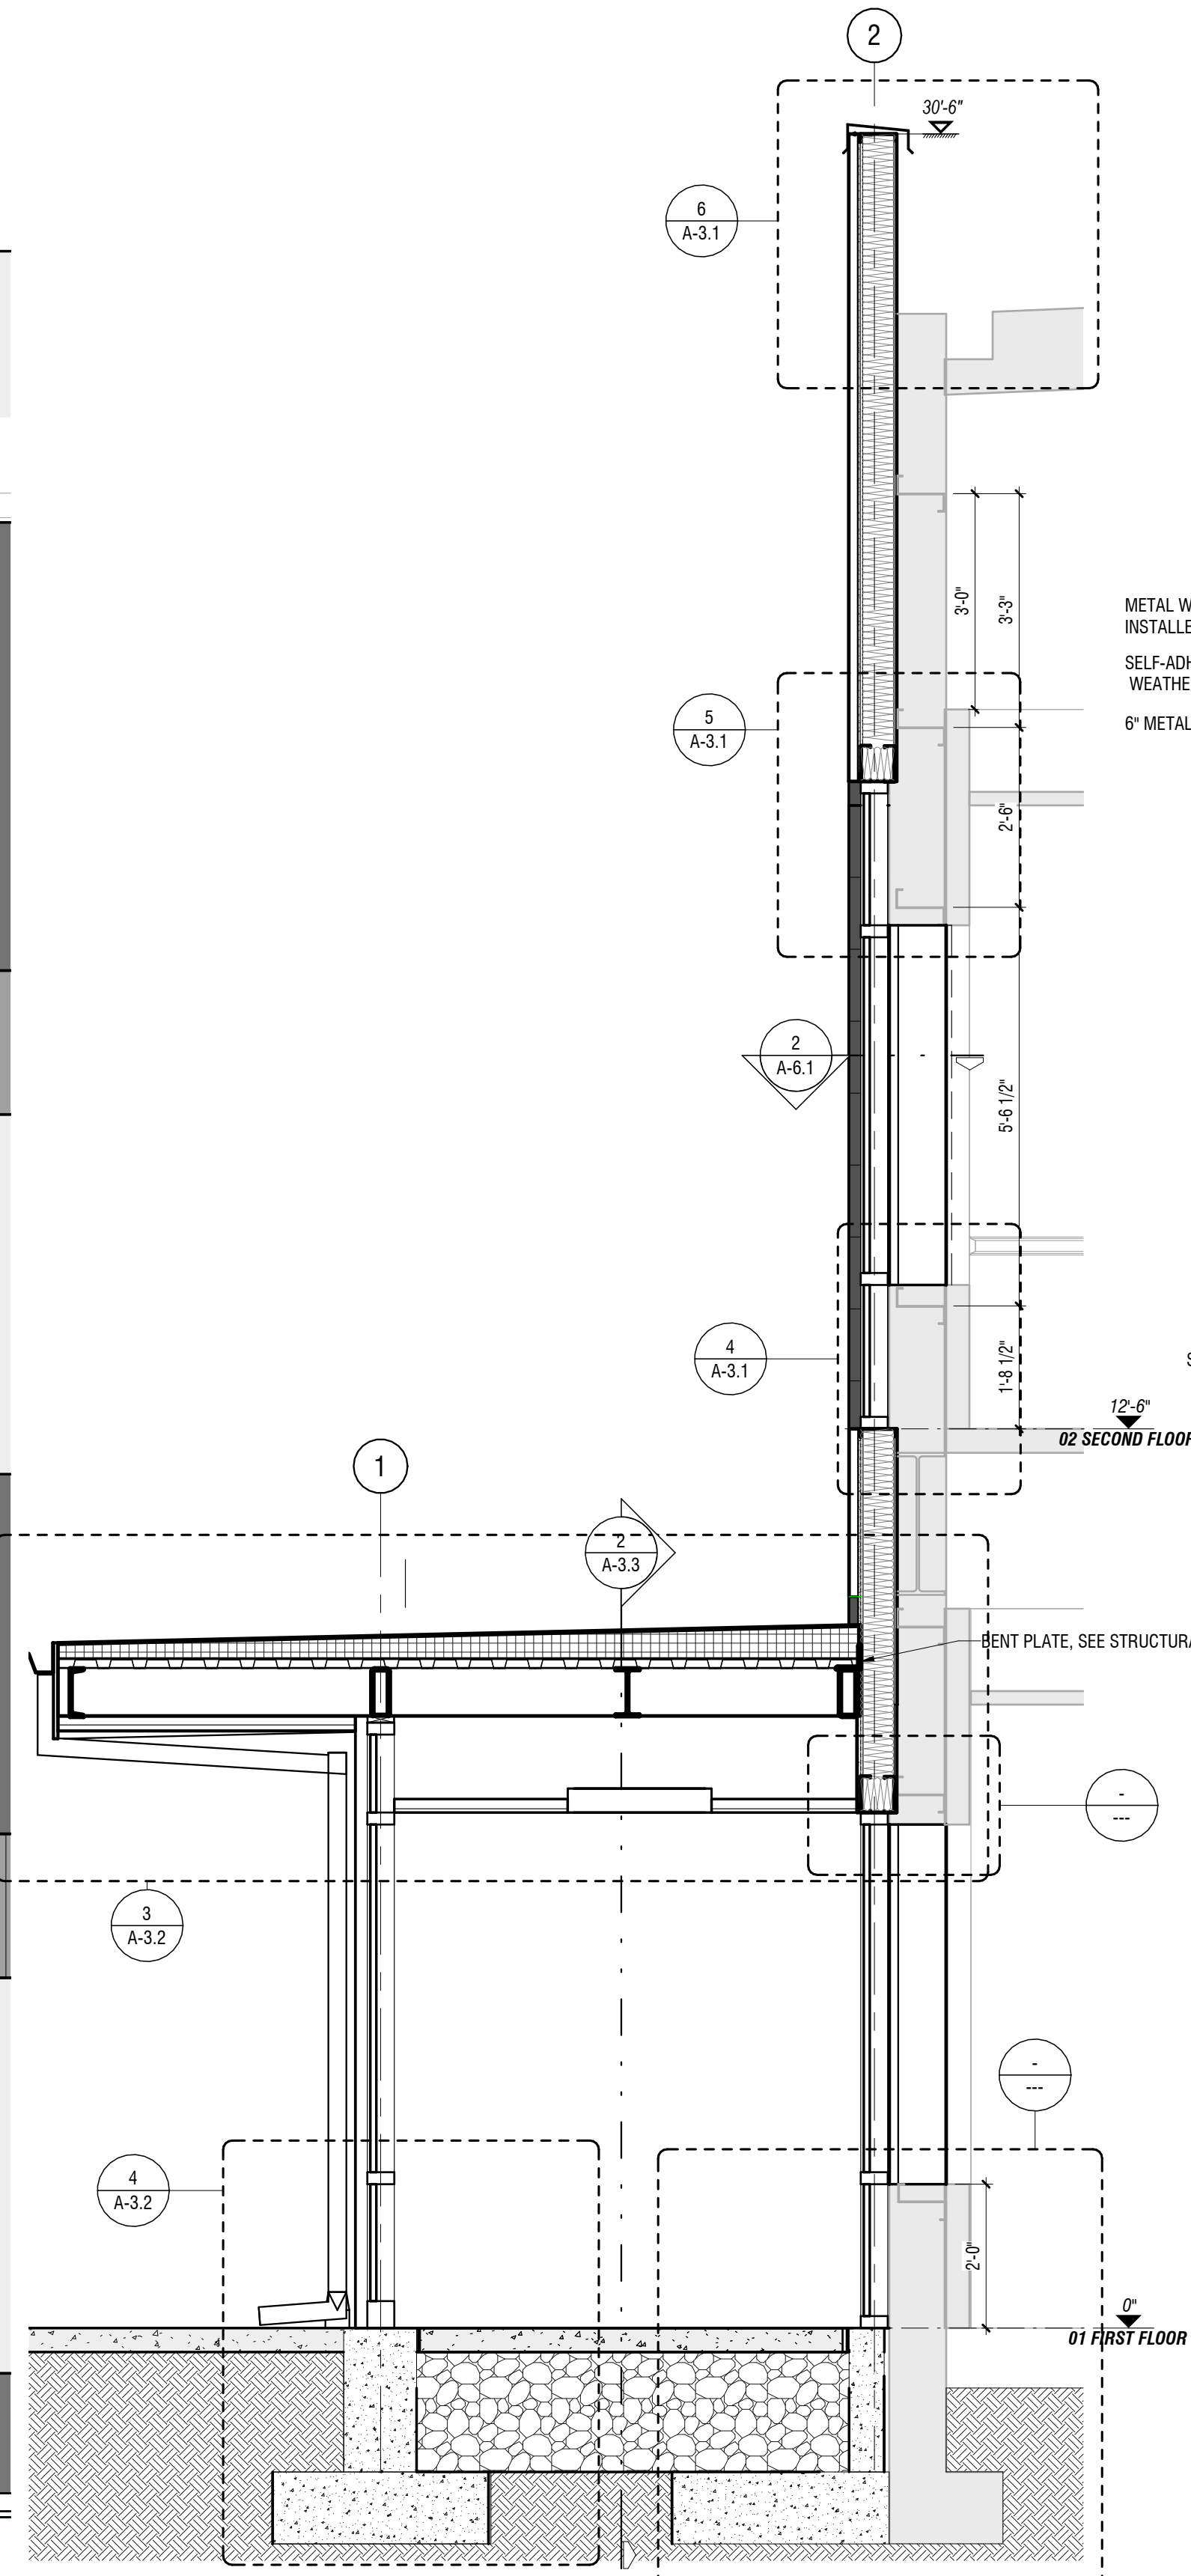


1 VESTIBULE SECTION
 SCALE: 1/2" = 1'-0" SHEET: A-3.1




6 PARAPET WALL AT EXISTING PEMB ROOF
 SCALE: 1 1/2" = 1'-0" SHEET: A-3.1

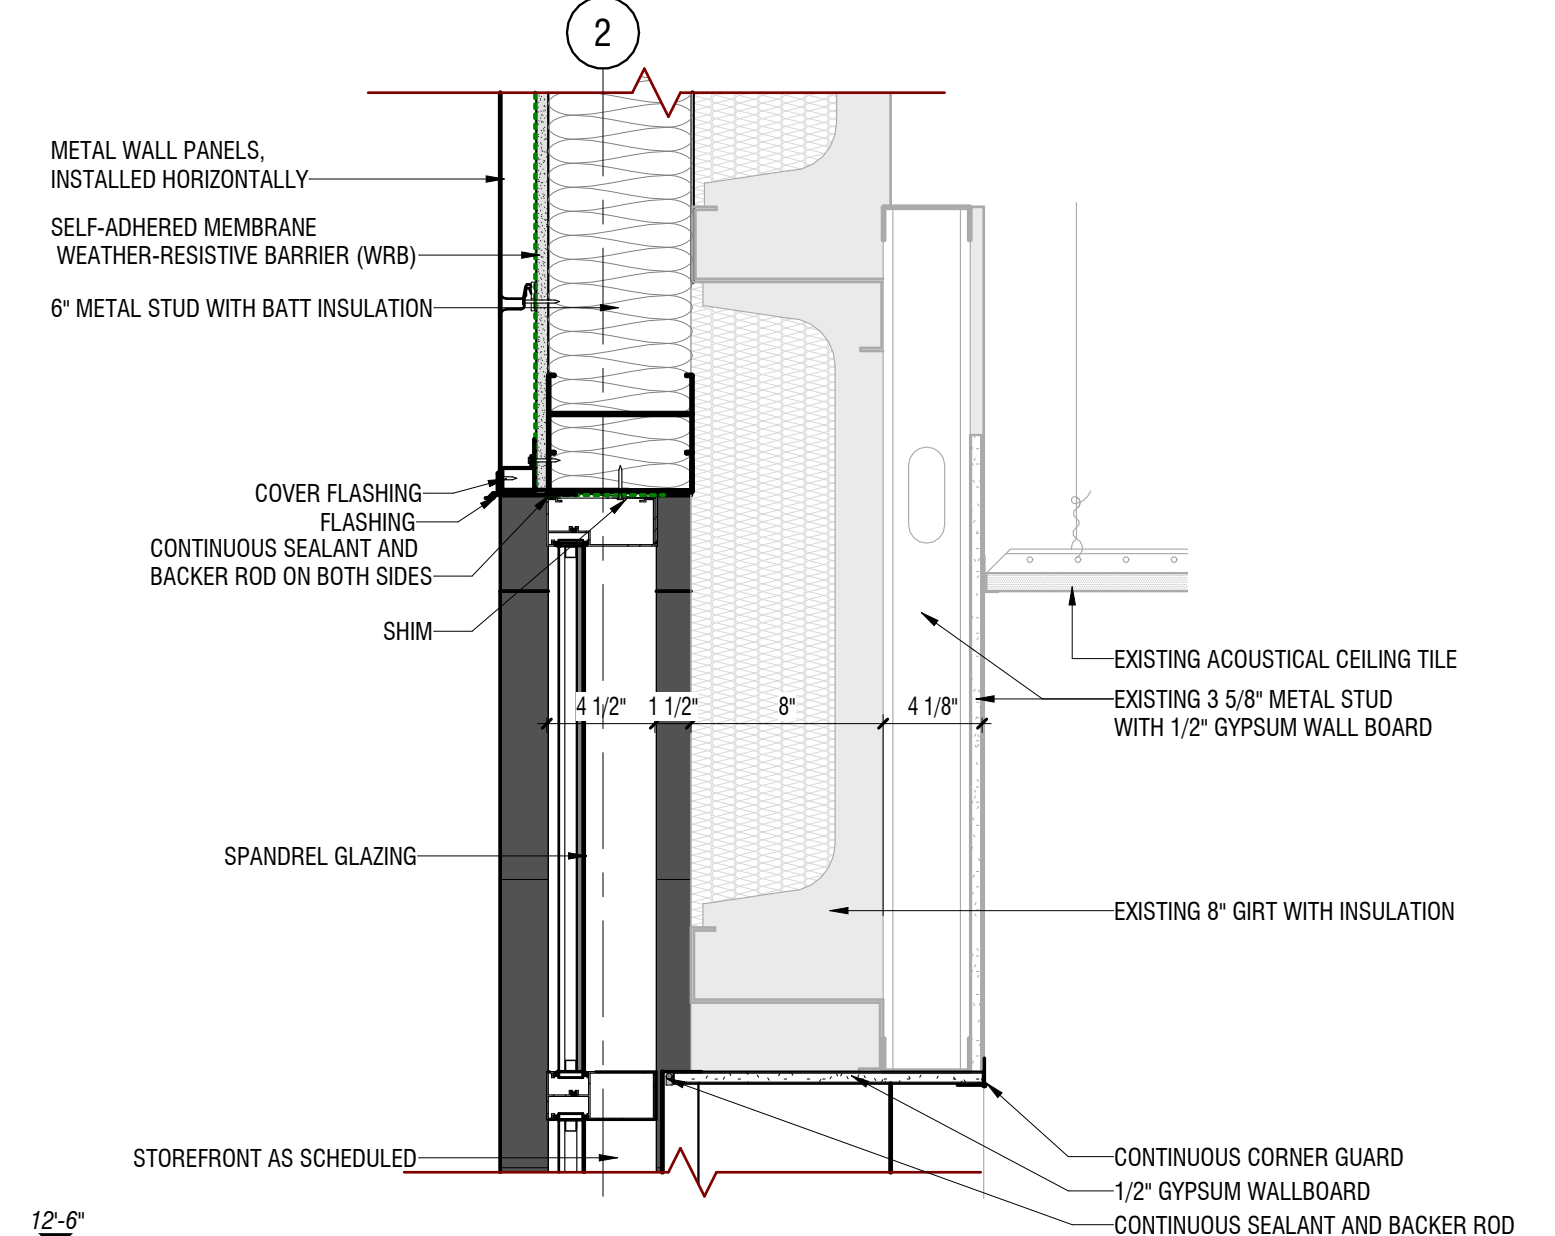


5 STOREFRONT HEAD AT NEW WALL DETAIL
 SCALE: 1 1/2" = 1'-0" SHEET: A-3.1

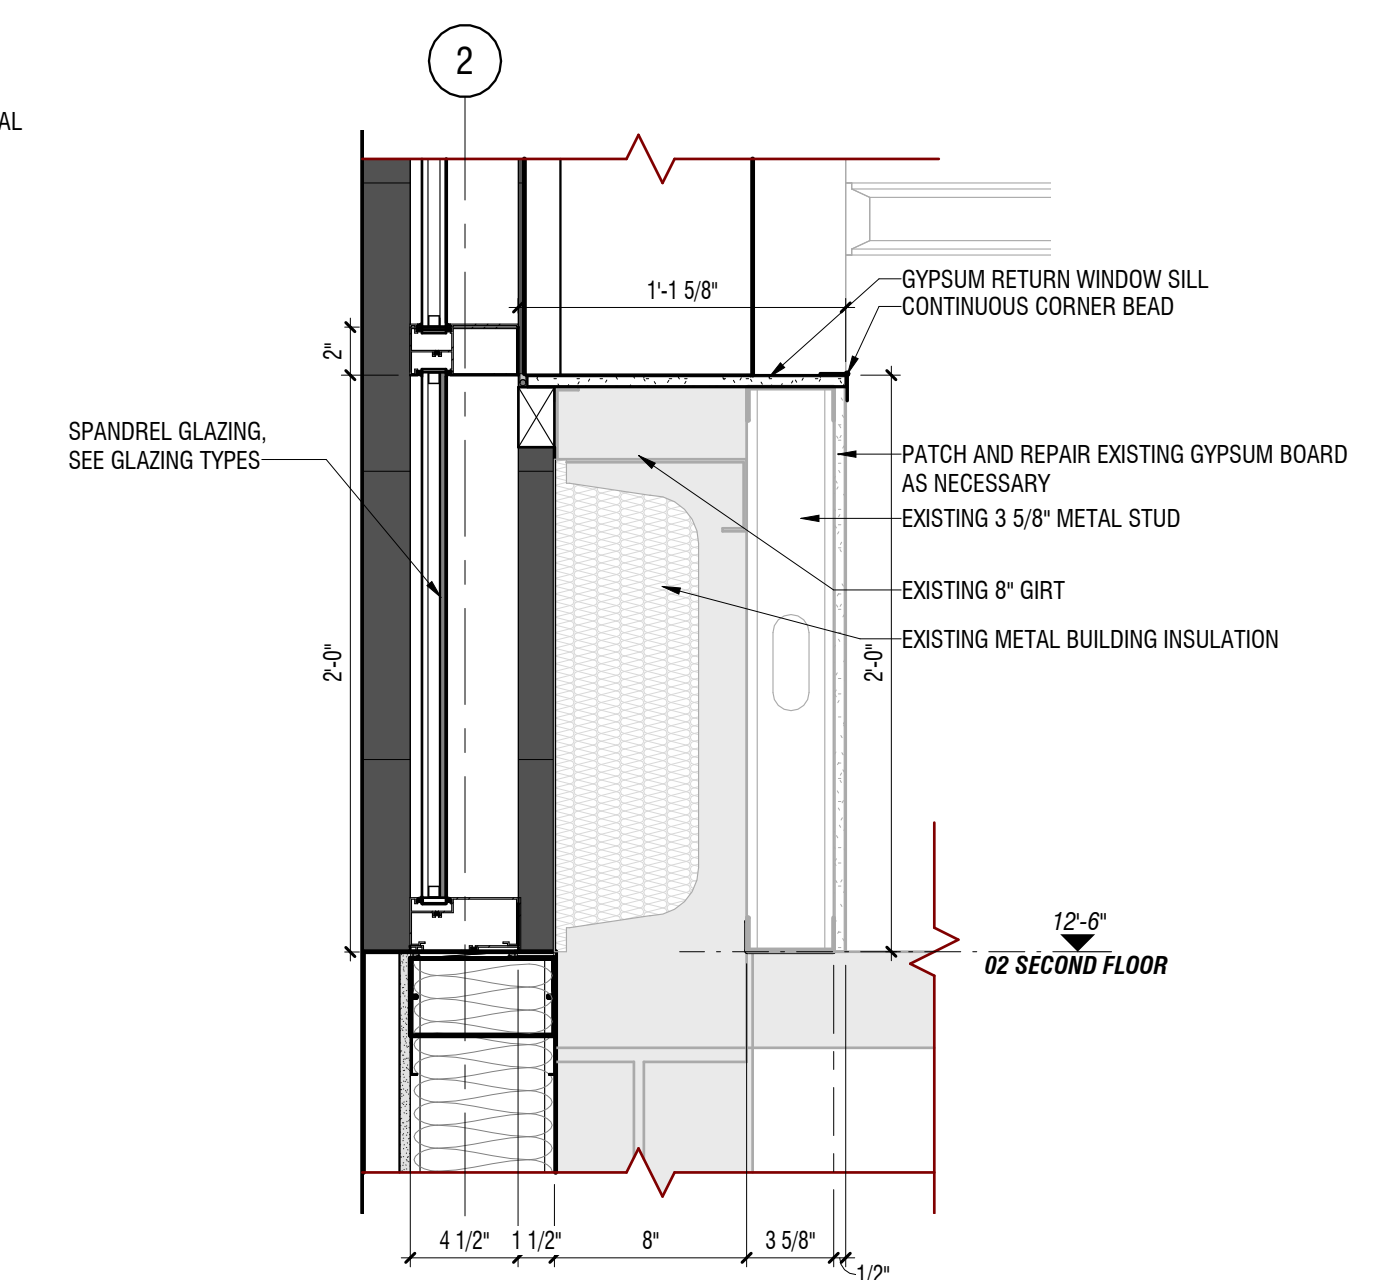


4 STOREFRONT SILL DETAIL
 SCALE: 1 1/2" = 1'-0" SHEET: A-3.1

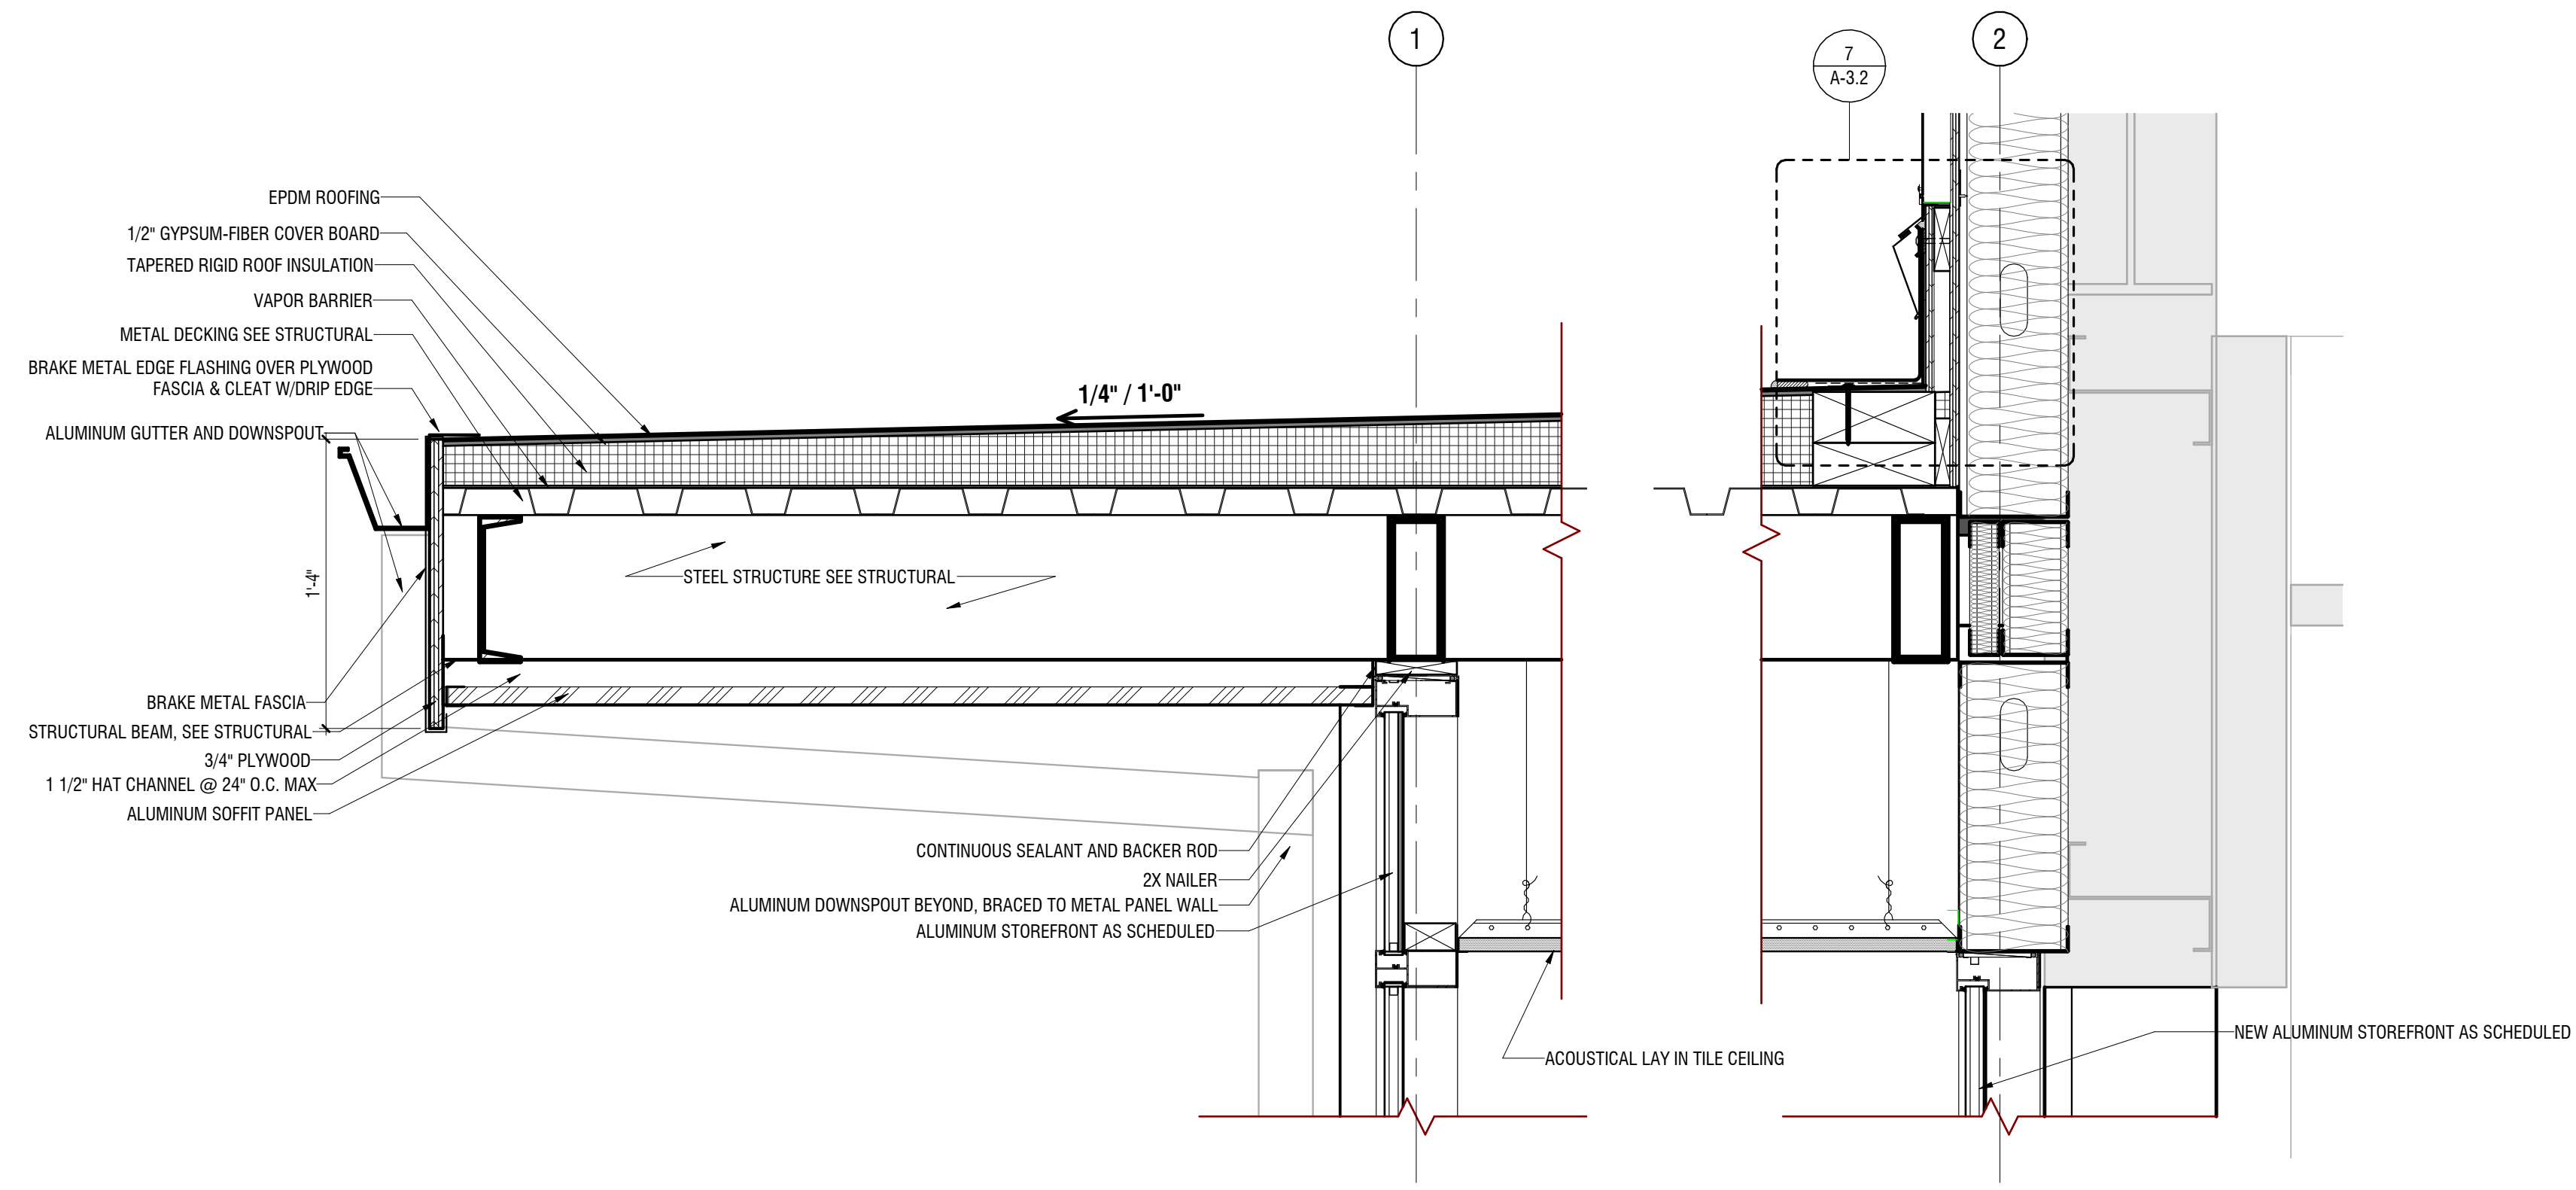


3 VESTIBULE CANOPY DETAIL
 SCALE: 1 1/2" = 1'-0" SHEET: A-3.2

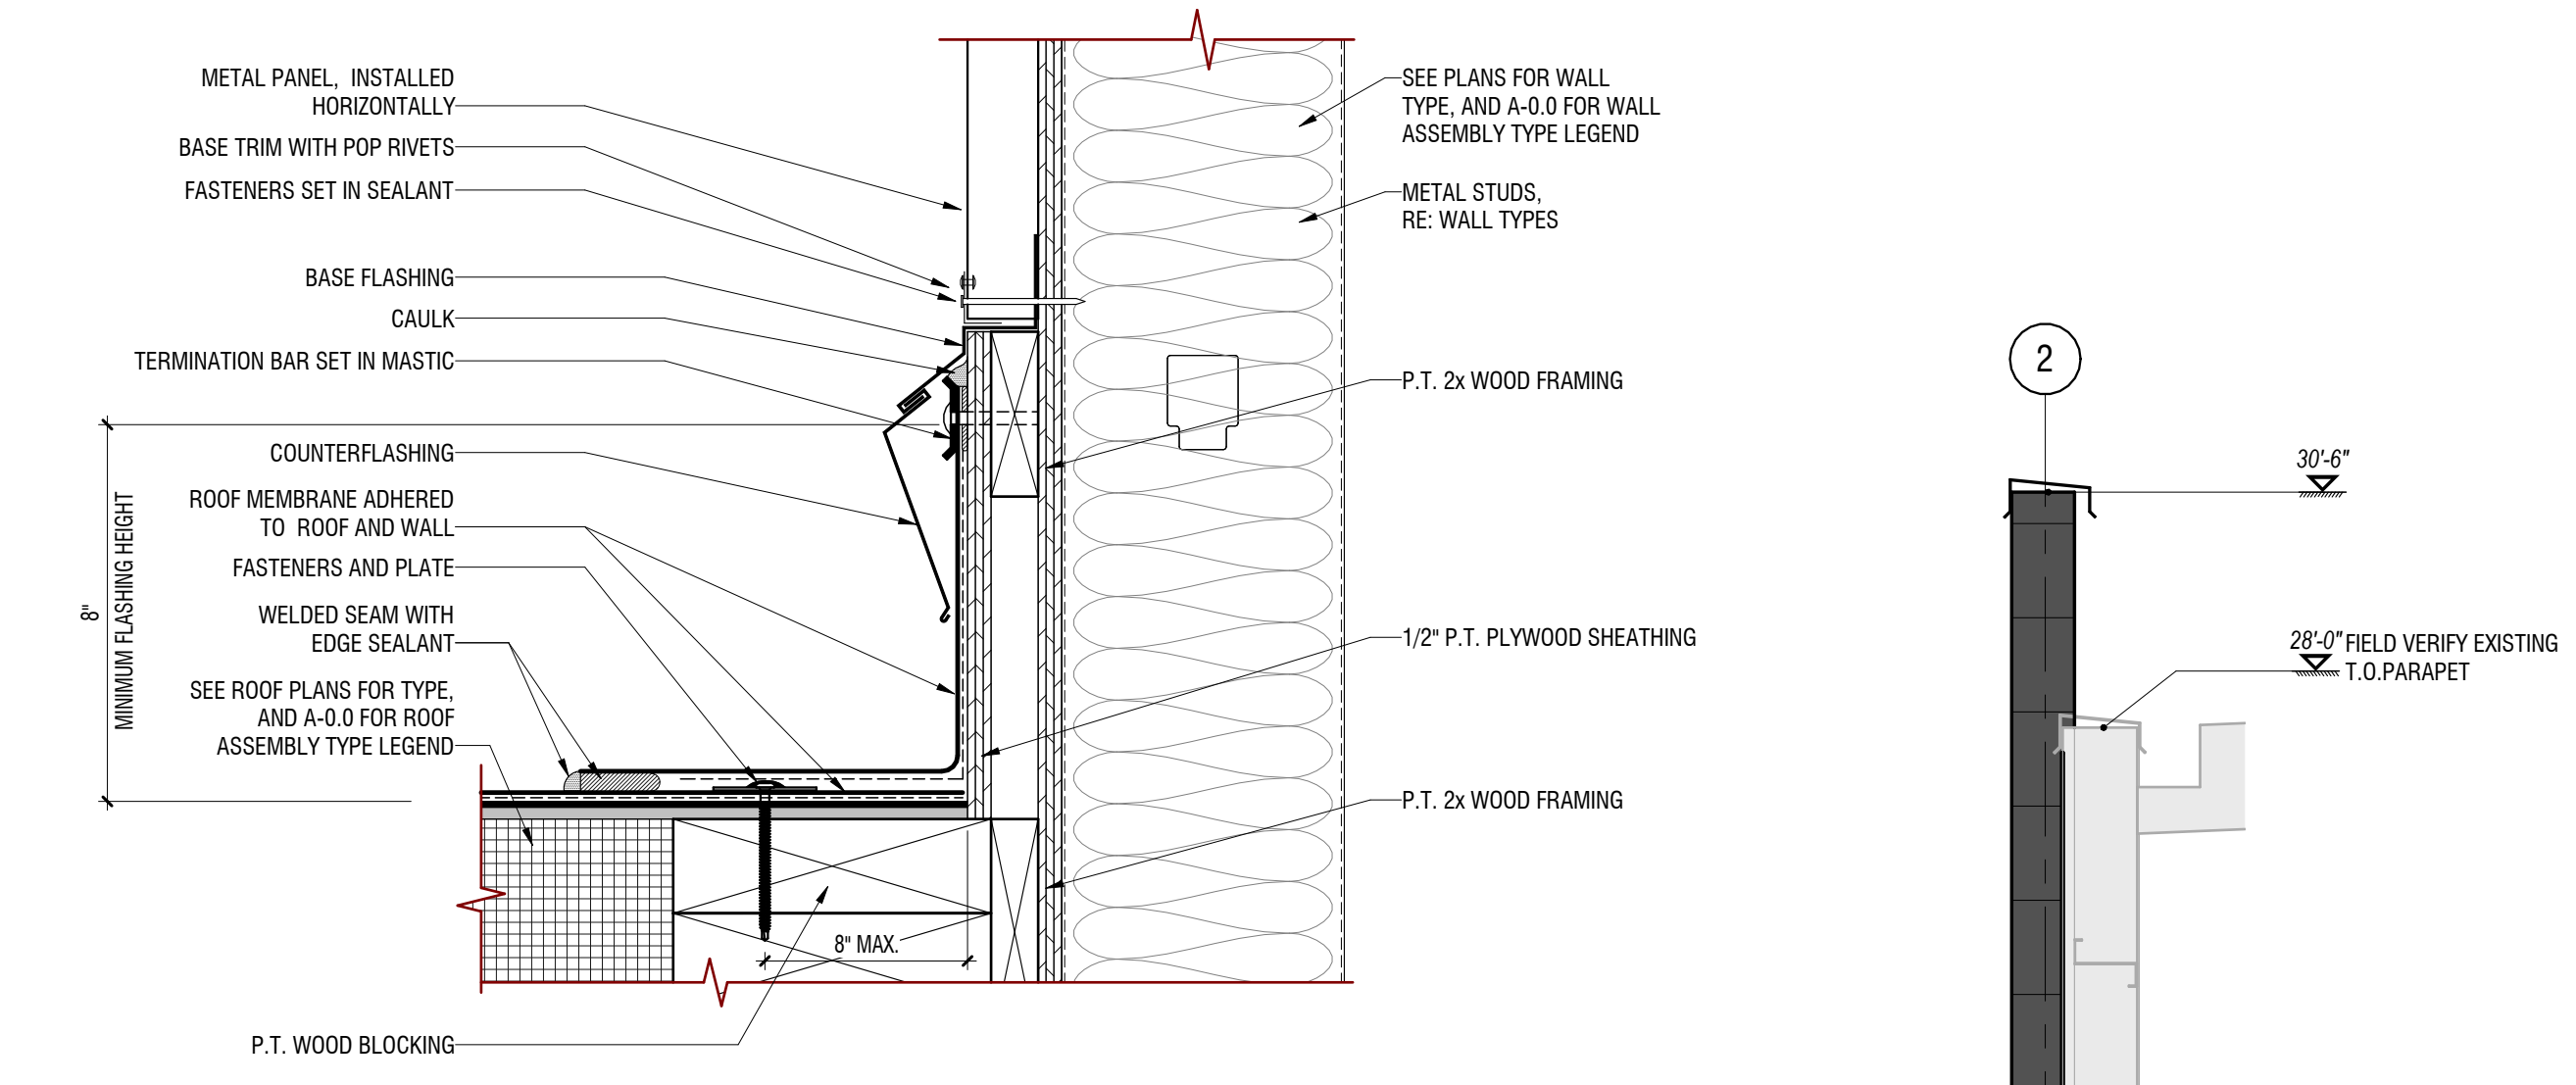


7 ROOF - TERMINATION @ METAL PANELS
 SCALE: 3" = 1'-0" SHEET: A-3.2

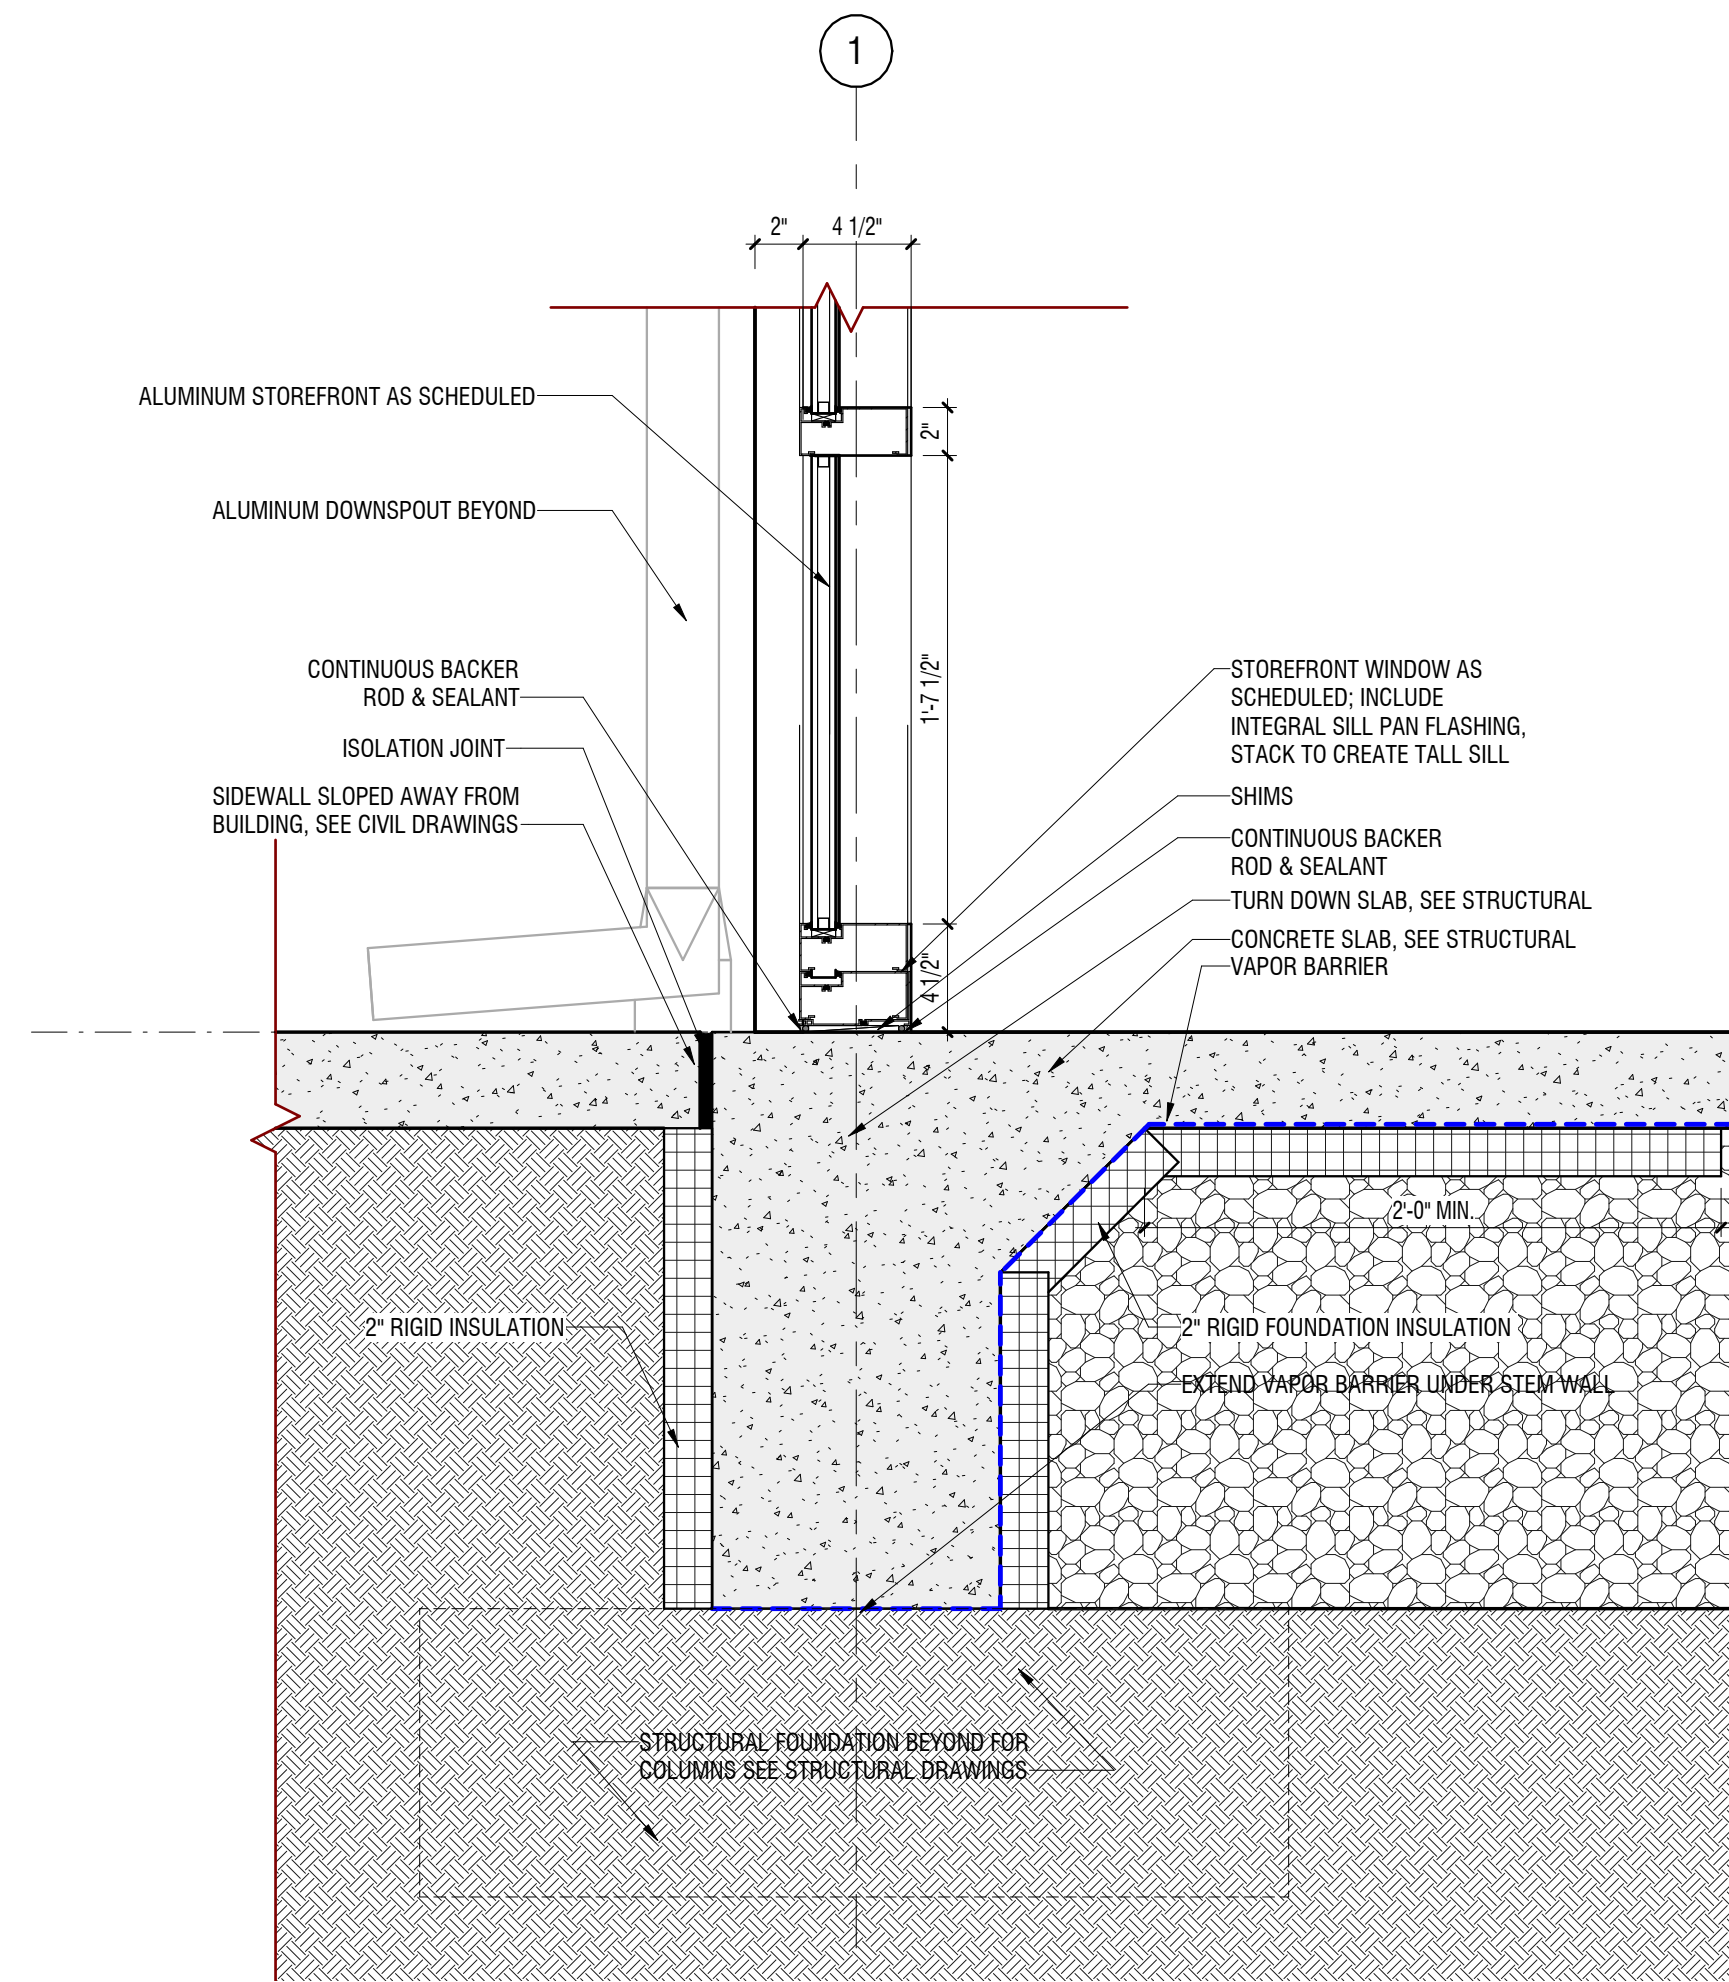

4 VESTIBULE FOUNDATION AT STOREFRONT
 SCALE: 1 1/2" = 1'-0" SHEET: A-3.2

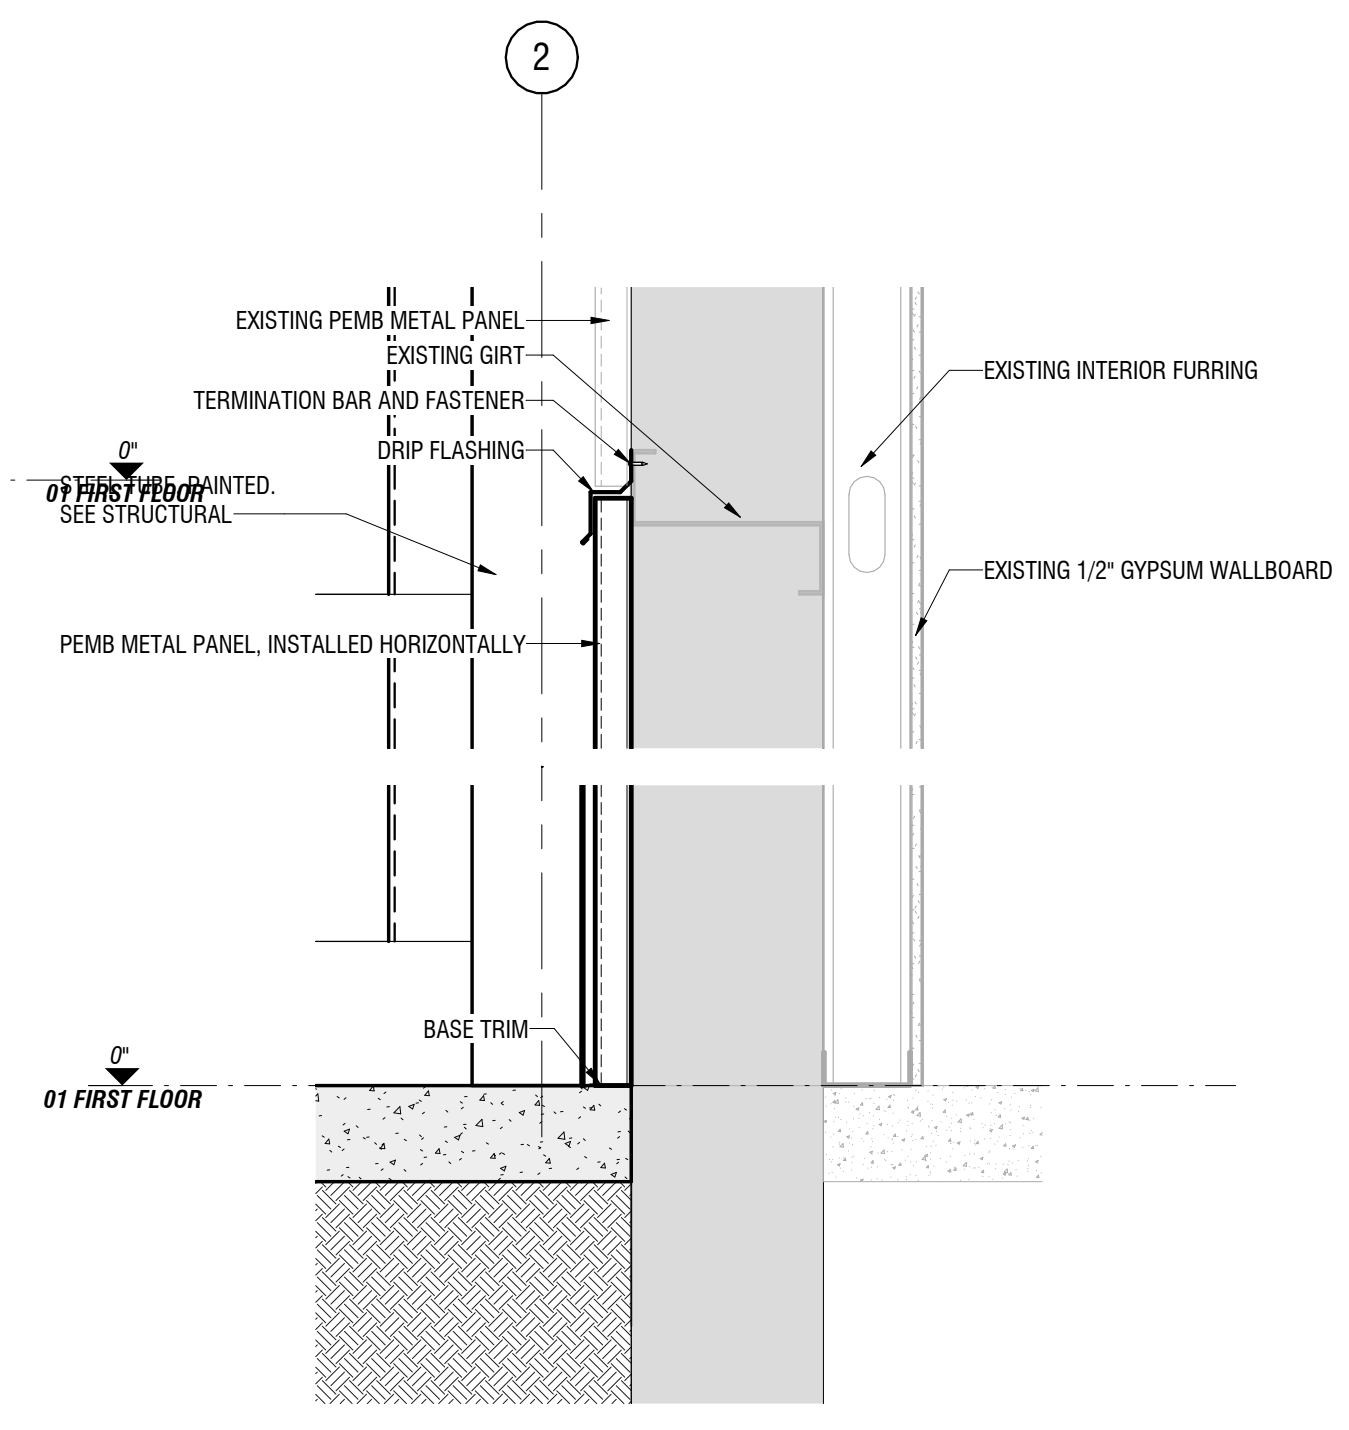

2 REPLACEMENT PANEL AT EXISTING DETAIL
 SCALE: 1 1/2" = 1'-0" SHEET: A-3.2

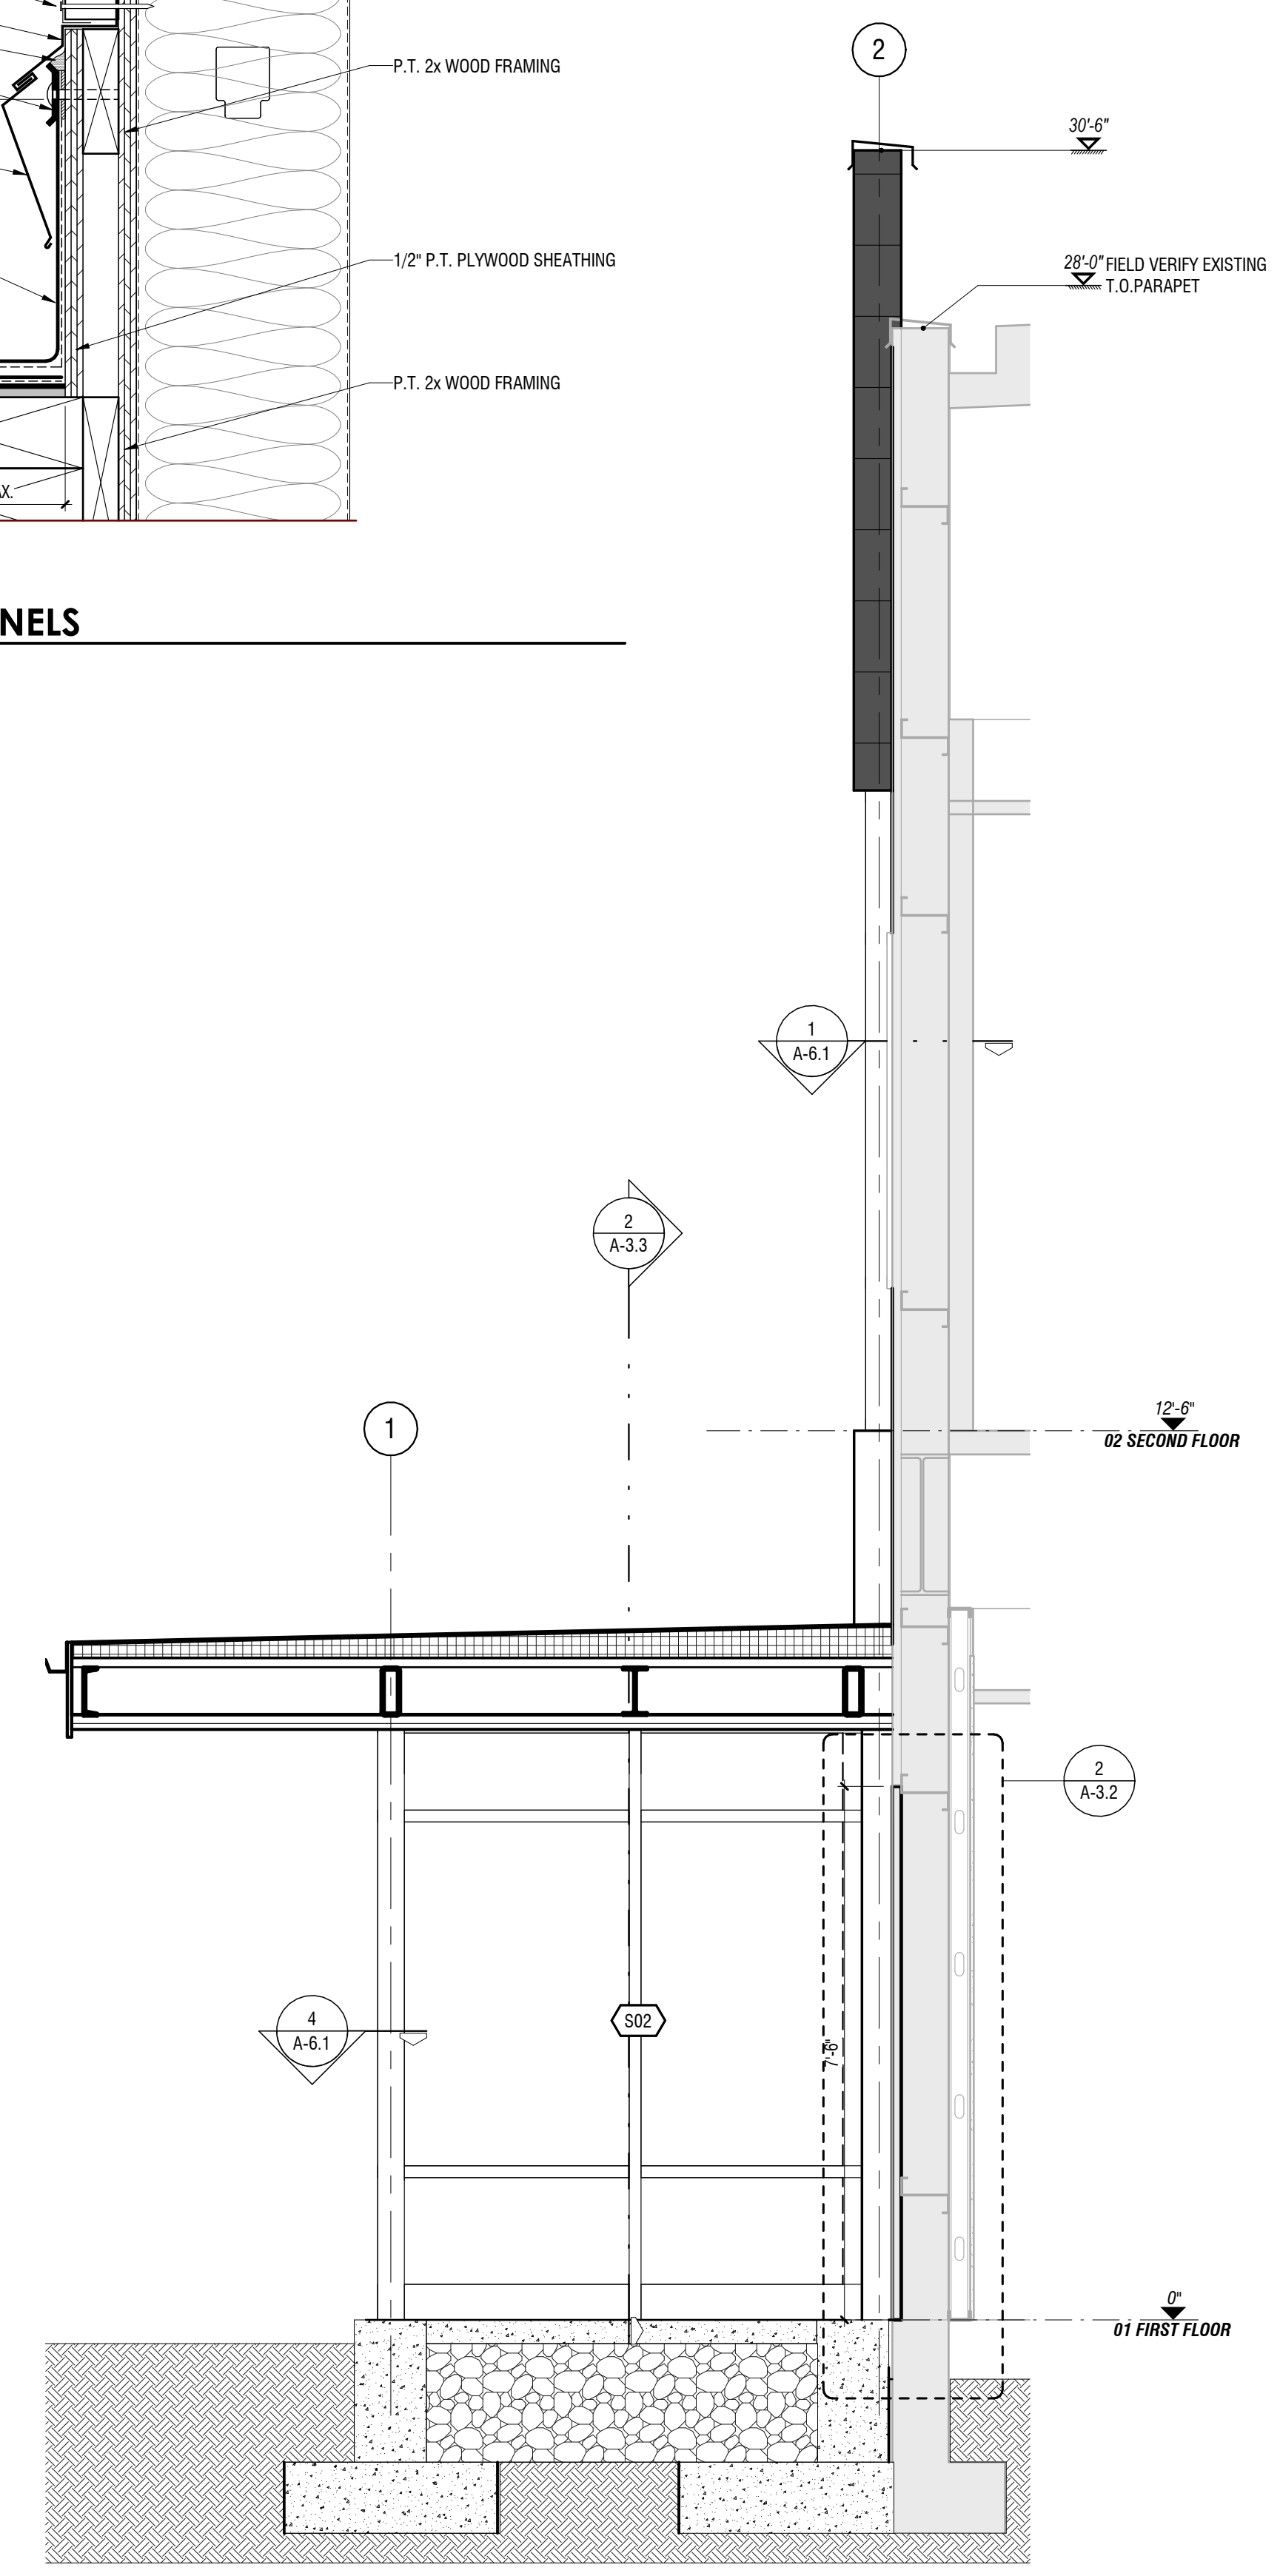

1 CANOPY SECTION
 SCALE: 1/2" = 1'-0" SHEET: A-3.2


ATC RENOVATION
 NEW RIVER COMMUNITY & TECHNICAL COLLEGE
 527 Odd Rd.
 Ghent, WV 25843




OMNI ARCHITECTS

A-3.2


WALL SECTIONS AND DETAILS - ALTERNATE #01

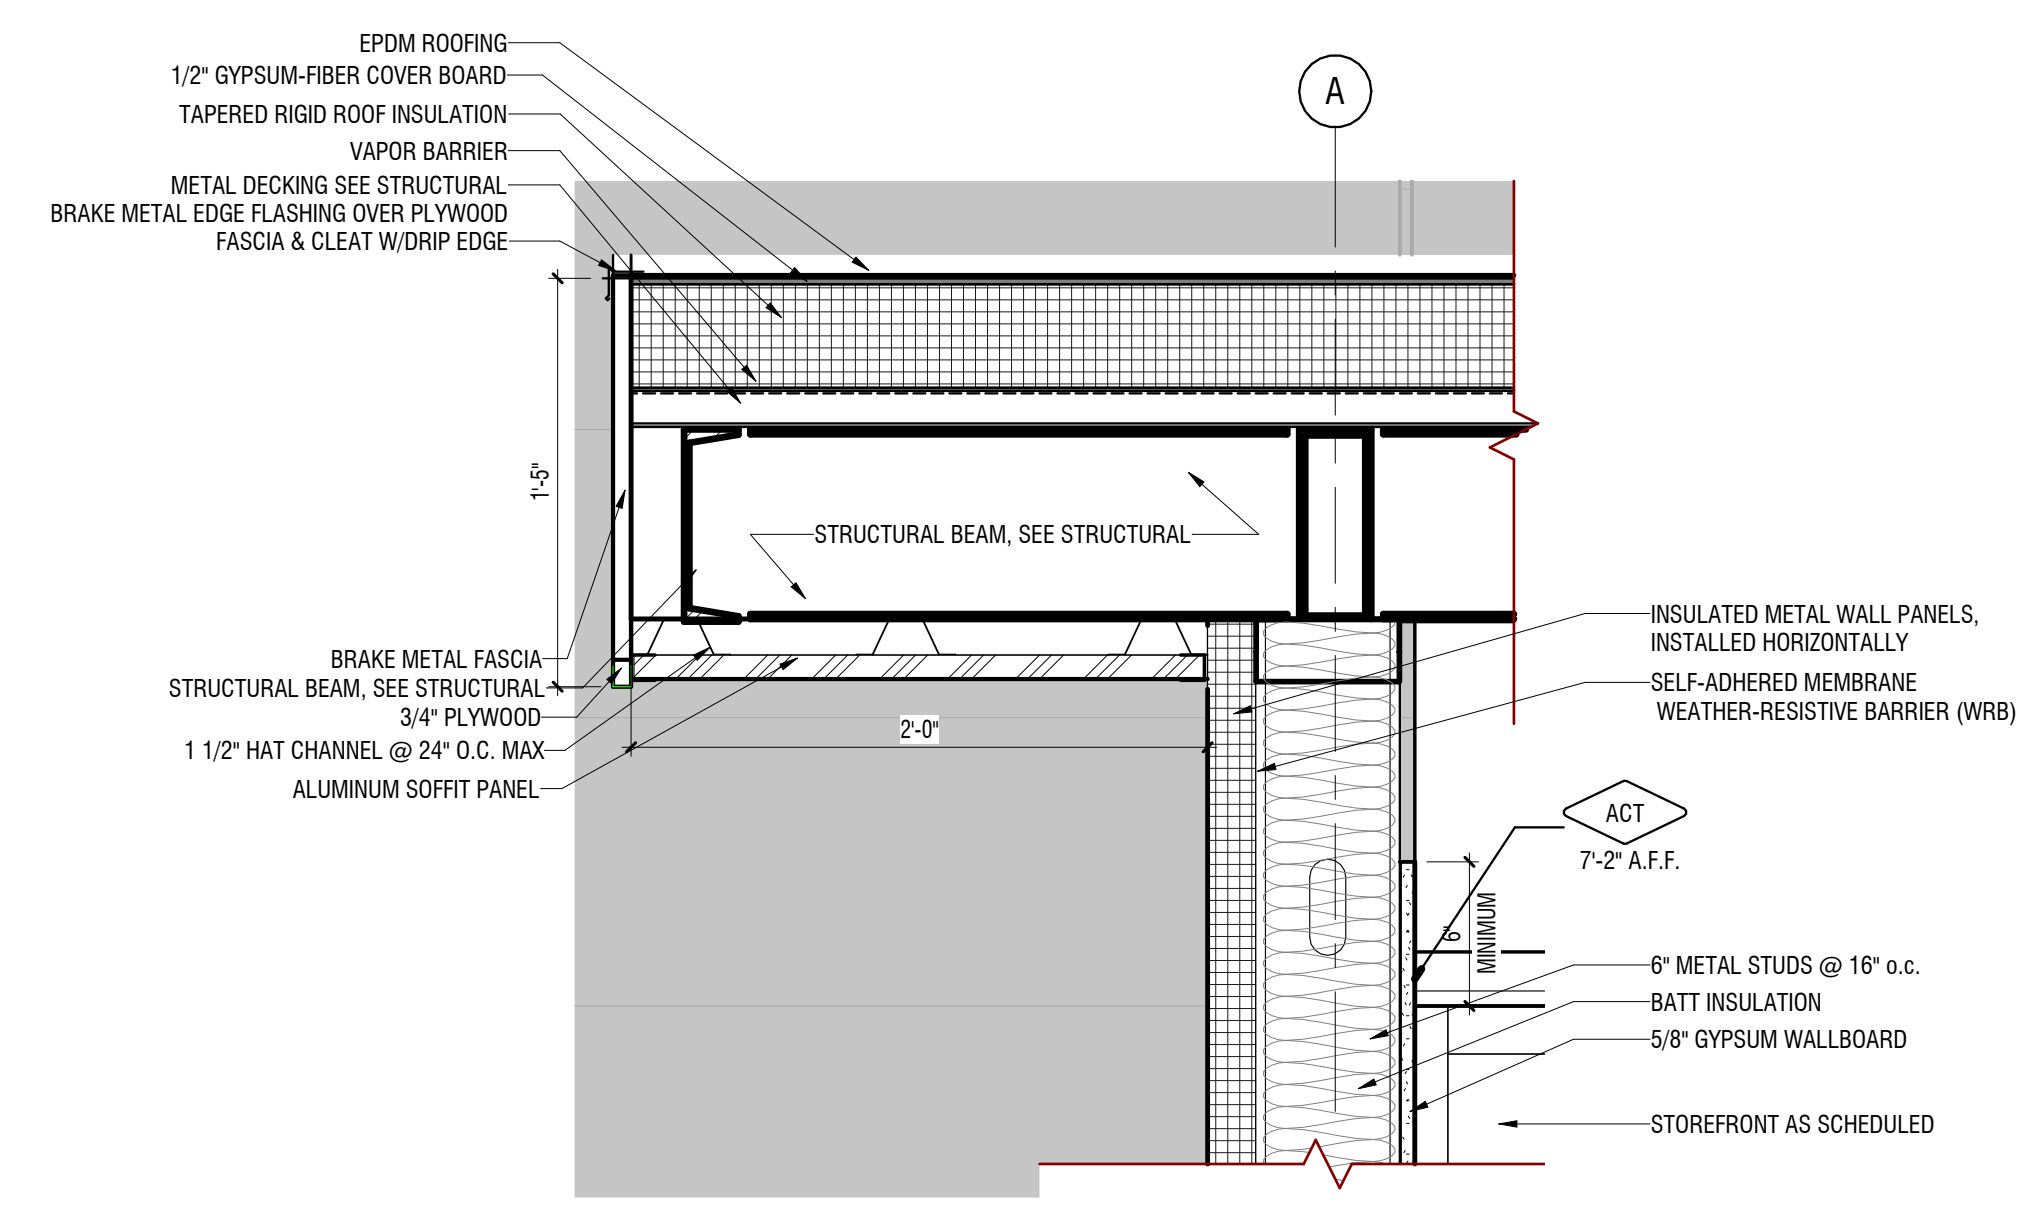


3 VESTIBULE SIDE CANOPY DETAIL
SCALE: 1 1/2" = 1'-0" SHEET: A-3.3

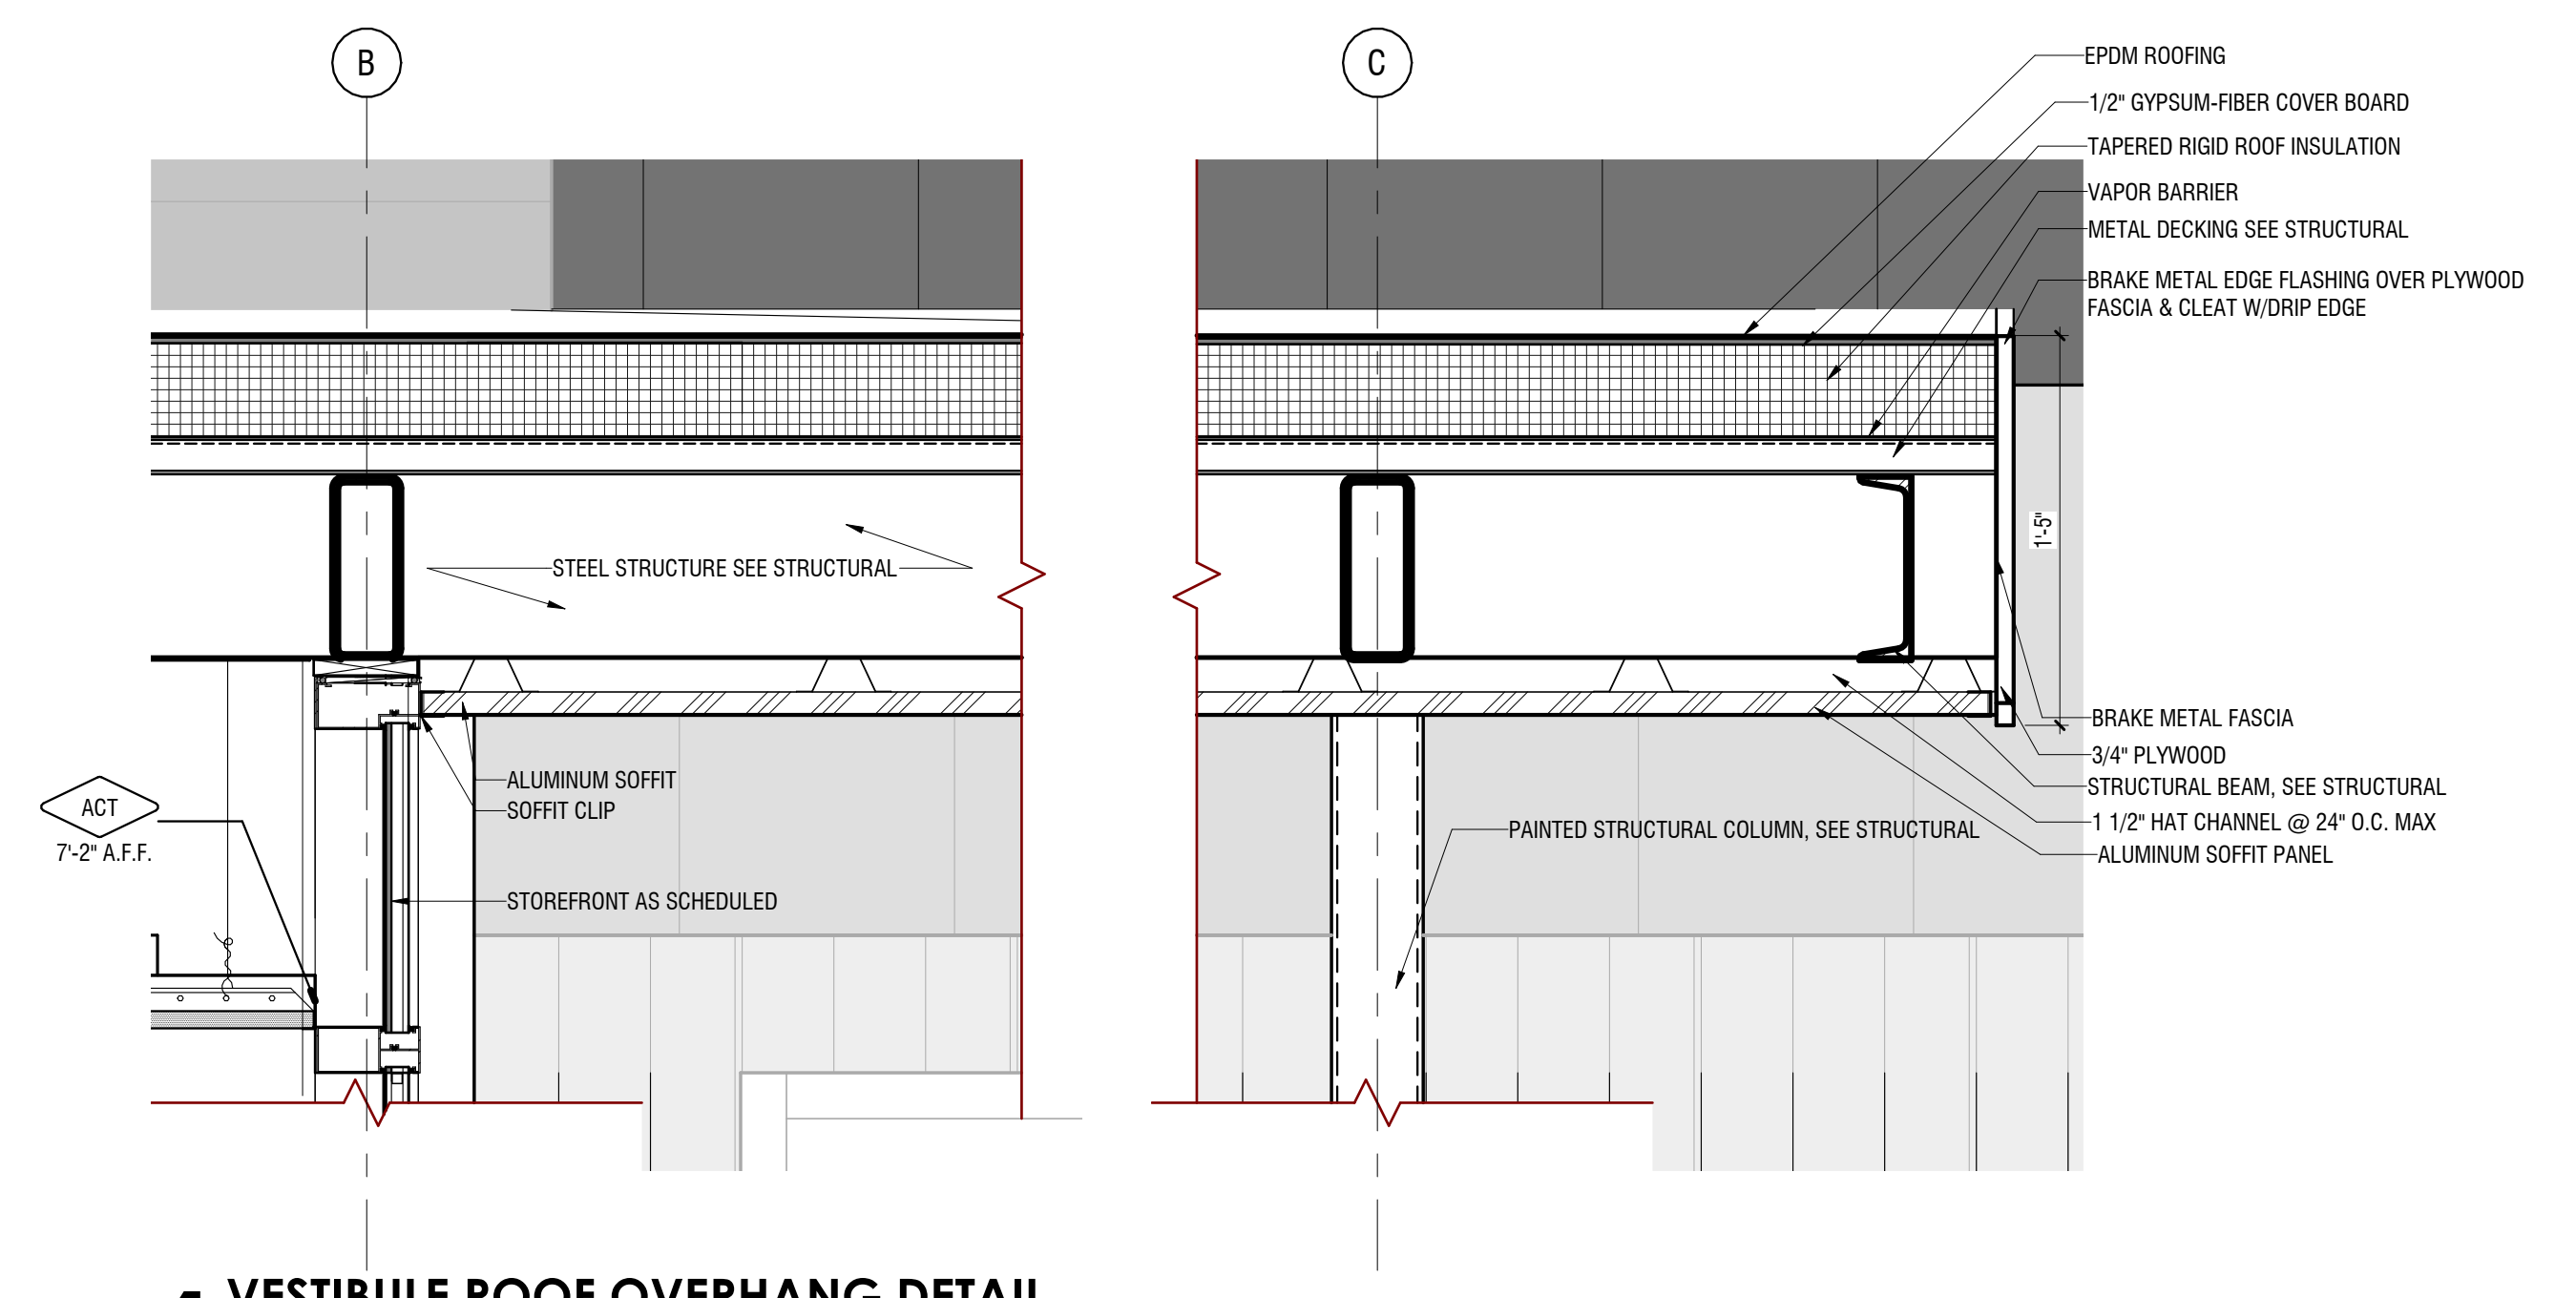


1 VESTIBULE ROOF OVERHANG DETAIL
SCALE: 1 1/2" = 1'-0" SHEET: A-3.3

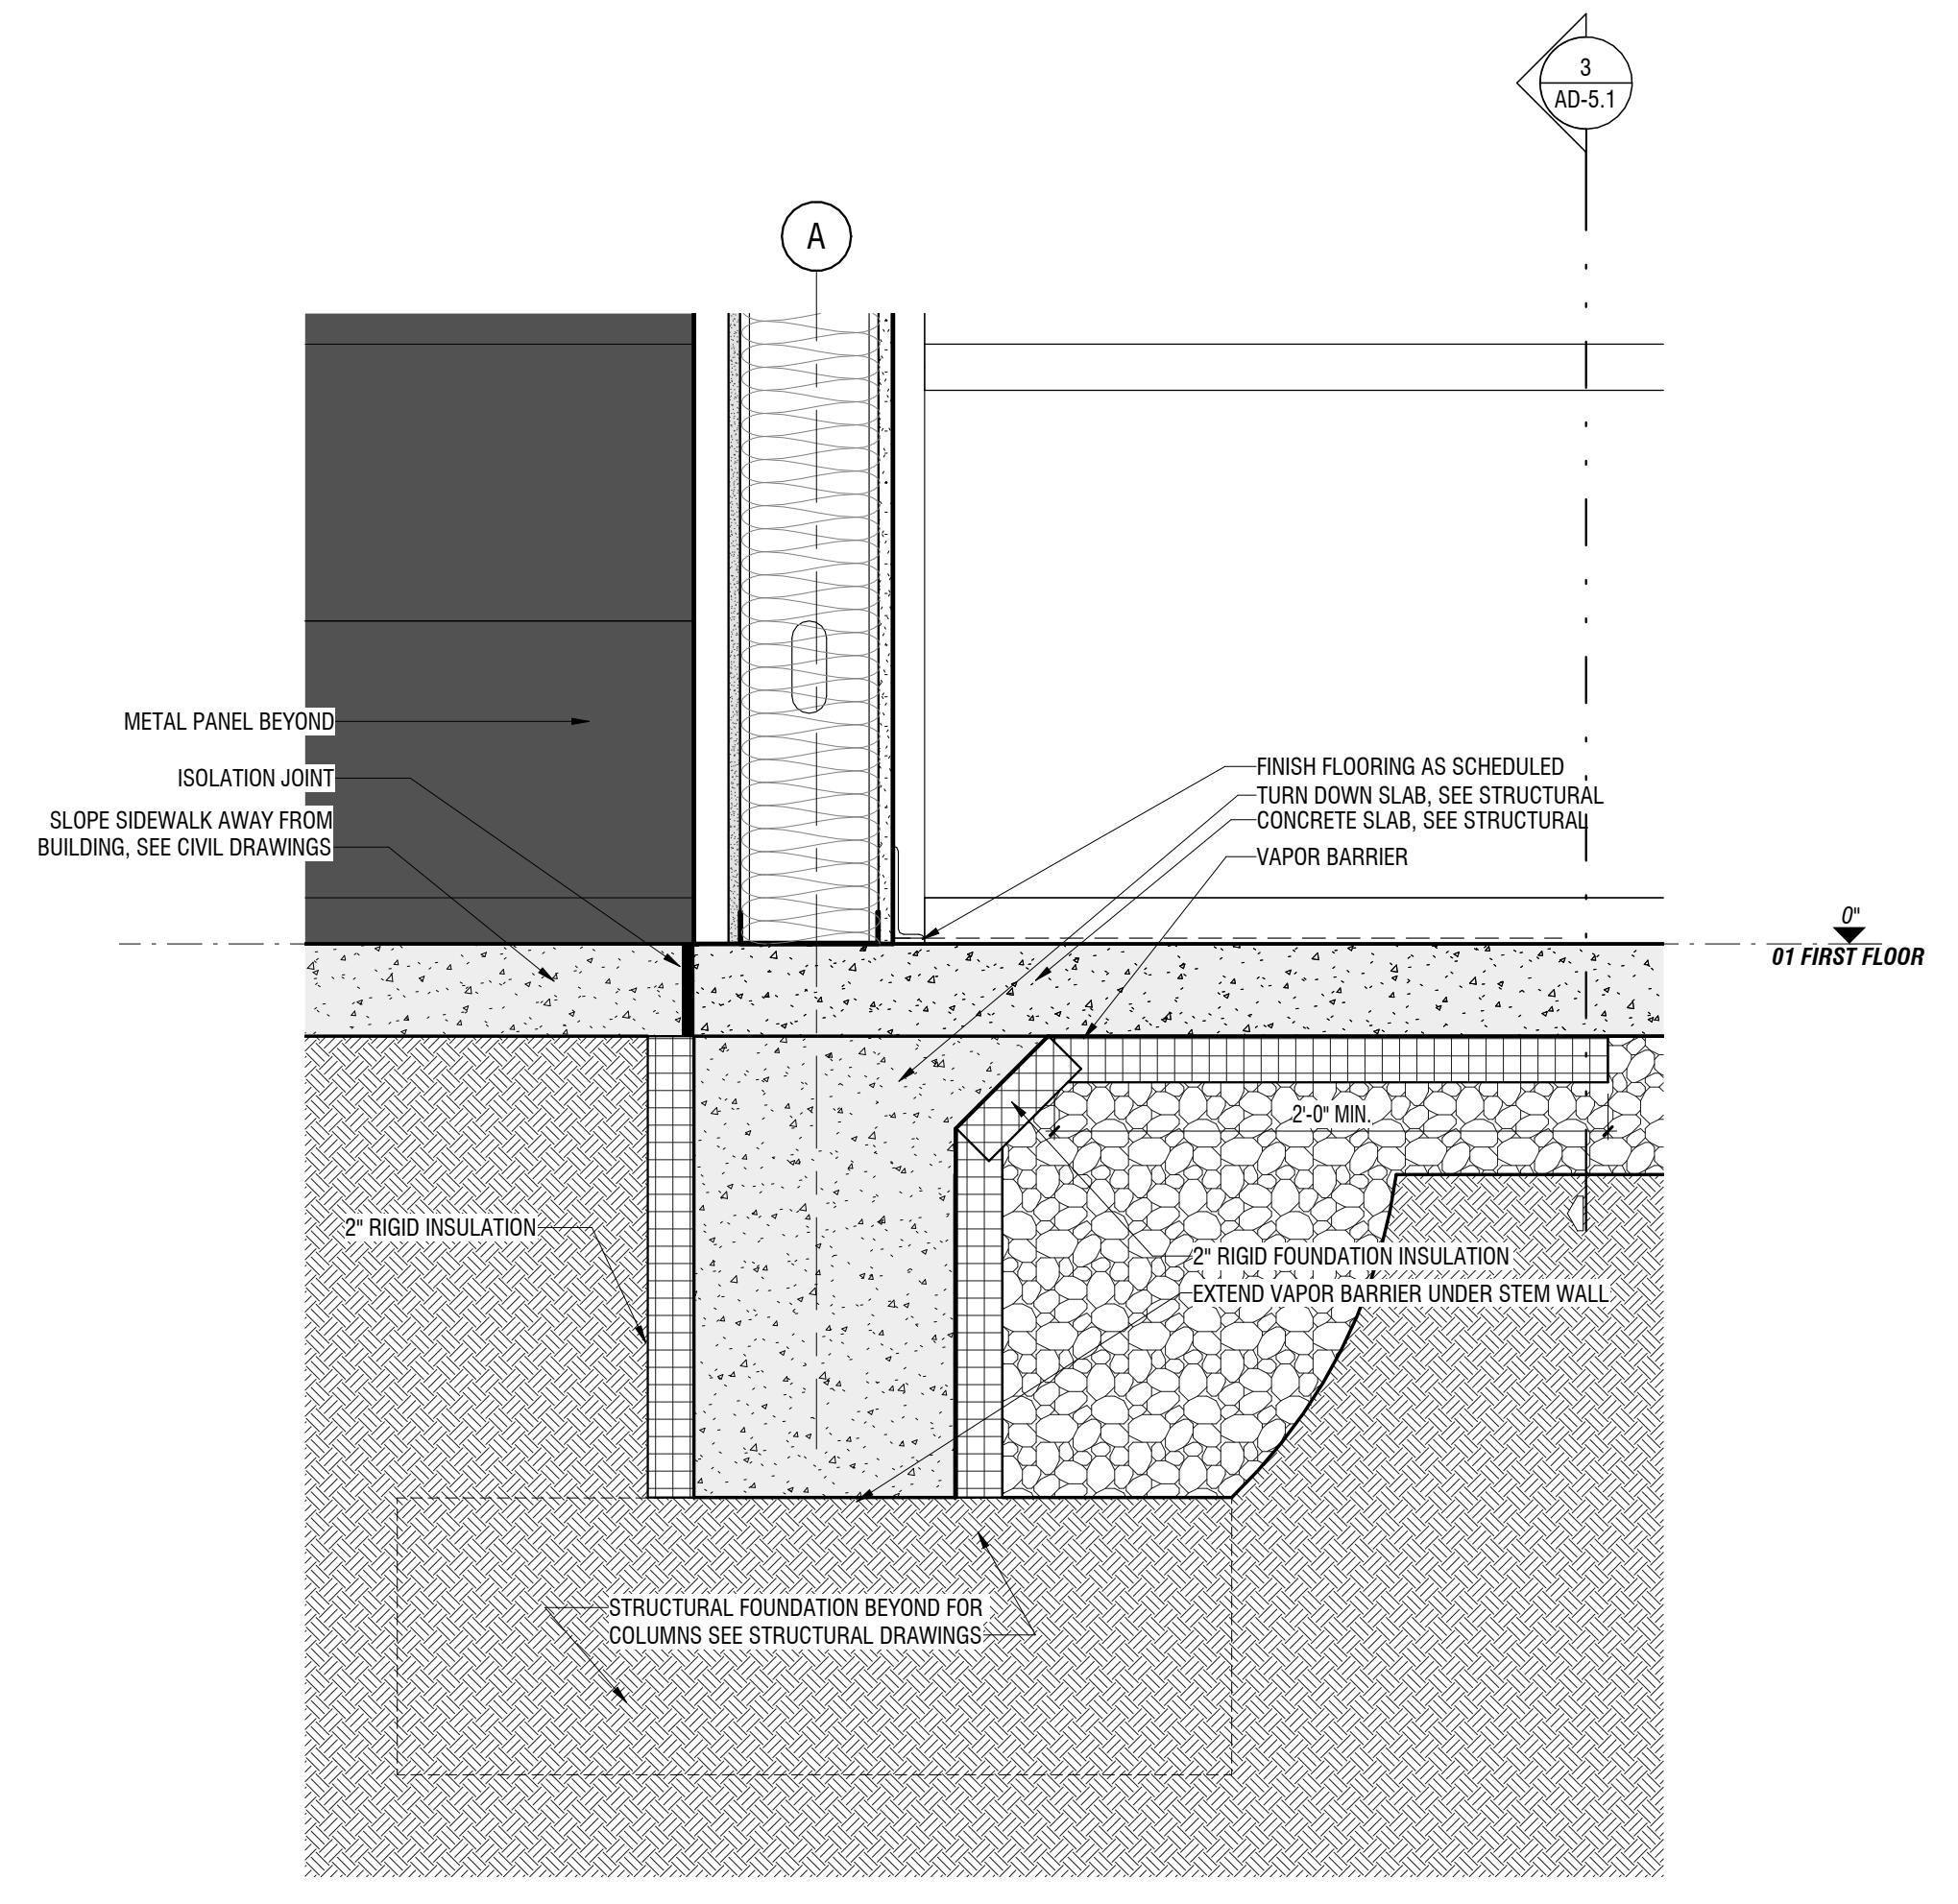


4 FOUNDATION DETAIL AT METAL STUD VESTIBULE WALL
SCALE: 1 1/2" = 1'-0" SHEET: A-3.3

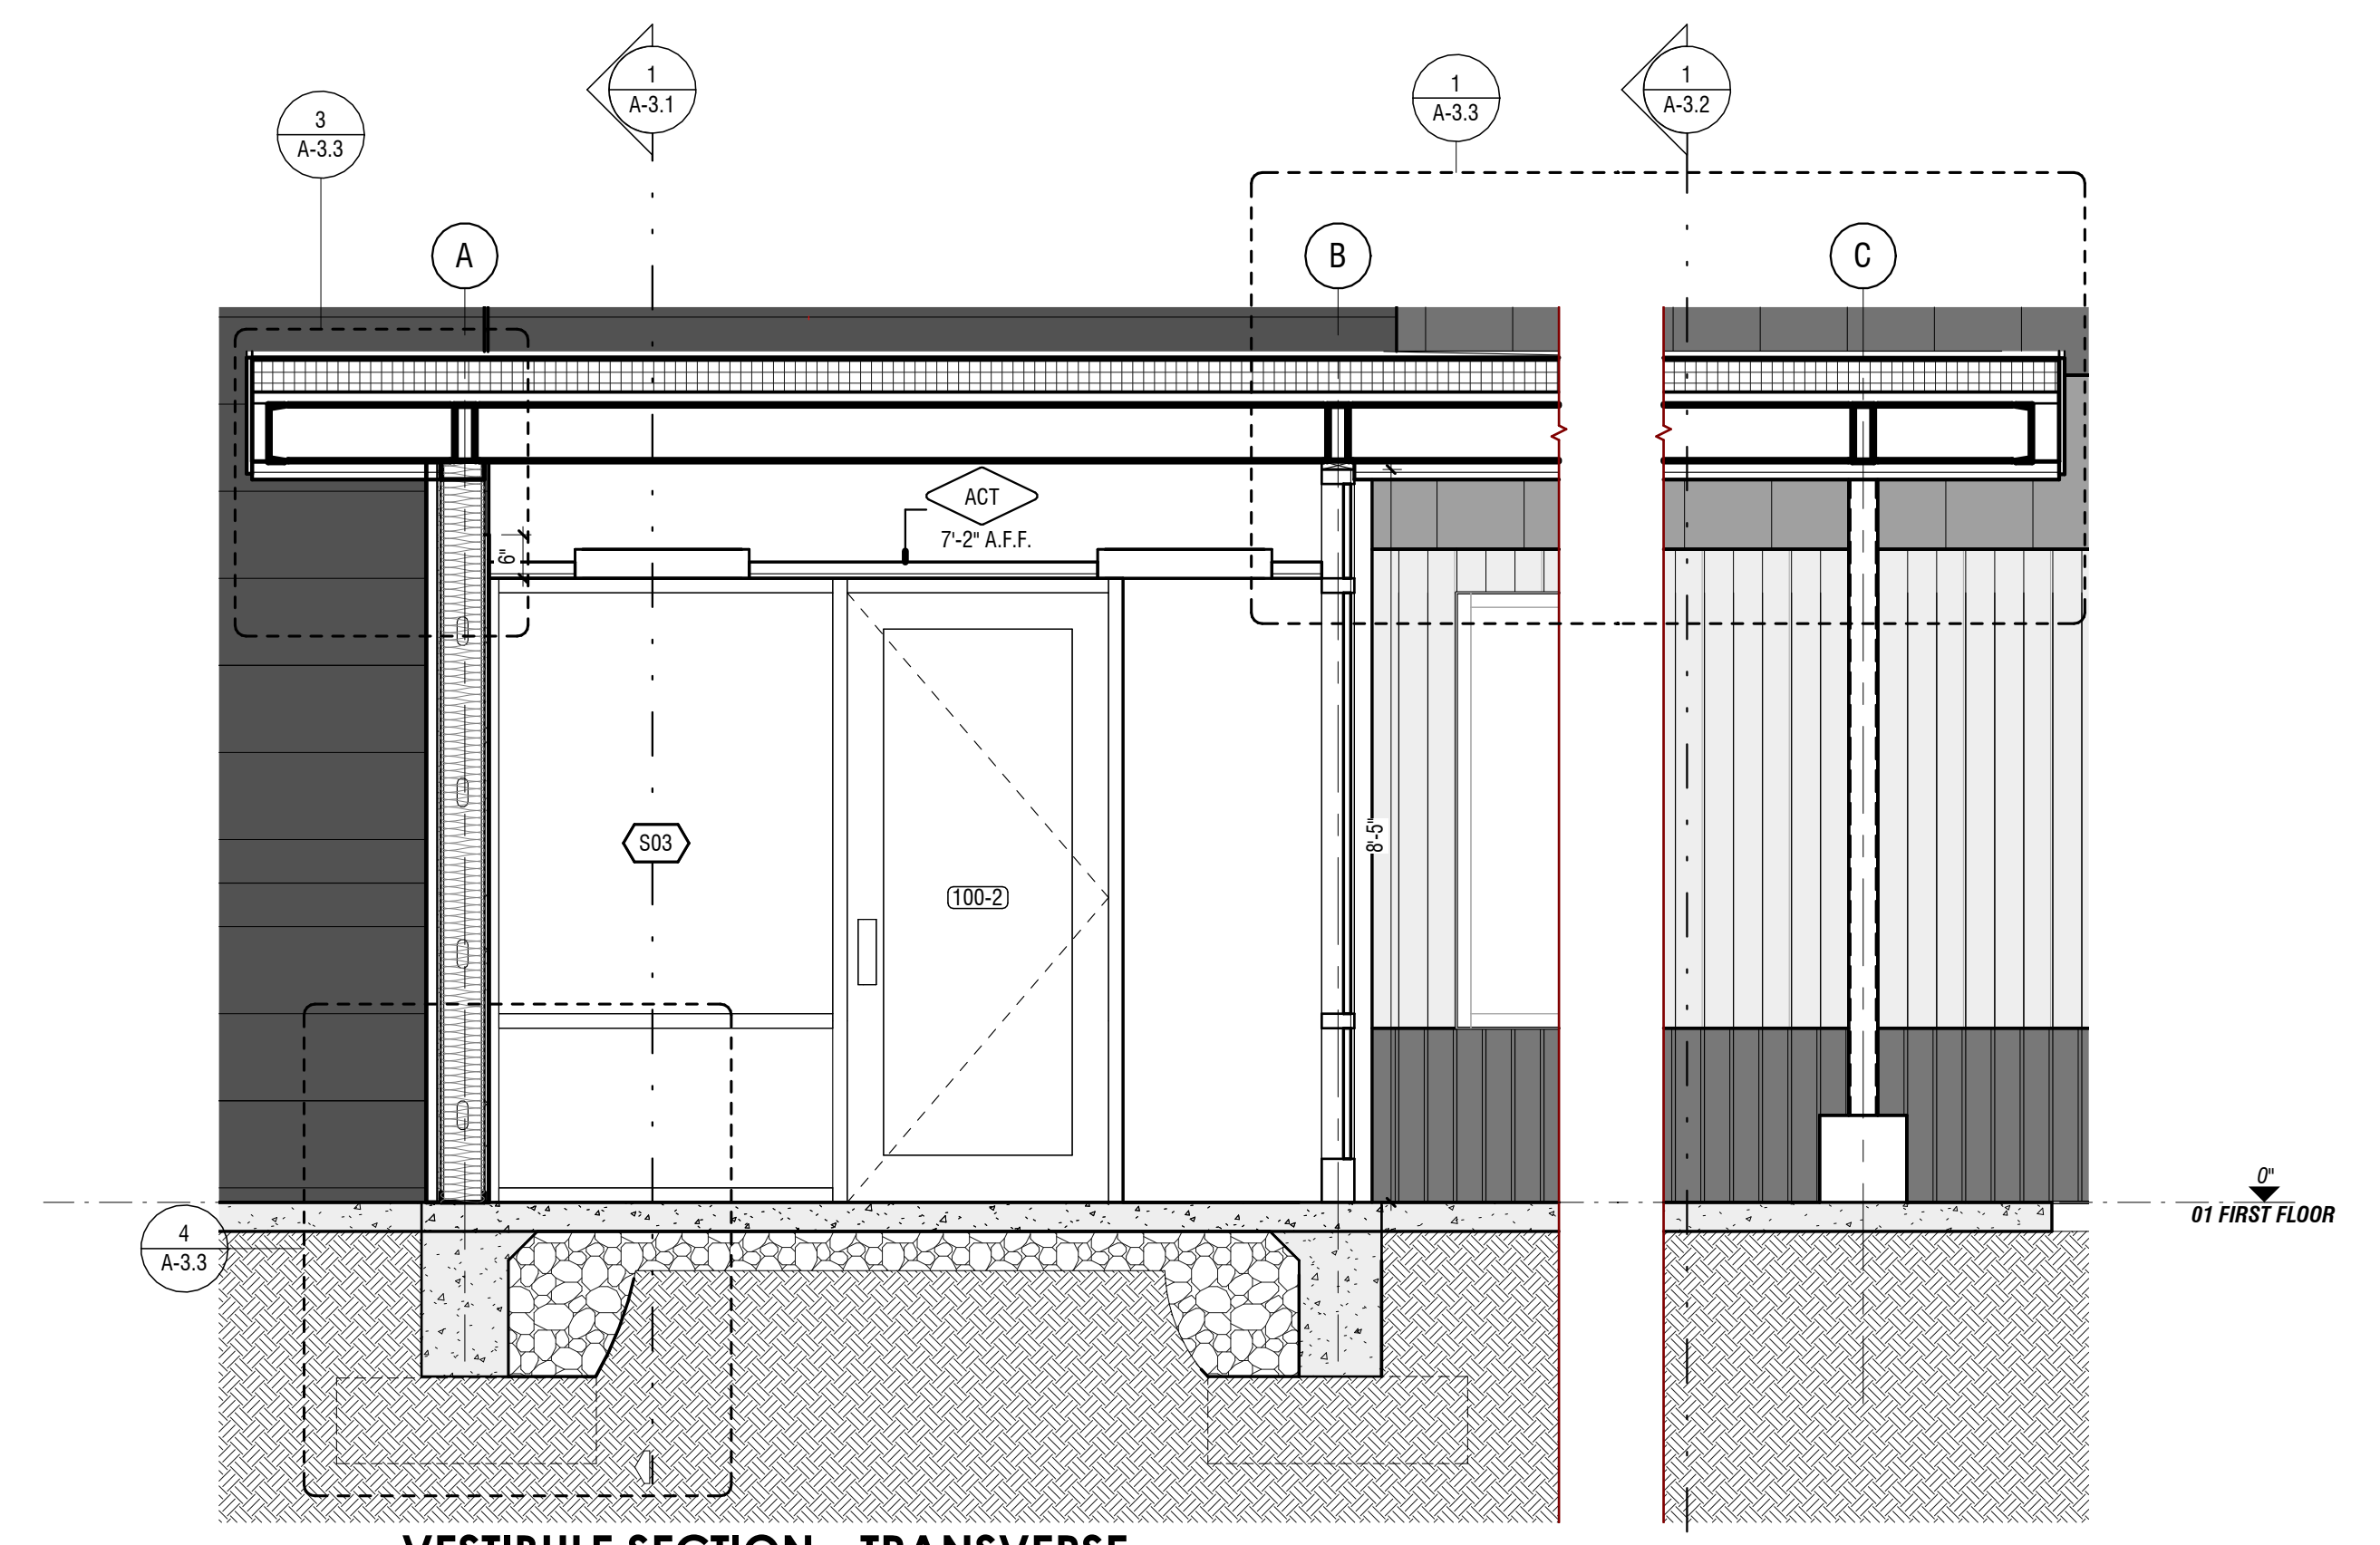


2 VESTIBULE SECTION - TRANSVERSE
SCALE: 1/2" = 1'-0" SHEET: A-3.3

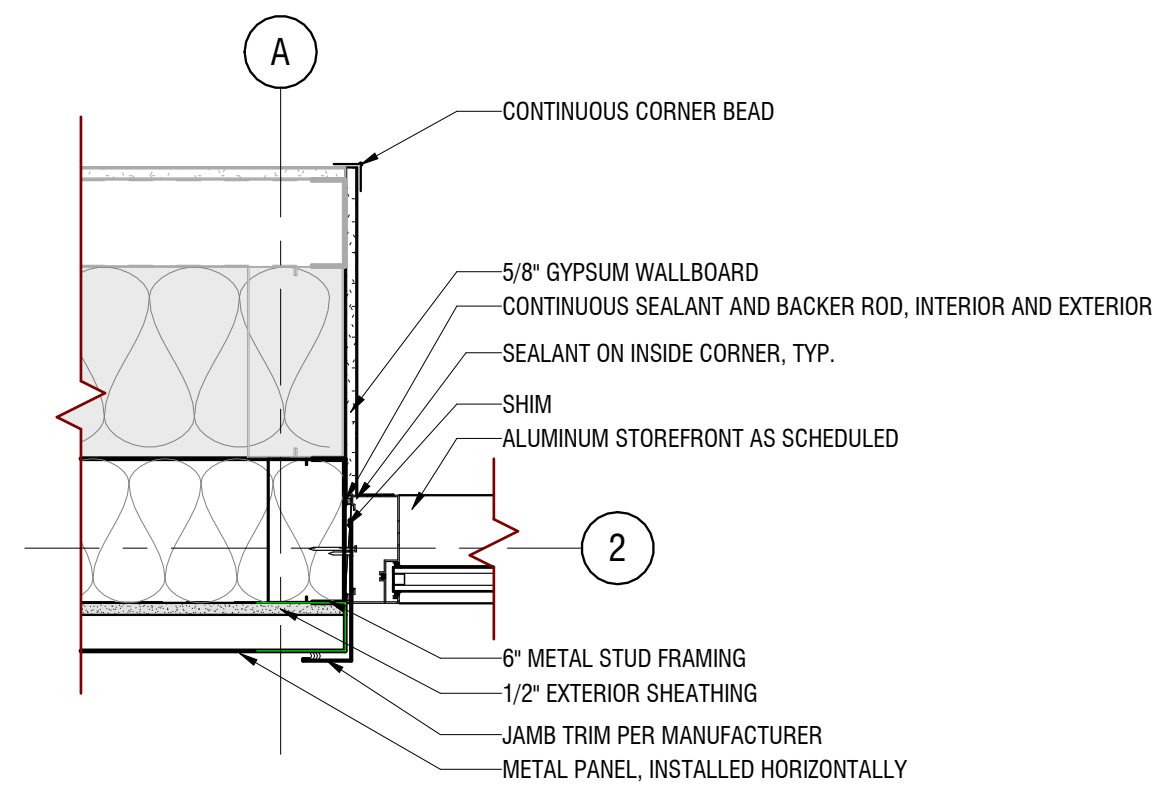


2 S05 STOREFRONT JAMB
 SCALE: 1 1/2" = 1'-0" SHEET: A-6.1

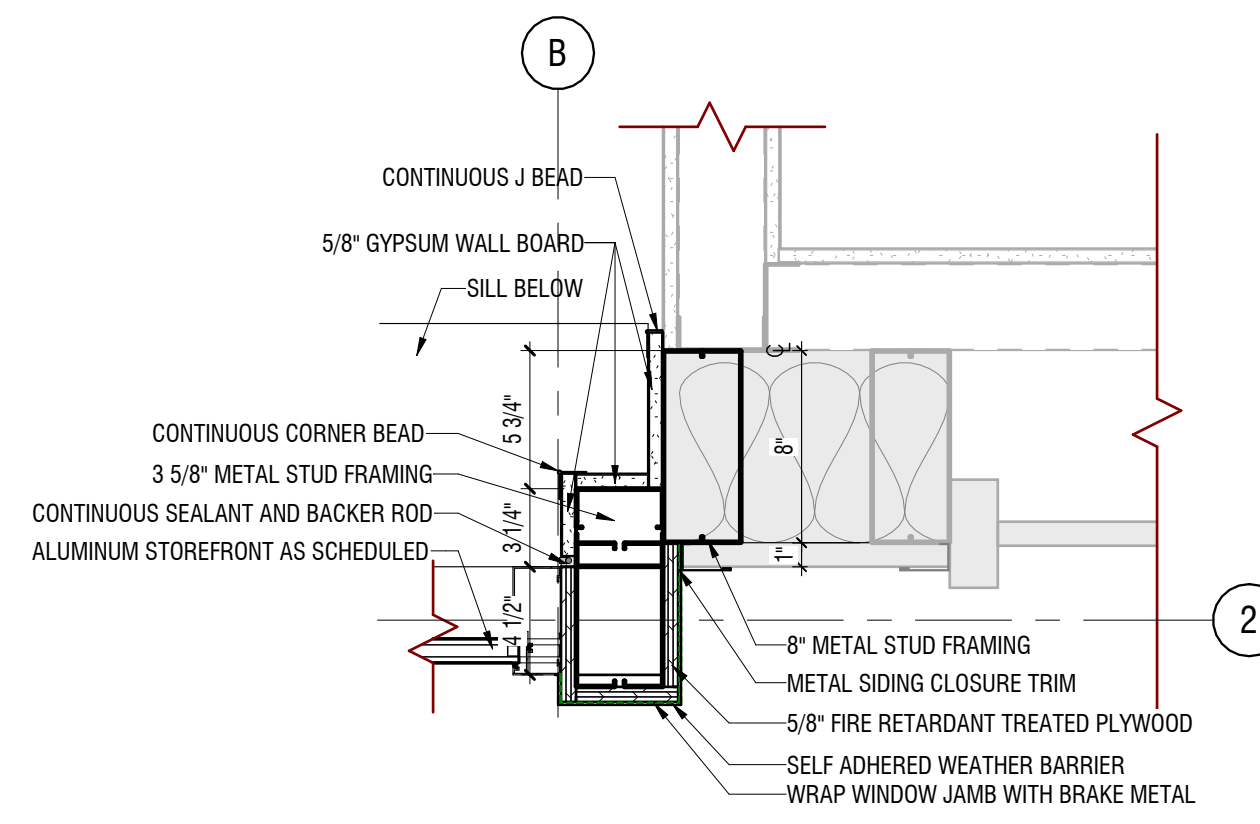


1 S05 STOREFRONT JAMB
 SCALE: 1 1/2" = 1'-0" SHEET: A-6.1

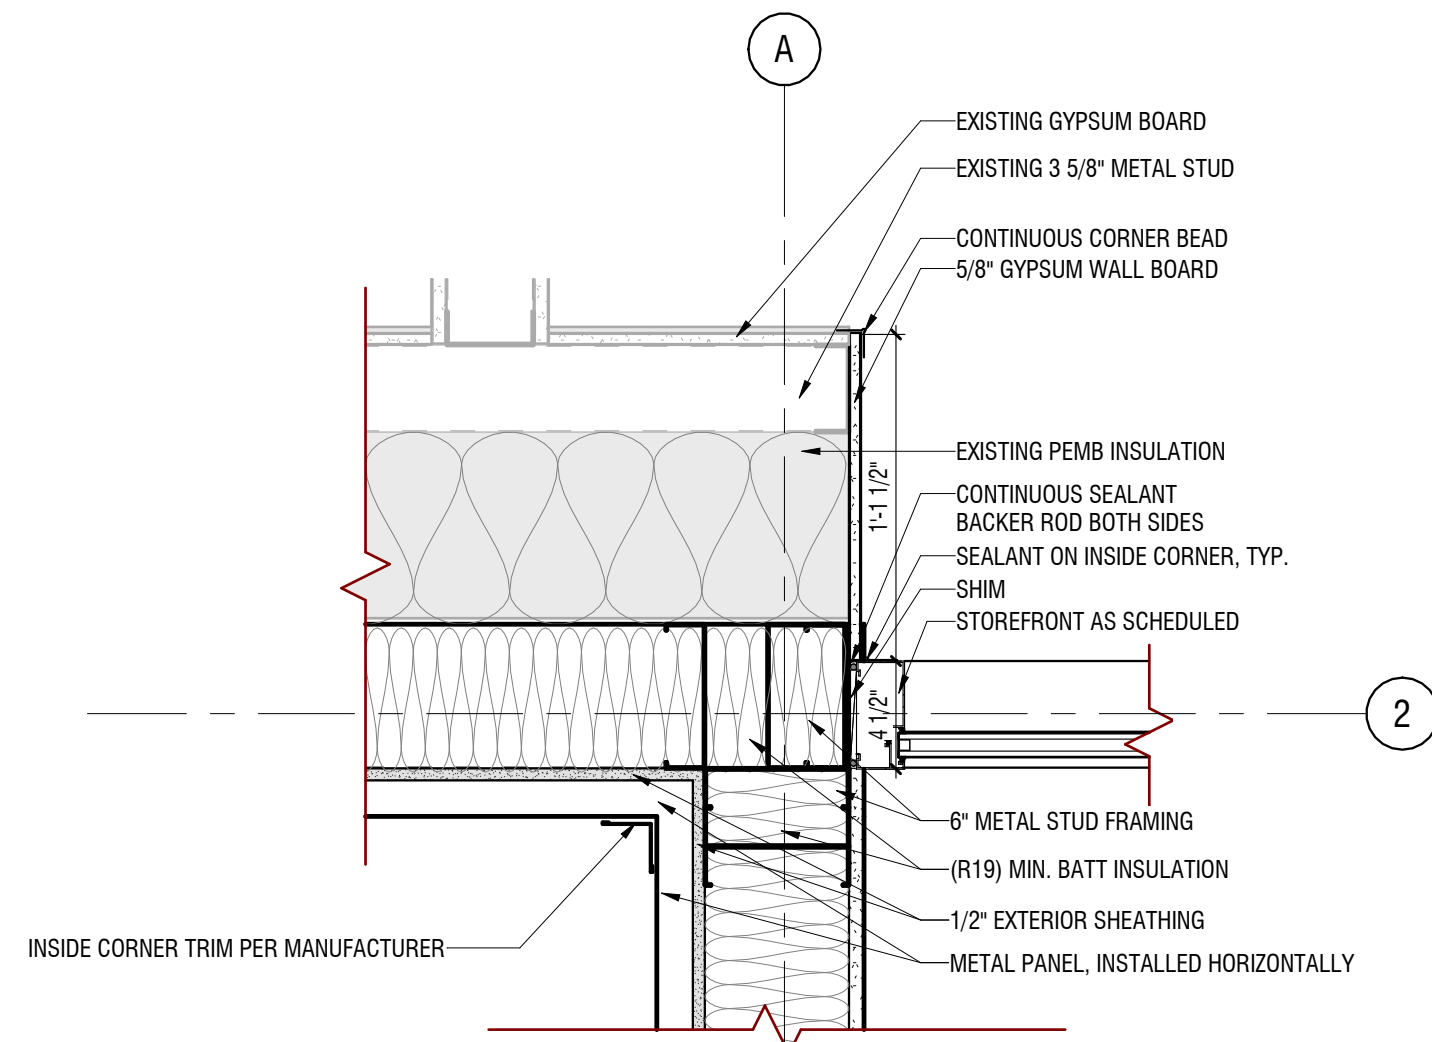


6 S03 STOREFRONT JAMB
 SCALE: 1 1/2" = 1'-0" SHEET: A-6.1

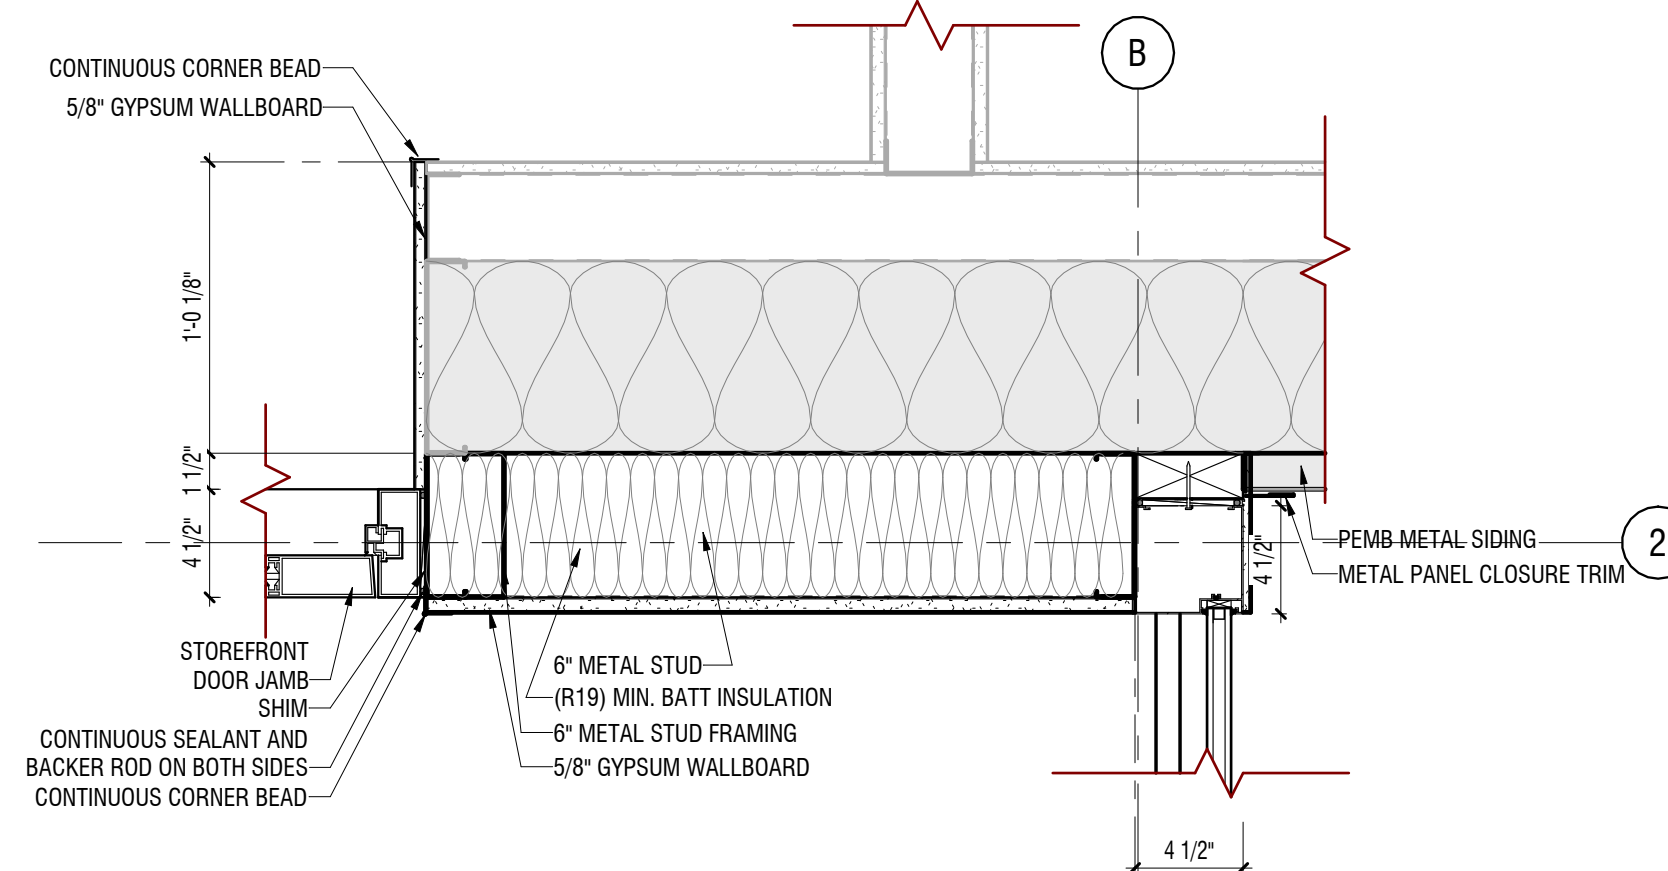


5 S03 STOREFRONT DOOR JAMB
 SCALE: 1 1/2" = 1'-0" SHEET: A-6.1

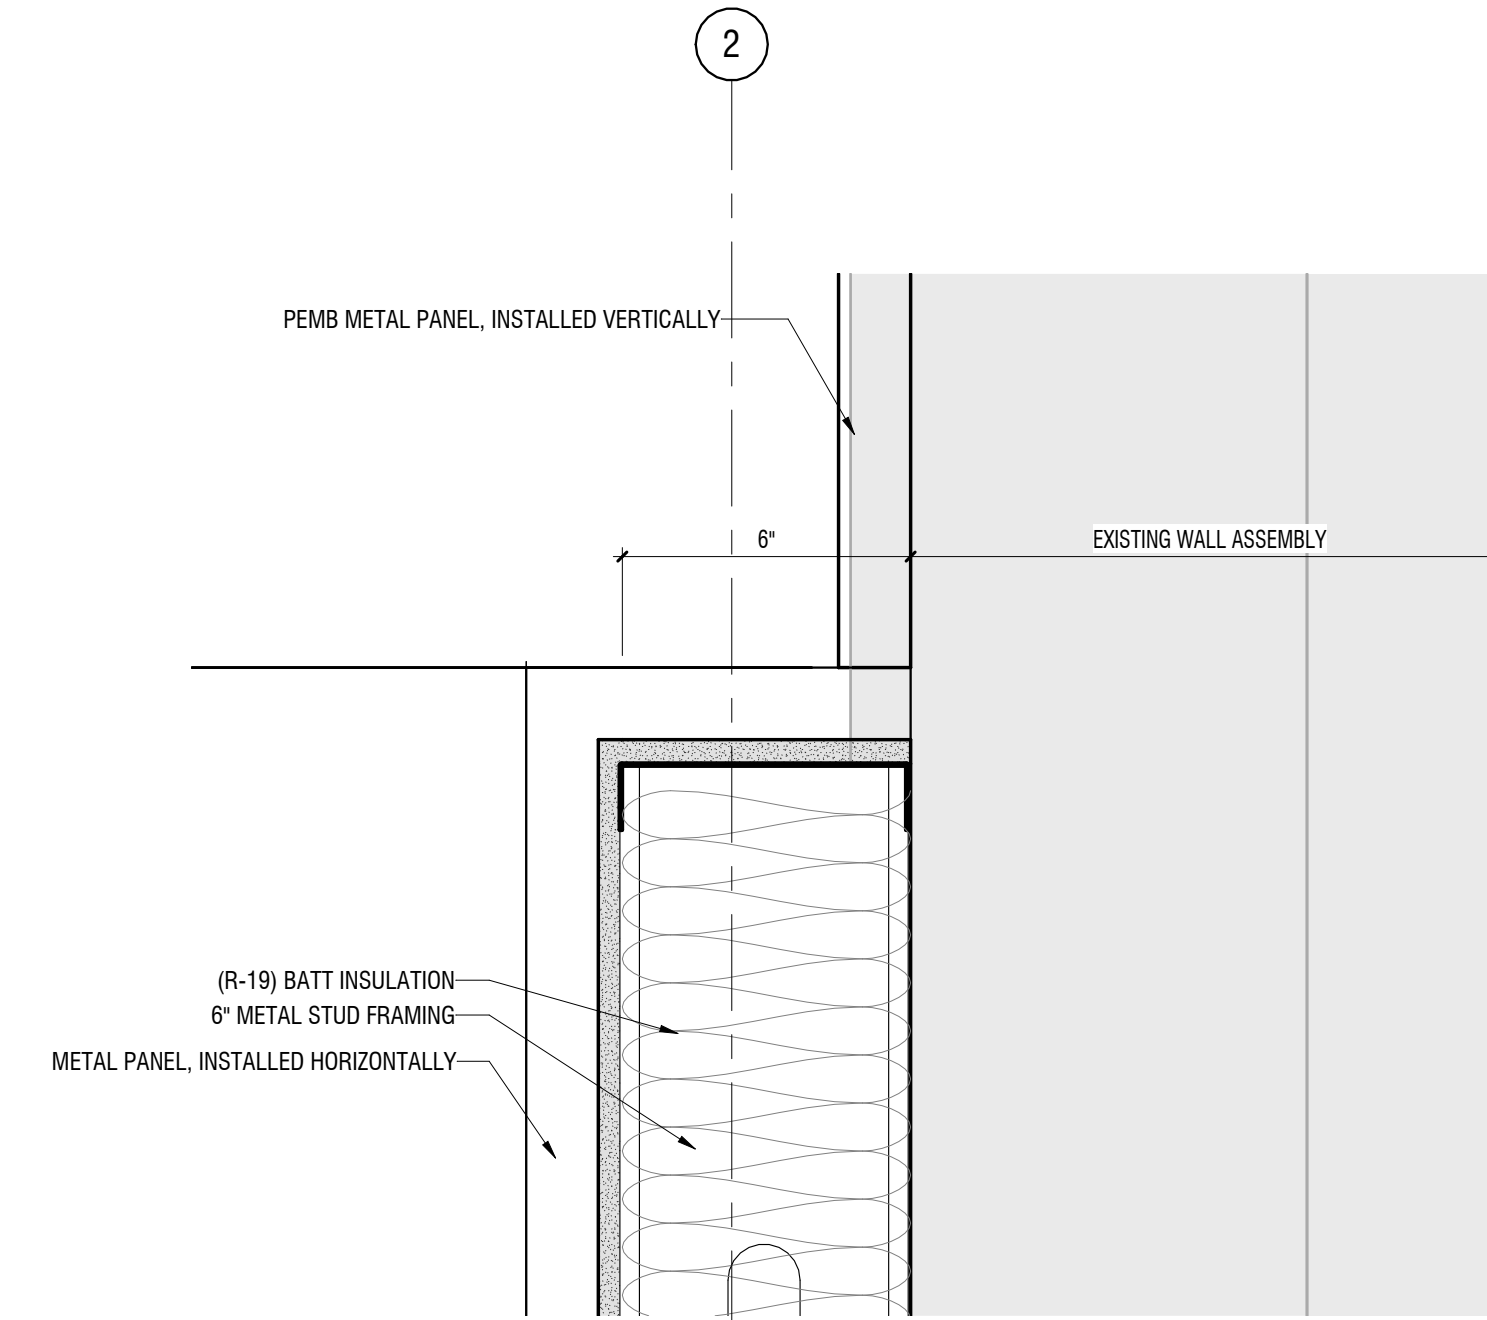


7 NEW VESTIBULE ENLARGED PLAN - STUD WALL MEETS NEW METAL SIDING
 SCALE: 3" = 1'-0" SHEET: A-6.1

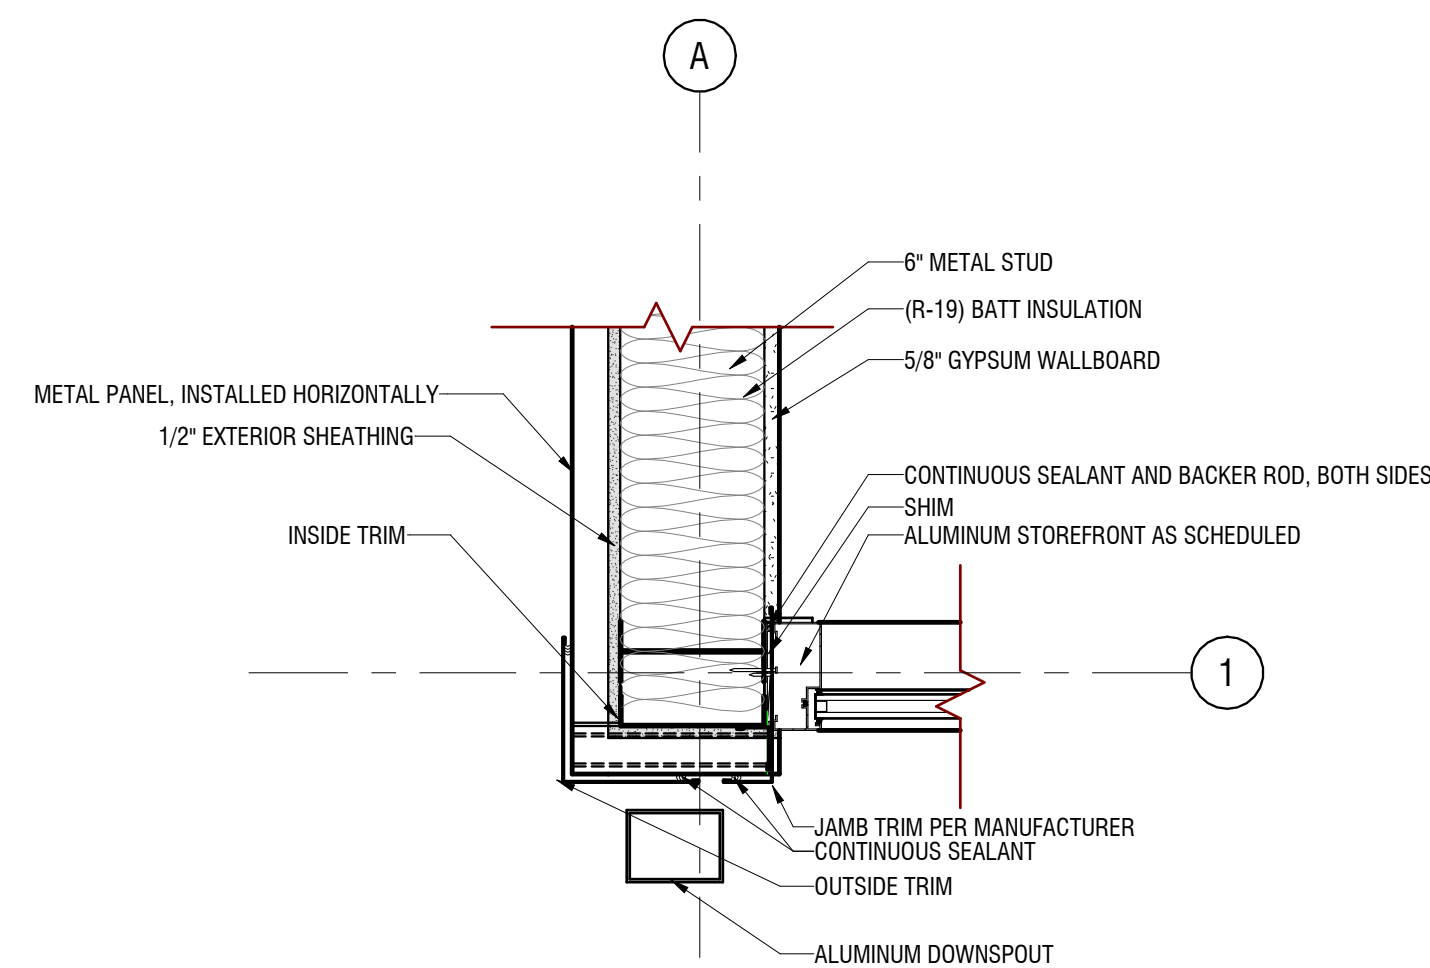

3 S01 STOREFRONT JAMB
 SCALE: 1 1/2" = 1'-0" SHEET: A-6.1

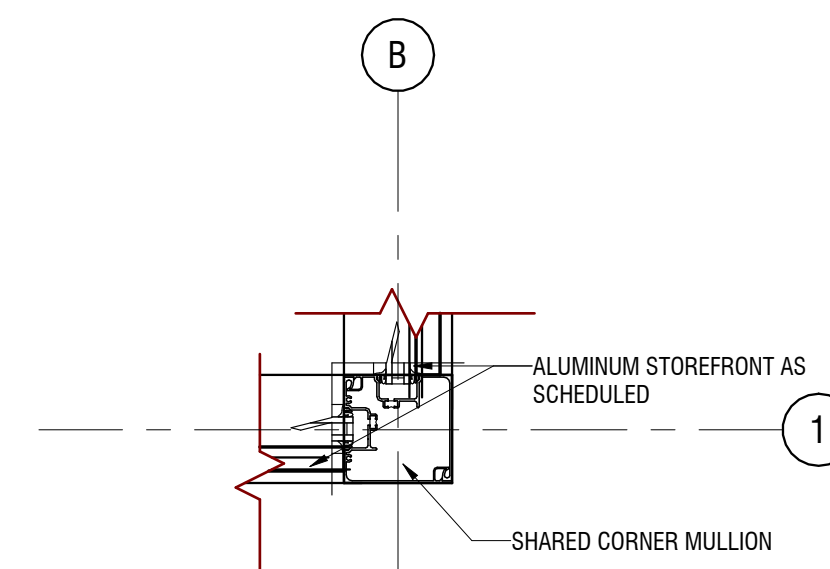


4 SQUARE CORNER MULLION DETAIL AT S01 AND S02
 SCALE: 1 1/2" = 1'-0" SHEET: A-6.1

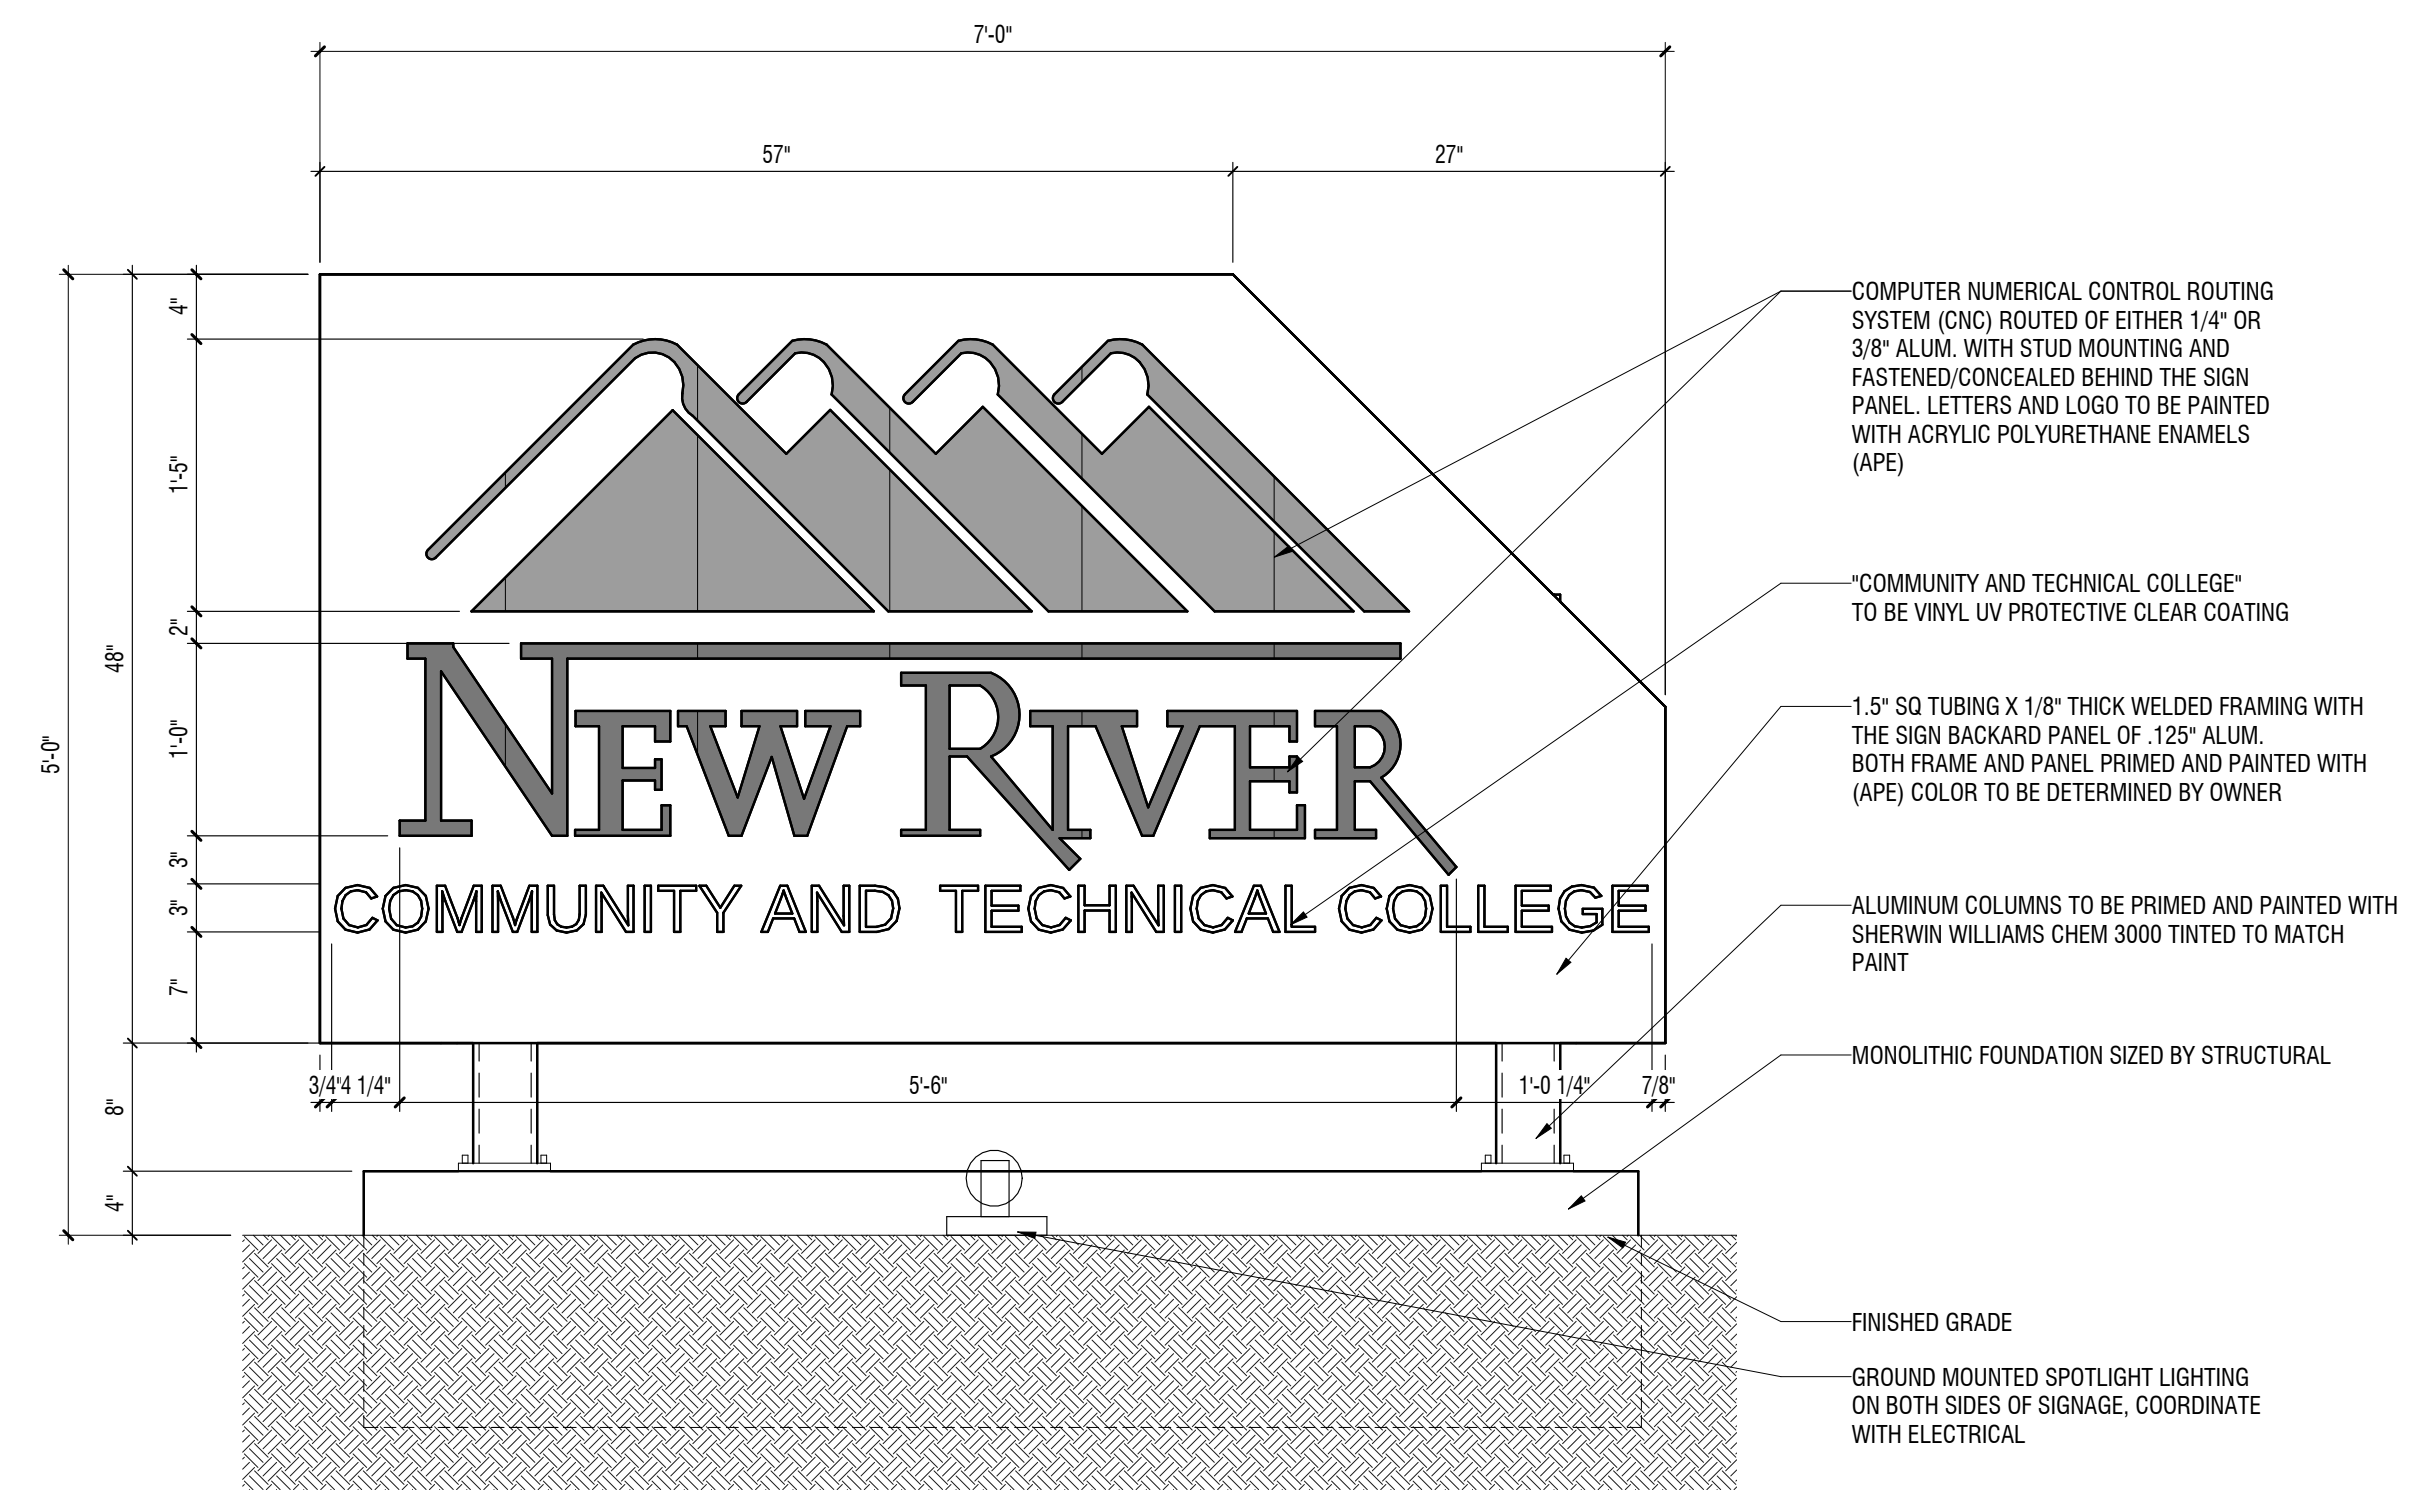

1 EXTERIOR MONUMENTAL SIGNAGE ELEVATION
 SCALE: 1" = 1'-0" SHEET: A-8.1

- NOTES:**
1. THE BACKGROUND TO BE SEAMLESS SHEET.
 2. MECHANICALLY RIVET THE BACKGROUND TO THE 1/5" SQ TUBING ALONG WITH CHEMICALLY WELDING THE PANEL TO THE FRAMING.
 3. RIVETS TO BE PLACED WHERE THEY WOULD NOT BE VISIBLE BEHIND THE LETTER.
 4. WOULD NEED PMS COLORS FOR THE ENTIRE SIGNAGE.
 5. FASTENERS TO BE STAINLESS.
 6. MECHANICAL FASTENERS FOR THE PANELS TO THE COLUMNS.
 7. BASE PLATES AND BOLTS TO NEW FOUNDATION.
 8. HALOPHANE TYPE GROUND FLOOD LIGHTING A POSSIBLE CONSIDERATION.

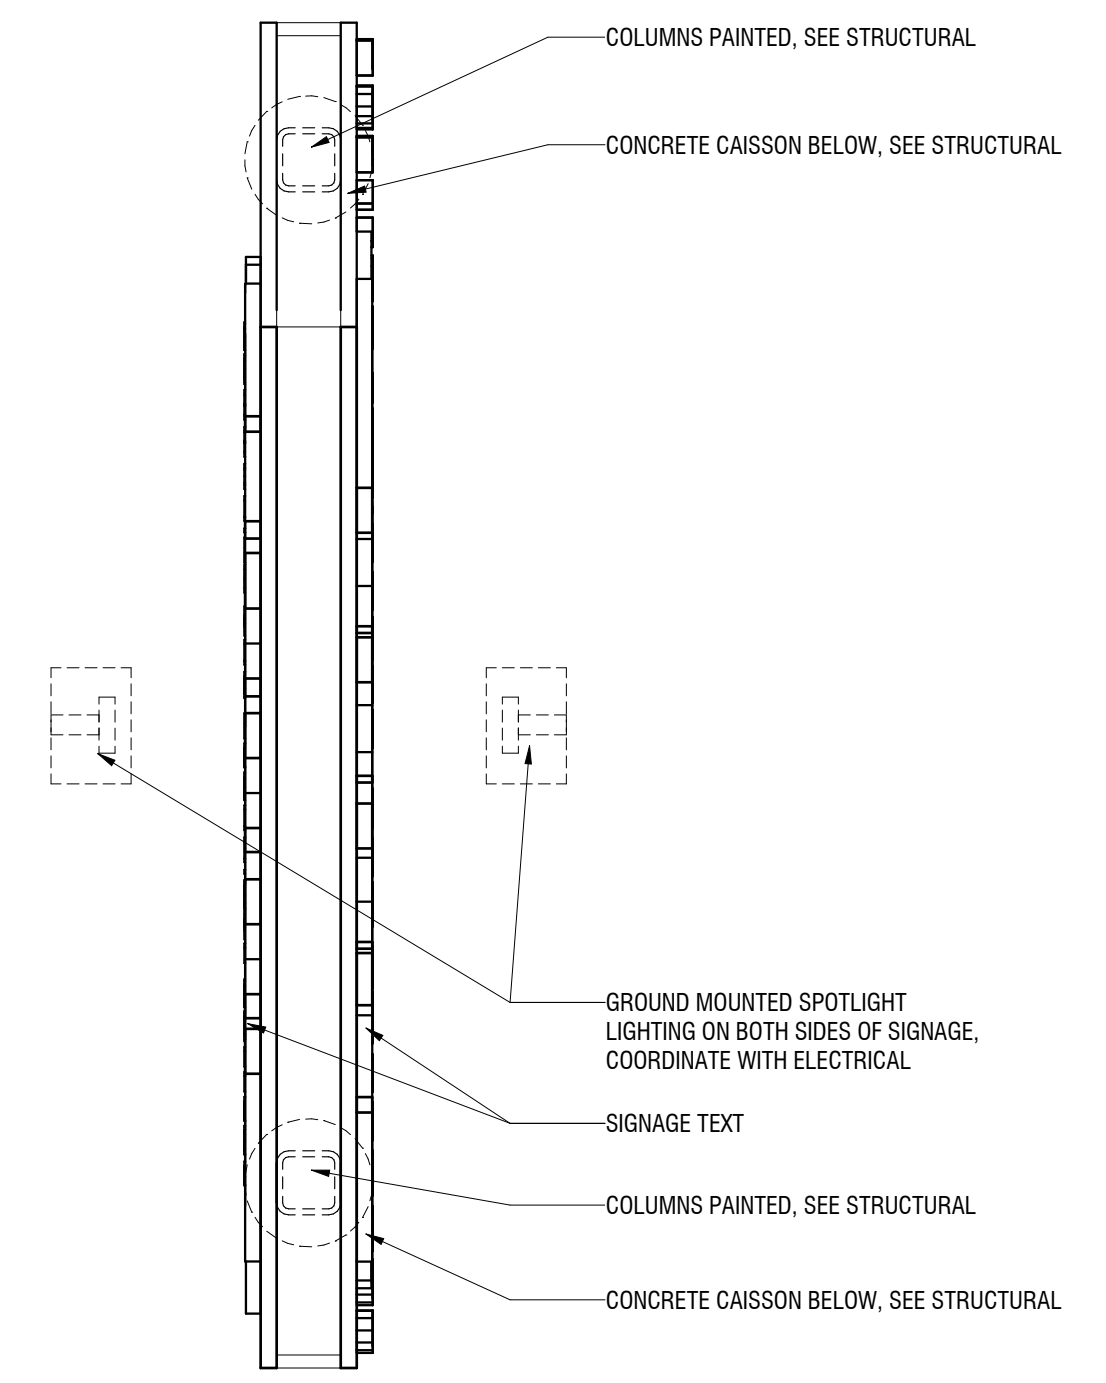

2 EXTERIOR SIGNAGE PLAN
 SCALE: 1" = 1'-0" SHEET: A-8.1


ATC RENOVATION
 NEW RIVER COMMUNITY & TECHNICAL COLLEGE
 527 Odd Rd.
 Ghent, WV 25843



OMNI ARCHITECTS

A-8.1


EXTERIOR SIGNAGE - ALTERNATE #02

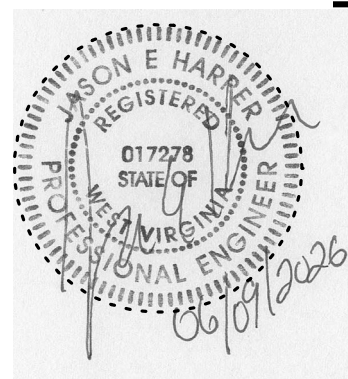

BID DOCUMENTS
06.09.2026

| MECHANICAL LEGEND | |
|---|--|
| SYMBOL | DESCRIPTION |
| | CIRCUIT SETTER (GPM INDICATED ON PLANS) |
| | ROUND FLEXIBLE DUCT (ONLY @ DIFFUSER CONNECTION) |
| | FIRE DAMPER |
| | MANUAL BALANCING DAMPER |
| | SUPPLY DUCT RISER |
| | RETURN OR OUTSIDE AIR DUCT RISER |
| | EXHAUST AIR DUCT RISER |
| | DUCT SIZE INSIDE DIMENSIONS - 24"W x 10"D |
| | DUCT SIZE - 10" DIAMETER |
| | THERMOSTAT |
| | HUMIDISTAT |
| | CONNECT TO EXISTING |
| WG | WIRE GUARD |
| (EX) | EXISTING |
| | DUCT MOUNT SMOKE DETECTOR |
| LS | LOOP SUPPLY PIPING |
| LR | LOOP RETURN PIPING |
| DIFFUSER SYMBOL-SEE SCHEDULE NECK SIZE DESIGN CUBIC FEET PER MINUTE OF AIR QUANTITY FOR ROOM OR SPACE | |
| ABBREVIATIONS | |
| AFF | ABOVE FINISHED FLOOR |
| BFF | BELOW FINISHED FLOOR |
| BTU | BRITISH THERMAL UNIT |
| DN | DOWN |
| GC | GENERAL CONTRACTOR |
| GPM | GALLON PER MINUTE |
| NTS | NOT TO SCALE |
| PC | PLUMBING CONTRACTOR |
| (TYP) | TYPICAL |
| VTR | VENT THRU ROOF |
| W | WITH |
| WG | WIRE GUARD |
| WP | WEATHER PROOF |

- ### GENERAL MECHANICAL NOTES
- PROVIDE ALL MATERIALS AND EQUIPMENT AND PERFORM ALL LABOR REQUIRED TO INSTALL COMPLETE AND OPERABLE HVAC SYSTEM AS INDICATED ON THE DRAWINGS, AS SPECIFIED AND AS REQUIRED BY CODE.
 - CERTAIN ITEMS SUCH AS RISES AND DROPS IN DUCTWORK, ACCESS DOORS, VOLUME DAMPERS, ETC., ARE INDICATED FOR CLARITY IN CERTAIN AREAS. THIS DOES NOT RELIEVE THE CONTRACTOR OF PROVIDED THESE ITEMS NOT SHOWN IN OTHER AREAS AS REQUIRED FOR A COMPLETE INSTALLATION.
 - REFER TO CLASSROOM CONTROL PANEL DETAIL FOR MOUNTING HEIGHT OF CO2 SENSOR, HUMIDITY SENSOR, AND TEMPERATURE SENSOR.
 - ALL DUCTWORK SHALL CLEAR DOORS AND WINDOWS.
 - ALL DUCTWORK DIMENSIONS, AS SHOWN ON DRAWINGS, ARE INTERNAL CLEAR DIMENSIONS. DUCT SIZE SHALL BE INCREASED IN SIZE TO COMPENSATE FOR INTERNAL LININGS.
 - COORDINATE DIFFUSER, REGISTER, AND GRILLE LOCATIONS WITH ARCHITECTURAL PLANS, LIGHTING, AND OTHER ITEMS LOCATED IN CEILING.
 - LOCATE ALL MECHANICAL EQUIPMENT FOR UNOBSTRUCTED ACCESS TO UNIT ACCESS PANELS, CONTROLS, AND VALVING.
 - PROVIDE FLEXIBLE CONNECTIONS IN ALL DUCTWORK SYSTEMS CONNECTED TO AIR HANDLING UNITS, RTU, EXHAUST FANS, AND OTHER EQUIPMENT THAT REQUIRE VIBRATION ISOLATION. FLEXIBLE CONNECTIONS SHALL BE PROVIDED AT THE POINT OF CONNECTION UNLESS NOTED OTHERWISE.
 - RUNS OF FLEXIBLE DUCTWORK SHALL NOT EXCEED 5 FEET.
 - ALL DUCTWORK SHALL BE COORDINATED WITH OTHER TRADES. OFFSETS AND TRANSITIONS SHALL BE PROVIDED AT NO ADDITIONAL COST TO THE OWNER.
 - PROVIDE ACCESS DOORS IN DUCTWORK WHERE REQUIRED.
 - ALL DUCTS SHALL BE GROUNDED ACROSS FLEXIBLE CONNECTIONS WITH FLEXIBLE COPPER GROUNDING STRAPS.
 - SMOKE DETECTORS SHALL BE FURNISHED AND WIRED BY THE ELECTRICAL CONTRACTOR. THE MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE FOR MOUNTING THE SMOKE DETECTOR IN THE DUCTWORK.
 - CONTROL RELAYS SHALL BE WIRED BY THE ELECTRICAL CONTRACTOR. MECHANICAL CONTRACTOR SHALL BE RESPONSIBLE FOR FURNISHING AND MOUNTING THE RELAY IN THE EQUIPMENT.
 - TURNING VANES SHALL BE INSTALLED IN ALL RECTANGULAR DUCT ELBOWS THAT EXCEED 45° CHANGE IN DIRECTION.
 - INSTALL 1" DUCTLINER IN FIRST 15' OF ALL RETURN AIR DUCTS.

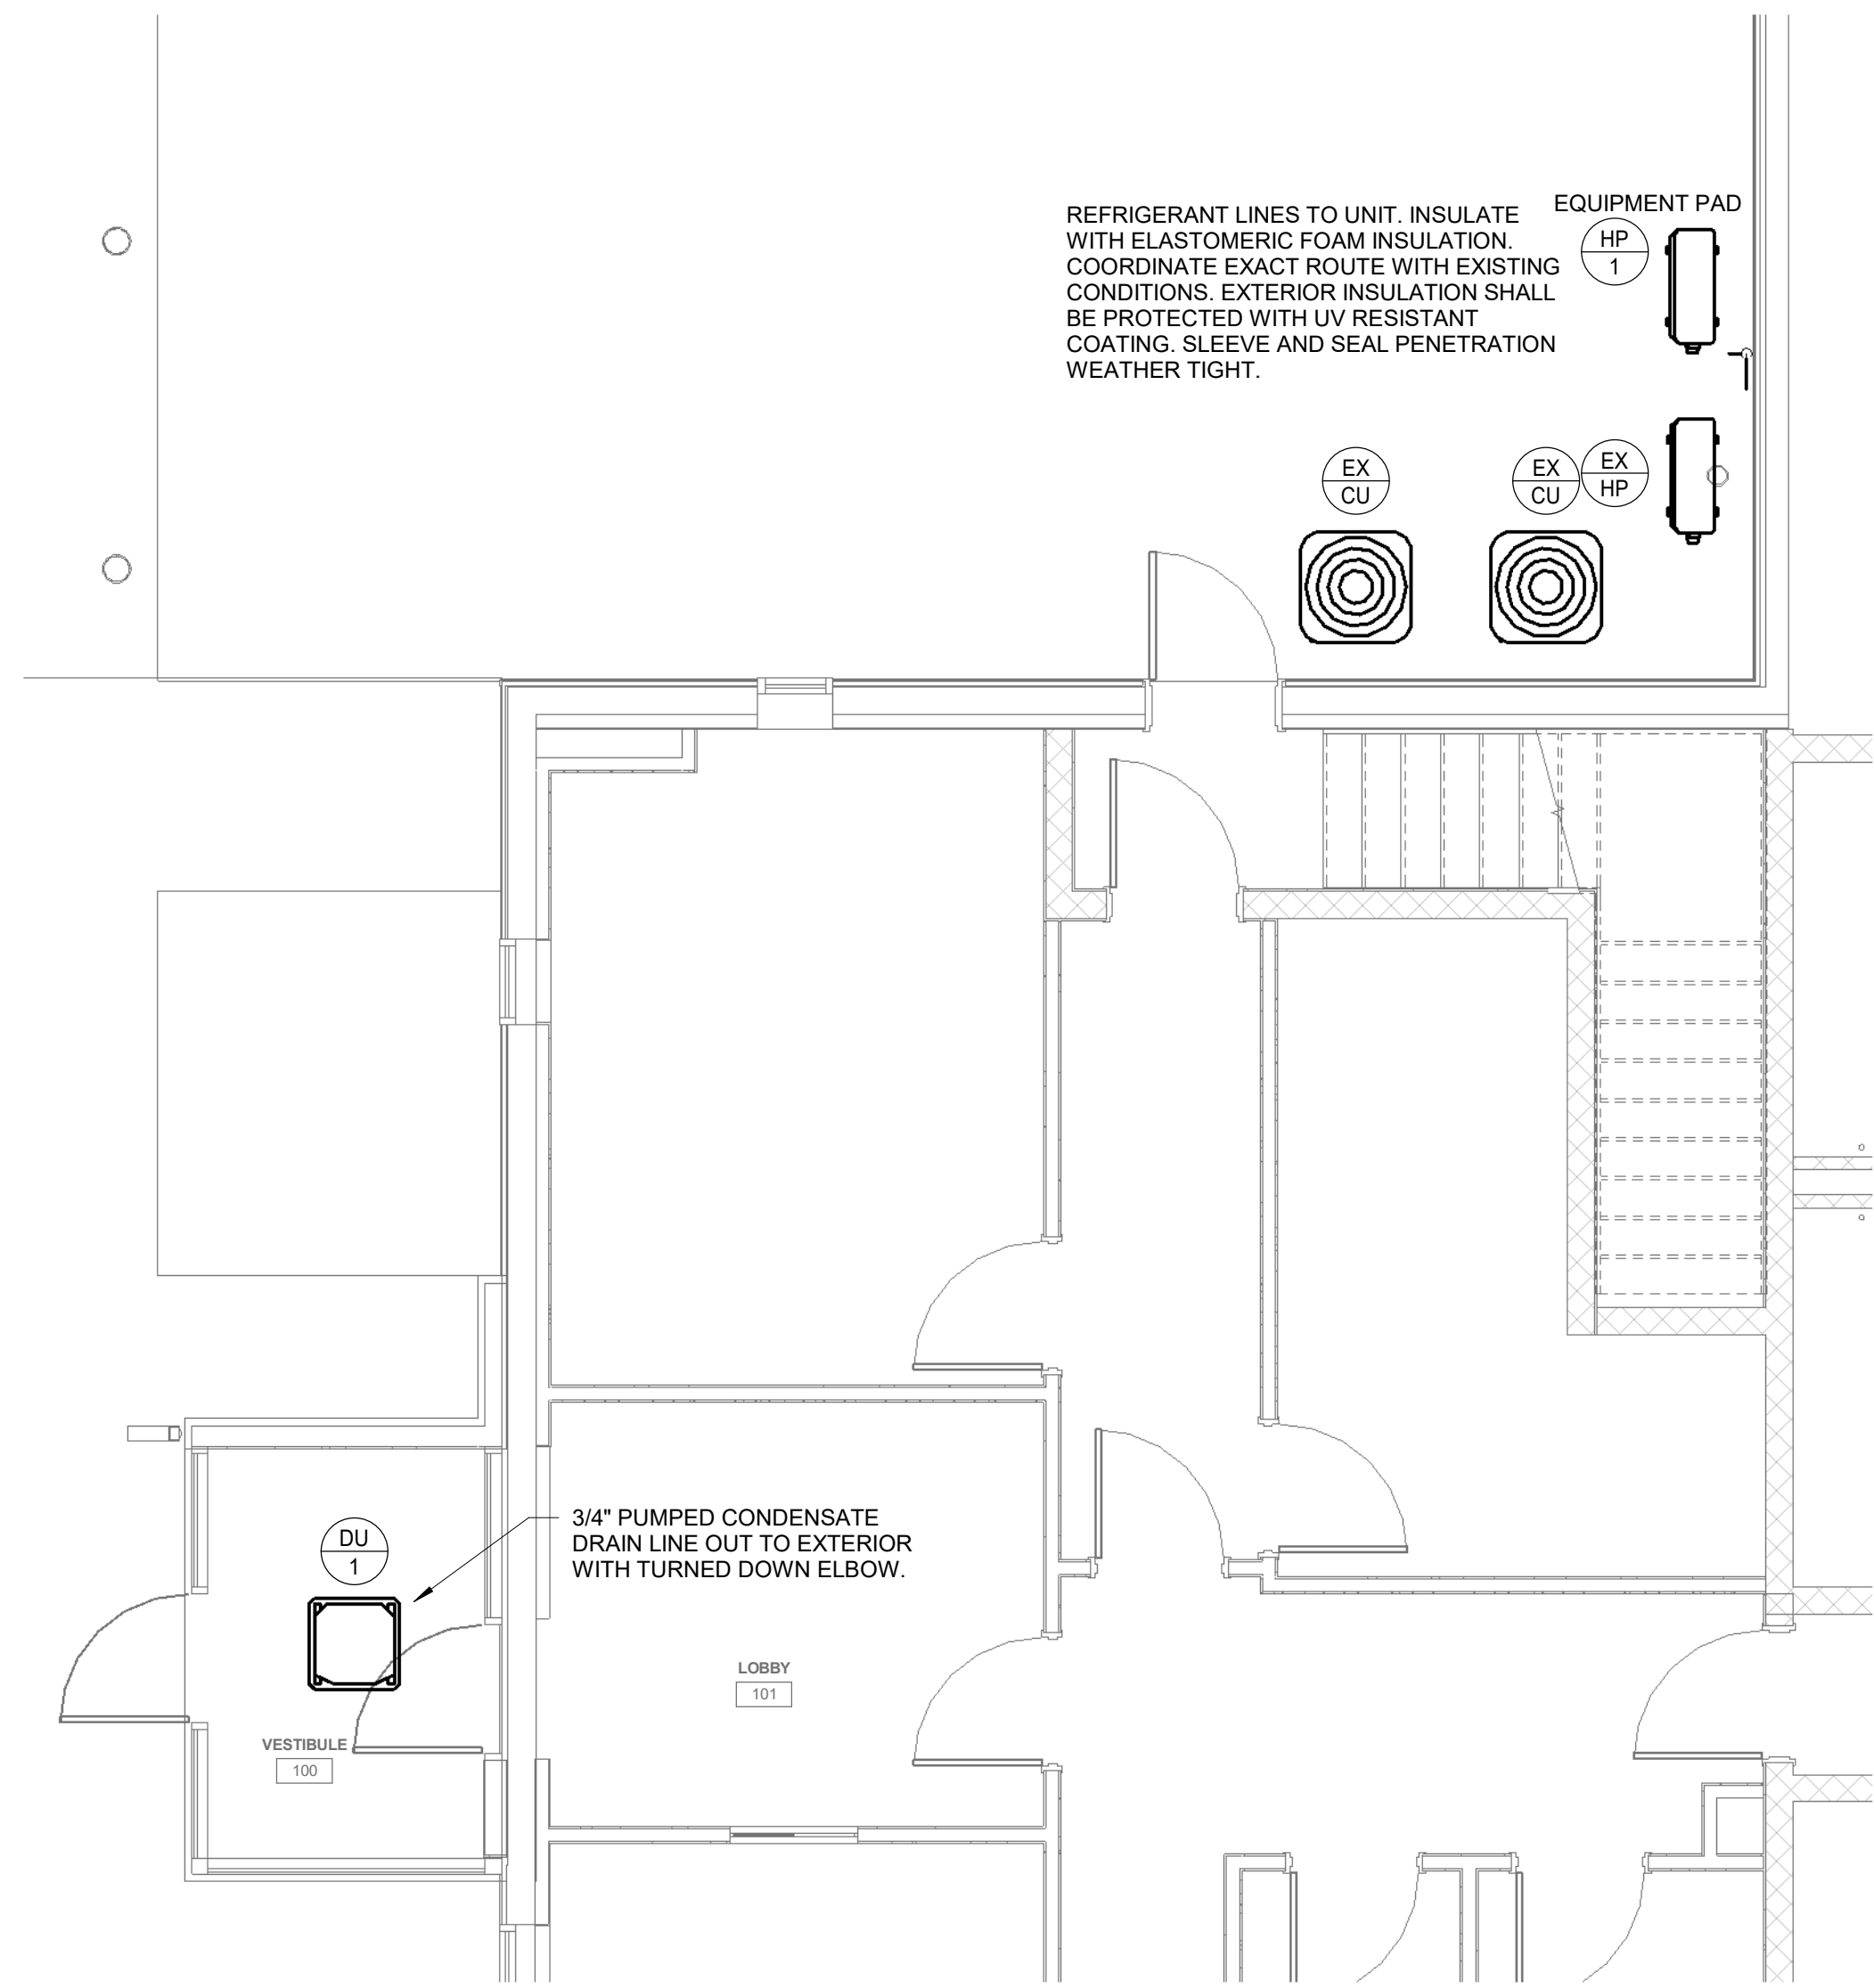


1 PARTIAL HVAC PLAN
SCALE: 1/4" = 1'-0"

| DUCTLESS UNIT AND CONDENSING UNIT SCHEDULE | | | | | | | | | | | | | | | | | |
|--|--------------|-----------|---------------|---------|-------------|-------------------|------|-----------|-------|---------------|-------|---------|-------|--------|------|-------|-------|
| INDOOR UNIT | | | OUTDOOR UNIT | | | SYSTEM ELECTRICAL | | | | | | | | | | | |
| MARK | MANUFACTURER | MODEL NO. | WEIGHT (LBS.) | CFM | COOLING MBH | HEATING MBH | MARK | MODEL NO. | TON | WEIGHT (LBS.) | SEER2 | VOLTAGE | PHASE | FLA | MCA | MOCPP | NOTES |
| DU-1 | CARRIER | 45MBCAQ12 | 41 | 365 CFM | 12 | 12 | HP-1 | 37MAHAQ12 | 1 TON | 100 | 22.5 | 208 V | 1 | 12.0 A | 15 A | 20 A | 1, 2 |


NOTES:
1. HIGH WALL AIR HANDLER SPLIT SYSTEM WITH FILTERS, GRILLE, CONDENSATE PUMP, ELECTRIC HEAT, HARD WIRED WALL MOUNTED THERMOSTAT, 454B REFRIGERANT WITH LEAK DETECTION, LINE SET HIDE AWAY KIT.
2. AIR COOLED CONDENSING UNIT WITH REF LINE, LOW AMBIENT OPERATION, PROGRAMMABLE THERMOSTAT.

| PLUMBING SYMBOL LEGEND | | | |
|------------------------|--|--------|-------------------------------|
| SYMBOL | DESCRIPTION | SYMBOL | DESCRIPTION |
| | TURN UP OR FROM BELOW | | COLD WATER PIPE (CW) |
| | TURN DOWN | | HOT WATER PIPE (HW) |
| | VENT THRU ROOF | | (HW) PIPE @ 140°F |
| | BALL VALVE | | HOT WATER RECIRCULATING (HWC) |
| | CHECK VALVE | | BELOW GRADE STORM DRAIN |
| | UNION | | SANITARY SEWER |
| | GAS VALVE | | ACID WASTE PIPING |
| | GAS VALVE IN VERTICAL | | ACID VENT PIPING |
| | SHOCK ABSORBER, LETTER DESIGNATES SIZE | | VENT PIPING |
| | PRESSURE REGULATING VALVE | | GAS PIPING |
| | FLOOR CLEANOUT | | WALL HYDRANT |
| | SURFACE CLEANOUT | | ROOF DRAIN |
| | FLOOR DRAIN | | FORCE MAIN PIPING |
| | FLOOR SINK | | FIRE PROTECTION PIPING |
| | FIXTURE DESIGNATION | | CONDENSATE DRAIN PIPING |
| | ABOVE GRADE RAINWATER CONDUCTOR | | DOWNSPOUT NOZZLE |
| | STRAINER | | SECONDARY ROOF DRAIN |
| | | | KITCHEN EQUIPMENT NUMBER |

- ### GENERAL PLUMBING NOTES
- ALL WORK SHALL BE IN ACCORDANCE WITH THE CURRENT EDITION OF INTERNATIONAL PLUMBING CODE & LOCAL AUTHORITIES HAVING JURISDICTION.
 - ALL PIPING IN EXTERIOR WALLS TO BE RUN ON BUILDING SIDE OF INSULATION.
 - PIPING LAYOUT IS SCHEMATIC. EXACT LOCATIONS OF PIPES TO BE COORDINATED WITH BUILDING STRUCTURE AND WORK OF OTHER TRADES.
 - MINIMUM PIPE SLOPE ON THE DRAINAGE AND VENT SYSTEM WITHIN THE BUILDING.
A. 2" PIPING SHALL SLOPE AT LEAST 1/4" PER FOOT.
B. ALL PIPE 3" AND LARGER SHALL SLOPE AT LEAST 1/8" PER FOOT.
 - PIPING SHALL NOT BE ROUTED ABOVE ELECTRIC PANELS.
 - COORDINATE PIPING IN TOILET AREAS WITH RECESSED TOILET ACCESSORIES. OFFSET PIPING AS REQUIRED TO ALLOW RECESS OF THESE ITEMS. SEE ENLARGED TOILET PLANS FOR LOCATIONS.
 - NOT ALL PLUMBING FIXTURES, ACCESSORIES AND PIPE SIZES ARE NECESSARILY SHOWN ON THIS DRAWING. REFER TO ALL OTHER SECTIONS, DETAILS, RISERS, PLANS AND SPECIFICATIONS FOR THIS PROJECT FOR COMPLETE SYSTEM REQUIREMENTS.
 - ALL PENETRATIONS THROUGH FIRE/SMOKE RATED CONSTRUCTION WILL BE SEALED WITH A FIRE RATED CAULK EQUAL TO OR EXCEEDING THE CONSTRUCTION FIRE RATING.
 - COORDINATE FINAL LOCATION OF PLUMBING FIXTURES, PIPING, ACCESSORIES, ETC. WITH GENERAL CONTRACTOR BEFORE FABRICATION OR INSTALLATION.
 - COORDINATE ALL PENETRATIONS OF FLOORS, ROOF, WALLS, ETC. WITH GENERAL CONTRACTOR.

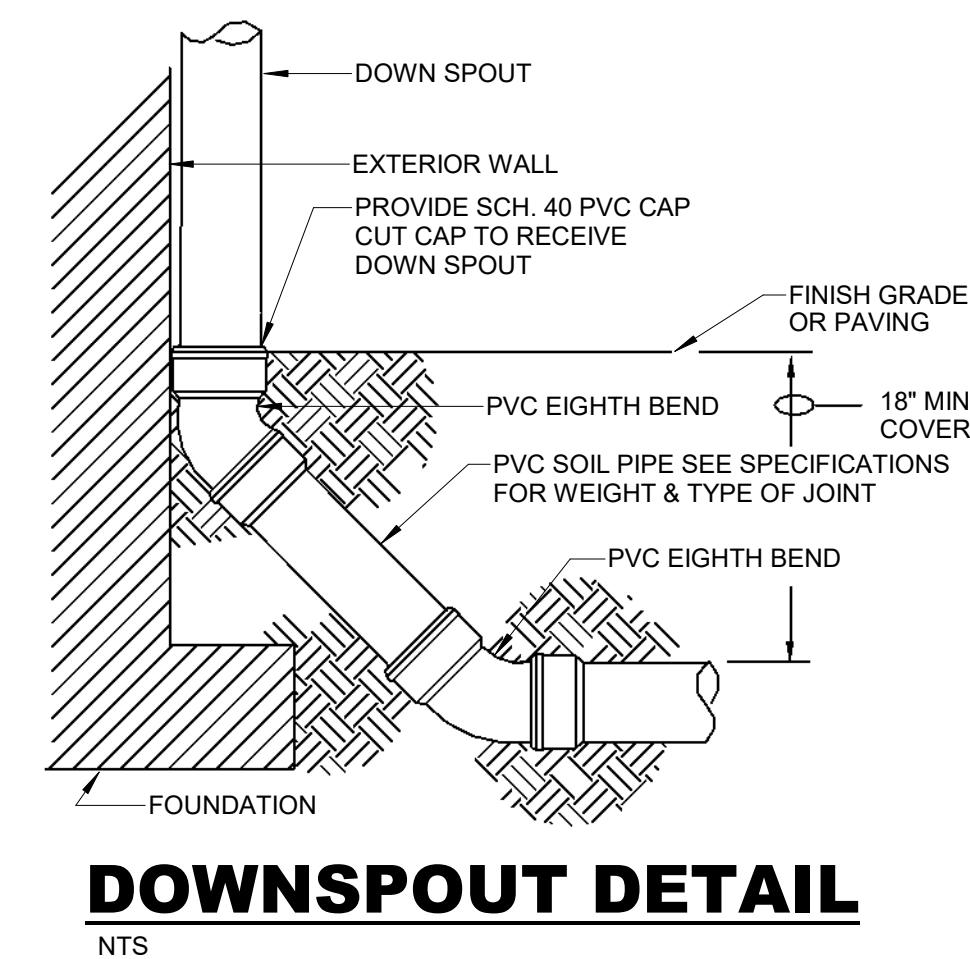

DOWNSPOUT DETAIL
NTS

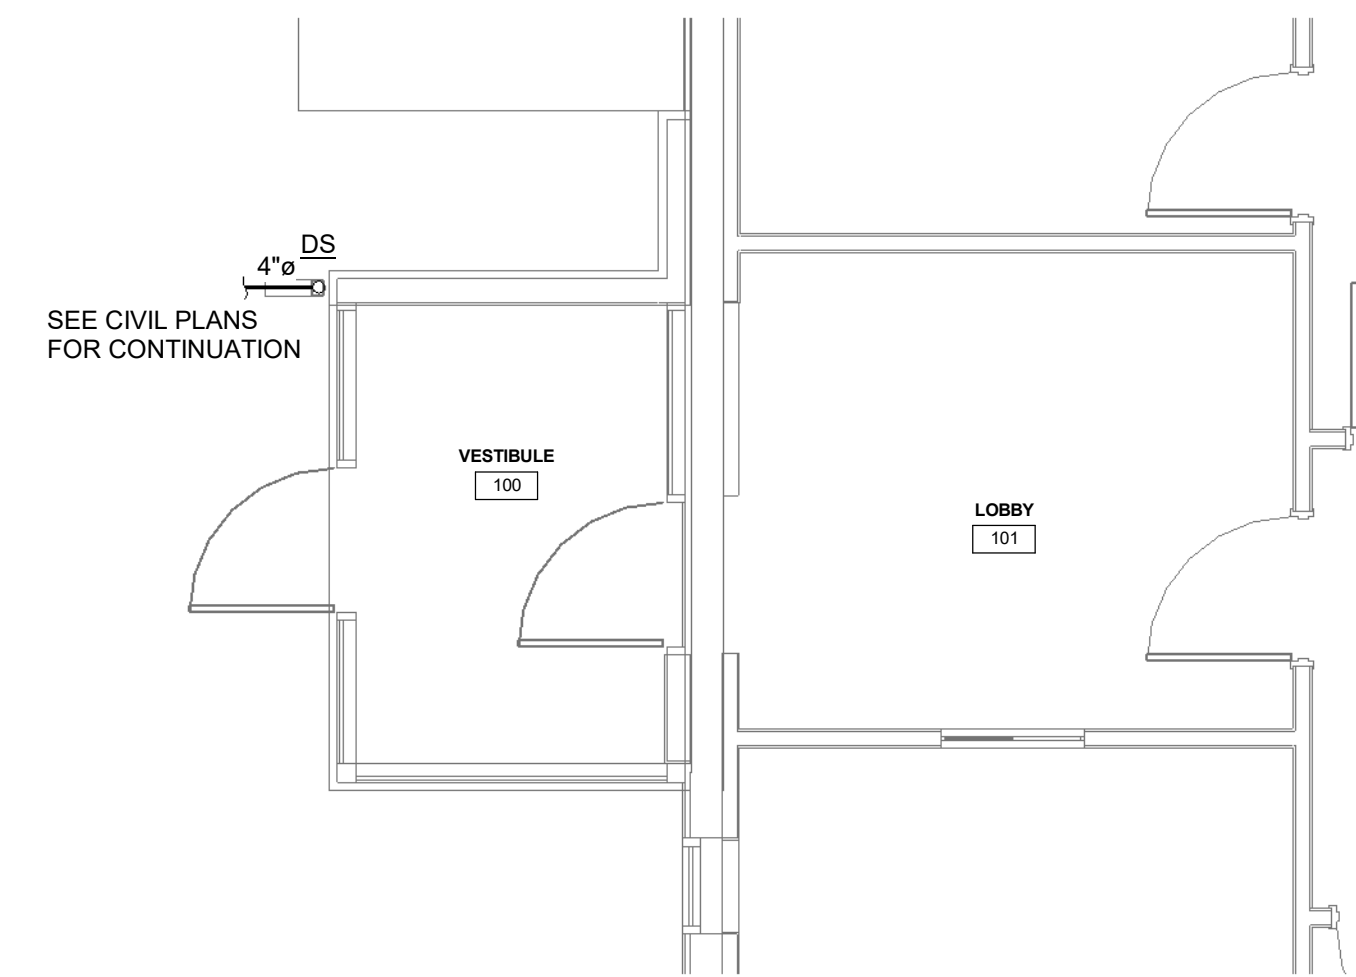

2 PARTIAL DRAINAGE AND VENT PLAN
SCALE: 1/4" = 1'-0"


ATC RENOVATION
NEW RIVER COMMUNITY & TECHNICAL COLLEGE
527 Odd Rd.
Ghent, WV 25843




MP-1.1

Copyright © All rights reserved. Reproduction in whole or in part is prohibited. This drawing is an instrument of service, is the property of the Architect and may not be used in any way without written permission of this firm.
Project No. 2024008.001 Drawn by: Staff

HVAC AND PLUMBING PLANS ADD ALTERNATE #01

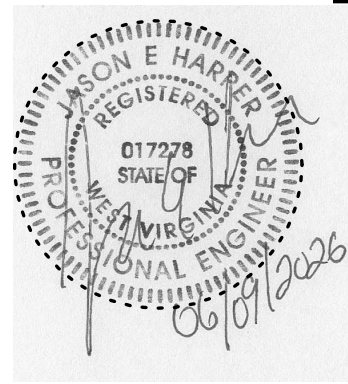


BID DOCUMENTS
06.09.2026

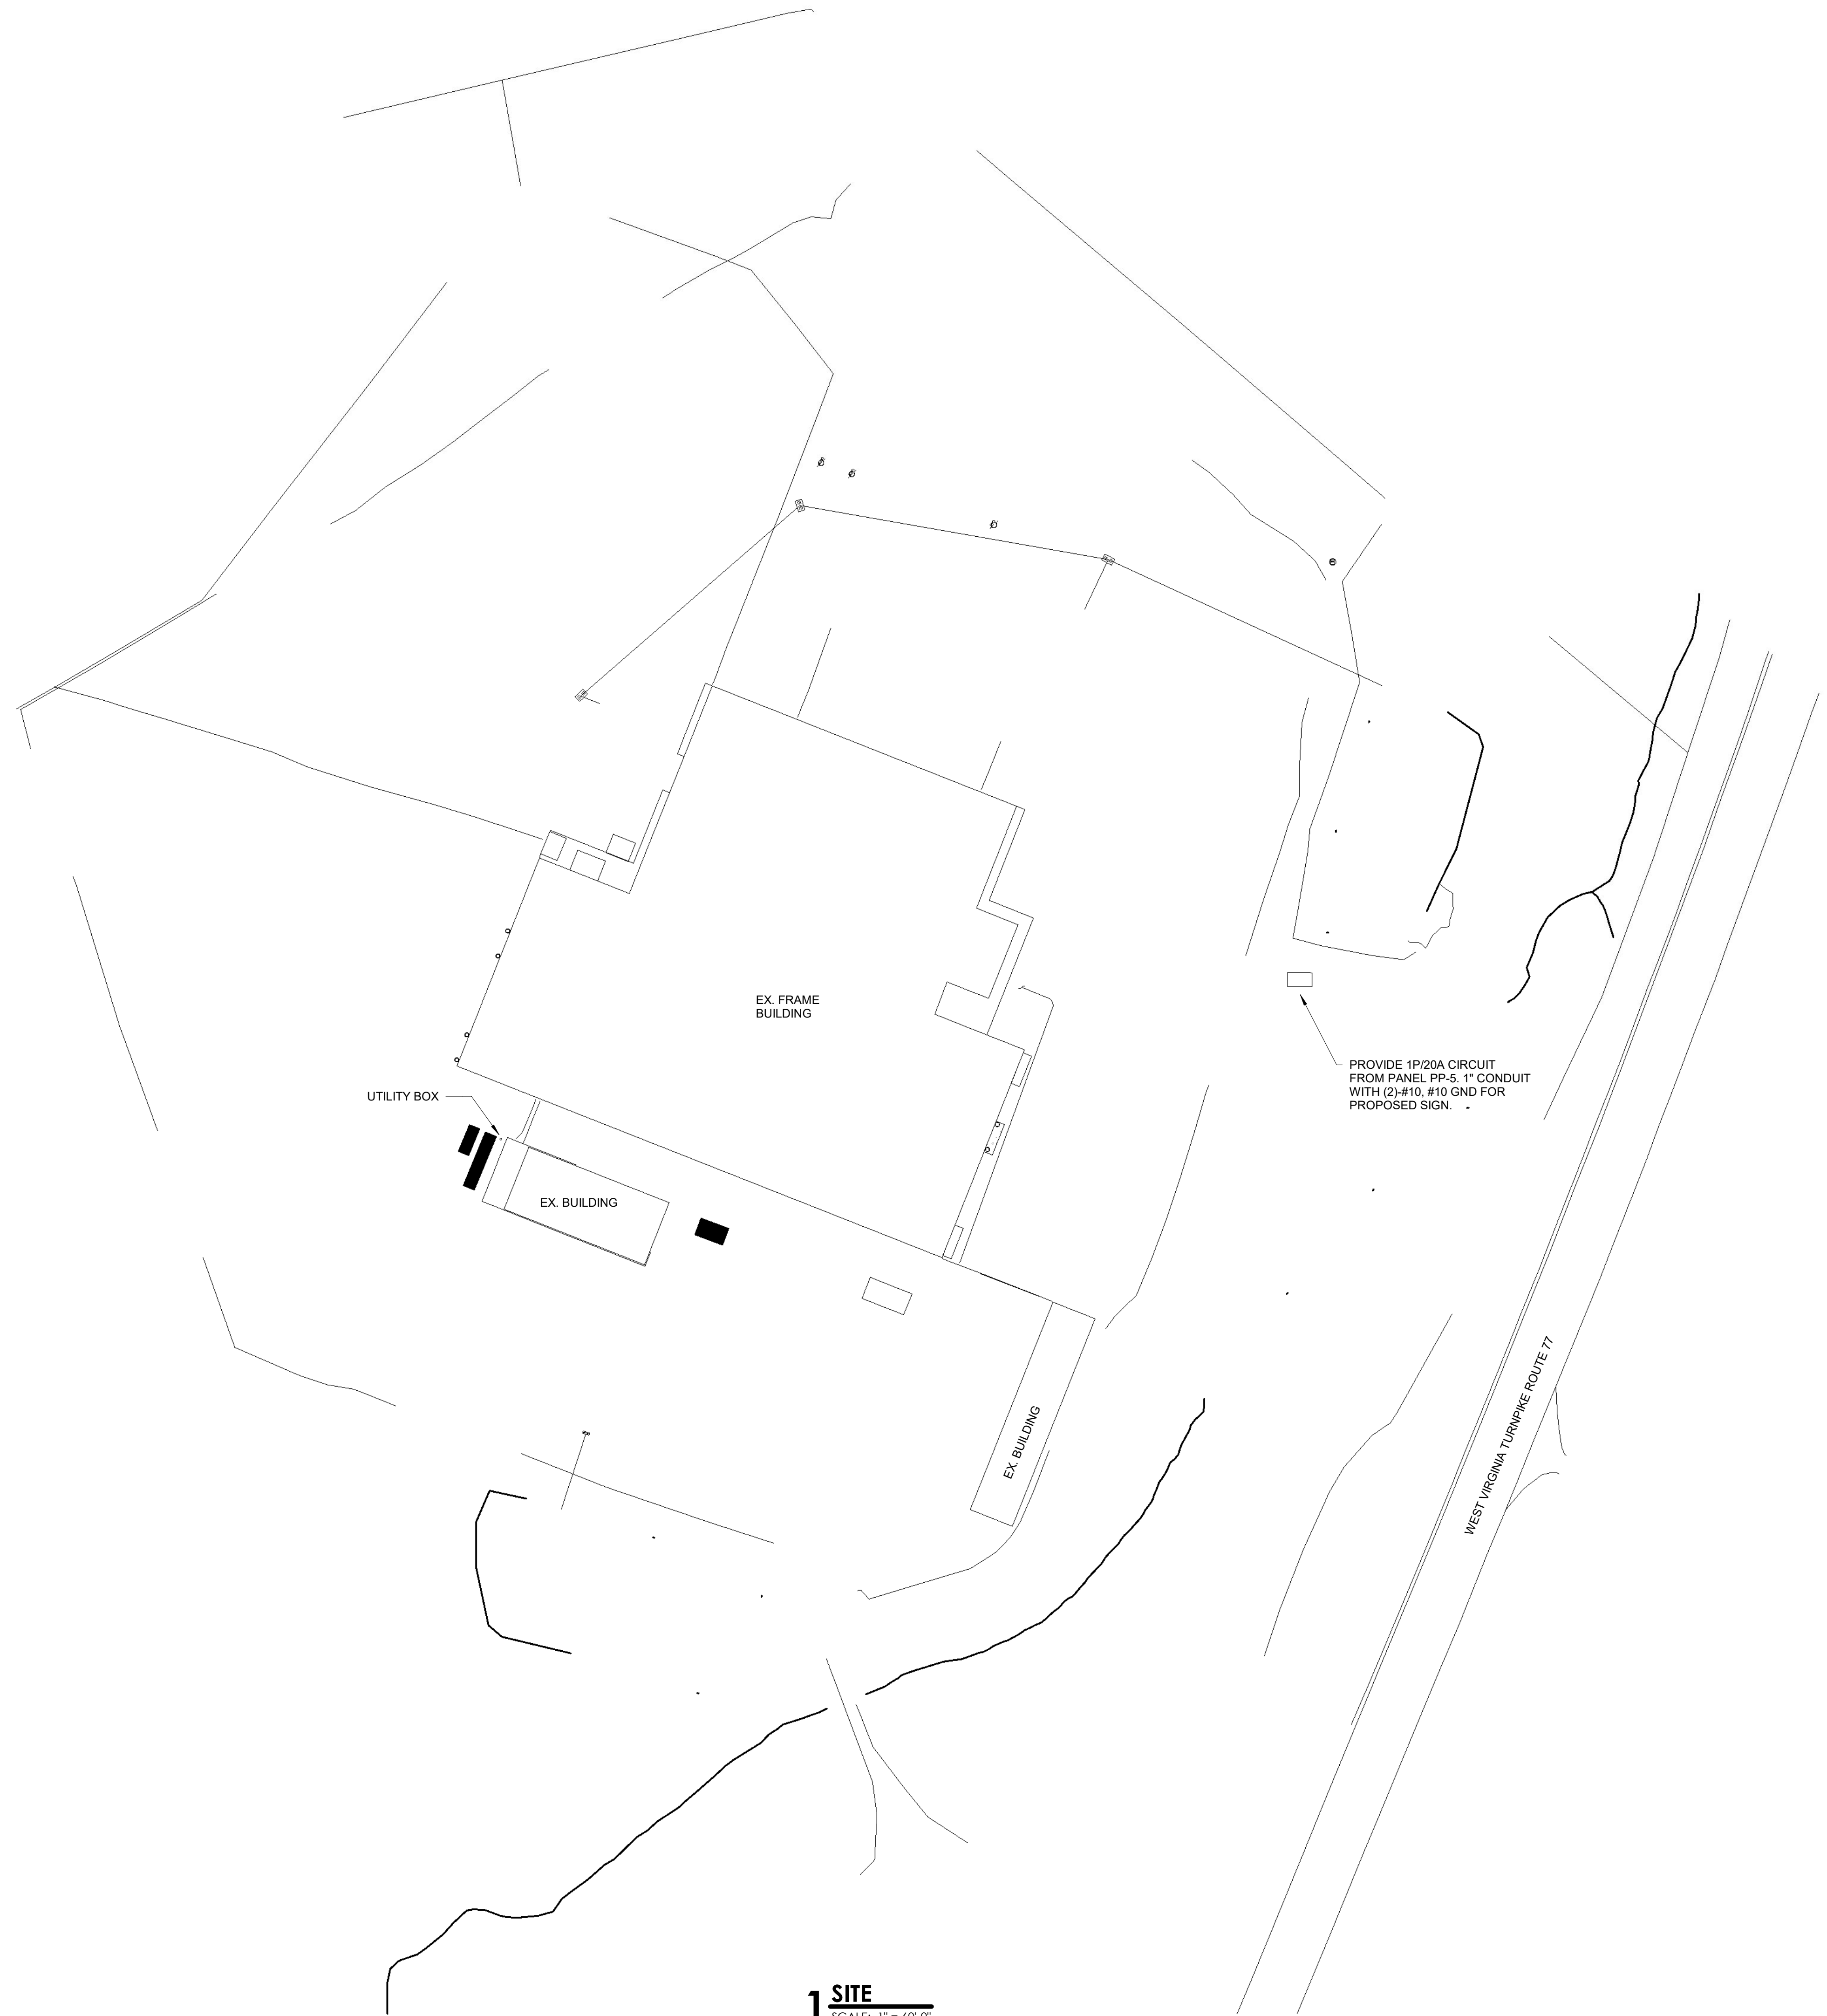

1 SITE
SCALE: 1" = 60'-0"


ATC RENOVATION
NEW RIVER COMMUNITY & TECHNICAL COLLEGE
527 Odd Rd.
Ghent, WV 25843

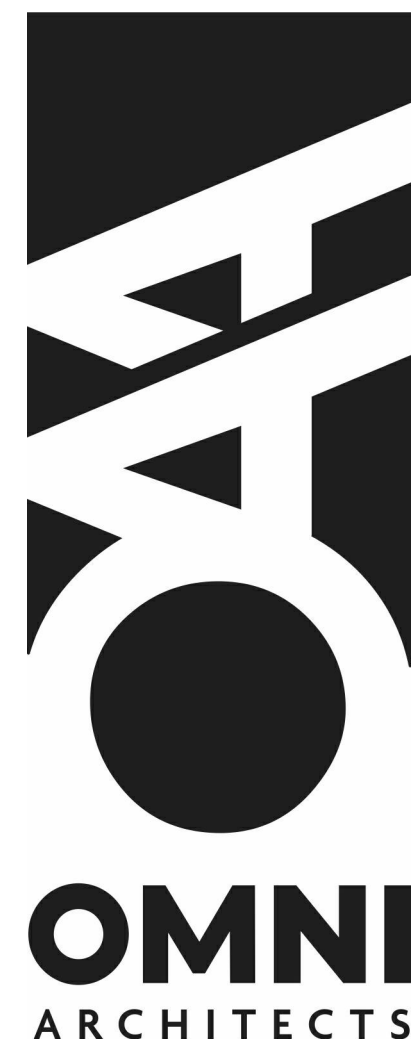

E-1.1

Copyright © All rights reserved. Reproduction in whole or in part is prohibited. This drawing is an instrument of service, is the property of the Architect and may not be used in any way without written permission of this firm.
Project No. 2024008.001 Drawn by: Author

SITE PLAN

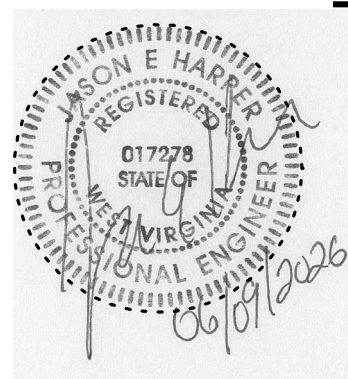

BID DOCUMENTS
06.09.2026

ATC RENOVATION
NEW RIVER COMMUNITY & TECHNICAL COLLEGE
527 Odd Rd.
Ghent, WV 25843



E-2.1

Copyright © All rights reserved. Reproduction in whole or in part is prohibited. This drawing is an instrument of service, is the property of the Architect and may not be used in any way without written permission of this firm.
Project No. 2024008.001 Drawn by: Staff

| WIRE AND CONDUIT SIZE SCHEDULE | | | | | |
|--------------------------------|----------------|-------------|--------------------------|--------|--------|
| MOCP (AMP) | CONDUCTOR SIZE | GROUND SIZE | CONDUIT SIZE WITH GROUND | | |
| | | | 1-POLE | 2-POLE | 3-POLE |
| 20 | #12 | #12 | 3/4" | 3/4" | 3/4" |
| 30 | #10 | #10 | 3/4" | 3/4" | 3/4" |
| 40 | #8 | #10 | 3/4" | 3/4" | 3/4" |
| 50 | #8 | #10 | 3/4" | 3/4" | 3/4" |
| 60 | #6 | #8 | 3/4" | 3/4" | 3/4" |
| 70 | #4 | #8 | 1" | 1" | 1" |
| 80 | #4 | #8 | - | 1" | 1" |
| 90 | #3 | #8 | - | 1 1/4" | 1 1/4" |
| 100 | #2 | #8 | - | 1 1/4" | 1 1/4" |
| 110 | #2 | #6 | - | 1 1/4" | 1 1/4" |
| 125 | #1 | #6 | - | 1 1/4" | 1 1/4" |
| 150 | #1/0 | #6 | - | 1 1/2" | 1 1/2" |
| 175 | #2/0 | #6 | - | 1 1/2" | 2" |
| 200 | #3/0 | #6 | - | 1 1/2" | 2" |
| 225 | #4/0 | #4 | - | - | 2-1/2" |
| 250 | 250MCM | #3 | - | - | 2 1/2" |
| 300 | 350MCM | #3 | - | - | 3" |
| 350 | 500MCM | #3 | - | - | 4" |
| 400 | 500MCM | #3 | - | - | 4" |

INCREASE CONDUCTOR SIZE AS REQUIRED FOR MAXIMUM VOLTAGE DROP OF 2% FOR FEEDERS AND 3% FOR BRANCH CIRCUITS.
ALL CIRCUITS SHALL COMPLY WITH NEC AND OTHER APPLICABLE CODES.
CONDUCTOR SIZE BASED ON 75 DEGREE C LUGS.

GENERAL ELECTRICAL NOTES

- COORDINATE LOCATIONS OF CEILING-MOUNTED LIGHTING FIXTURES, SPEAKERS AND OTHER ITEMS WITH THE CEILING PATTERN AND MECHANICAL EQUIPMENT.
- CENTER WALL-MOUNTED LIGHTING FIXTURES DIRECTLY OVER ANY RELATED LAVATORY, MIRROR OR OTHER EQUIPMENT.
- LOCATE FLOOR SERVICE FITTINGS, FLOOR BOXES AND FLOOR CONDUIT TERMINATIONS APPROXIMATELY AS INDICATED, EXACTLY AS NECESSARY OR AS DIRECTED TO COORDINATE WITH THE ASSOCIATED FURNISHINGS OR EQUIPMENT.
- LOCATE DUPLEX RECEPTACLES DESIGNATED "EWC" TO BE CONCEALED BY THE ASSOCIATED WATER COOLER.
- LOCATE SNAP SWITCHES APPROXIMATELY 4 TO 6 INCHES FROM THE LATCH SIDE OF THE RELATED DOOR FRAME WHERE POSSIBLE, EXCEPT AS NOTED OTHERWISE.
- LOCATE SNAP SWITCHES DIRECTLY UNDER THERMOSTATS WHERE THEY ARE SHOWN IN CLOSE PROXIMITY (SEE MECHANICAL DRAWINGS).
- LOCATE WALL BOXES APPROXIMATELY AS INDICATED, EXACTLY AS DIRECTED OR AS NECESSARY TO ACHIEVE SYMMETRY AND COORDINATED WITH THE BUILDING, FINISHES AND EQUIPMENT.
- LOCATE ALL BOXES TO BE ACCESSIBLE MOUNT FLUSH BOXES WITH THEIR FRONT EDGES EVEN WITH THE FINISHED SURFACE OF COMBUSTIBLE MATERIALS, WITHIN 1/4 INCH OF NON-COMBUSTIBLE MATERIALS.
- MOUNT SINGLE-GANG BOXES WITH THE LONGER DIMENSION VERTICAL EXCEPT AS NOTED OTHERWISE. MOUNT ALL BOXES AND PLATES PLUM.
- DO NOT INSTALL BOXES BACK TO BACK ON BOTH SIDES OF A PARTITION. OFFSET BOXES A MINIMUM OF 6 INCHES EXCEPT AS NOTED OTHERWISE.
- LOCATE ALL RACEWAYS TO AVOID INTERFERENCE WITH DUCTS, PIPES, MECHANICAL EQUIPMENT, WITH THE REMOVAL OF CEILING TILE, OR WITH ACCESS TO EQUIPMENT THAT REQUIRES PERIODIC ADJUSTMENT OR MAINTENANCE.
- DO NOT SUPPORT RACEWAYS OR EQUIPMENT FROM PIPES, DUCTS, OR A CEILING SUSPENSION SYSTEM.
- BRANCH CIRCUIT AND FEEDERS ARE DESIGNATED BY A NUMBER AND LETTER.
- INSTALL FEEDER RACEWAYS WITH NO MORE THAN 3 CURRENT-CARRYING CONDUCTORS PLUS A NEUTRAL CONDUCTOR, PLUS A GROUND CONDUCTOR.
- INDICATED BRANCH CIRCUIT CONDUCTOR SIZES ARE BASED ON NO MORE THAN 3 CURRENT-CARRYING CONDUCTORS AND A NON-CURRENT-CARRYING NEUTRAL CONDUCTOR IN EACH RACEWAY. WHERE THE NUMBER OF CONDUCTORS EXCEEDS THIS AMOUNT, ADJUST THE CONDUCTOR SIZES IF AND AS NECESSARY TO ACCOUNT FOR DERATING THEIR AMPACITY IN ACCORDANCE WITH THE NATIONAL ELECTRIC CODE.
- FROM EACH FLUSH MOUNTED PANELBOARD EXTEND A MINIMUM OF THREE EMPTY 3/4" CONDUITS TO ABOVE AN ACCESSIBLE CEILING AND CAP.
- PROVIDE AN ADJACENT DISCONNECT SWITCH FOR EACH ELECTRIC UNIT HEATER.
- IN MECHANICAL ROOMS ADJUST LIGHTING FIXTURE LOCATIONS AS NECESSARY TO COORDINATE WITH EQUIPMENT AND TO PROVIDE OPTIMUM ILLUMINATION.
- LOCATE TV AND DATA OUTLETS APPROXIMATELY AS SHOWN ON DRAWINGS. COORDINATE EXACT LOCATIONS WITH ARCHITECT.
- WHERE EMERGENCY LIGHTING FIXTURES ARE CONTROLLED BY ONE OR MORE WALL SWITCHES, PROVIDE AN UNSWITCHED CIRCUIT CONDUCTOR FOR OPERATION OF THE EMERGENCY CONTROLS.
- PROVIDE A SEPARATE NEUTRAL CONDUCTOR FOR EACH DIMMED LIGHTING CIRCUIT.
- COORDINATE OUTLET LOCATIONS AND CIRCUIT RATINGS WITH THE EQUIPMENT SHOWN ON THE MECHANICAL AND PLUMBING DRAWINGS AND WITH ALL EQUIPMENT AND FURNISHINGS SHOWN ON THE ARCHITECTURAL DRAWINGS.
- EQUIPMENT SHALL BE GROUNDED IN ACCORDANCE WITH SPECIFICATIONS AND AS REQUIRED BY THE NATIONAL ELECTRIC CODE.
- ALL WORK SHALL COMPLY WITH NFPA 70.
- ELECTRICAL BRANCH CIRCUITS SHALL NOT SHARE A COMMON NEUTRAL.

ELECTRICAL SYMBOL LEGEND

| SYMBOL | DESCRIPTION | MT HEIGHT UNO |
|--------|--|---------------|
| (A) | PLAN NOTE | |
| — | WIRING IN CONDUIT CONCEALED IN CEILING, OR IN WALL. CONDUIT AND WIRE AS REQUIRED BY CODE UNLESS OTHERWISE NOTED. | |
| — | CONDUIT STUBBED OUT | |
| HA-1 | BRANCH CIRCUIT, "HA" DESIGNATES PANEL "1" DESIGNATES CIRCUIT NUMBER | |
| JB | JUNCTION BOX | |
| ▭ | RECESSED LED LIGHT FIXTURE | |
| ▭ | EMERGENCY LIGHT FIXTURE | |
| ▭ | WALL MOUNTED LIGHT FIXTURE | |
| ▭ | EXIT SIGN WALL MOUNTED WITH REMOTE HEAD. | |
| S | SINGLE POLE TOGGLE SWITCH. | 48" AFF |
| ⊠ | DIRECT CONNECTION | |
| ▭ | CLOSED CIRCUIT TELEVISION CAMERA | |
| ▭ | PANELBOARD. SEE PANEL SCHEDULES ON DRAWINGS FOR RATING AND SIZE. | |
| ⊙ | SMOKE DETECTOR. | |
| ▭ | FIRE ALARM MANUAL PULL STATION | 48" AFF |
| CR | CARD READER | 48" AFF |


FIRE ALARM SYSTEM NOTES

- ALL EXTERIOR DOORS SHALL HAVE A PULL STATION MOUNTED ADJACENT TO THE DOOR. SPACING OF PULL STATIONS SHALL NOT EXCEED 200' ALONG PATH OF EGRESS.
- FIELD VERIFY LOCATION AND QUANTITY OF AIR HANDLING UNITS GREATER THAN 2000 CFM. PROVIDE A DUCT SMOKE DETECTOR IN THE RETURN AIR DUCT OF EACH UNIT. EACH AIR HANDLER DUCT SMOKE DETECTOR SHALL BE SEPARATELY ANNUNCIATED BY THE FIRE ALARM PANEL AND THE ANNUNCIATOR. PROVIDE REMOTE LED INDICATOR AT CEILING BELOW EACH DETECTOR.
- FIELD VERIFY LOCATION AND QUANTITY OF ELECTRICAL PANELS. PROVIDE A SMOKE DETECTOR IN EACH OF THESE ROOMS.
- PROVIDE SMOKE DETECTORS IN CORRIDOR A MAXIMUM 15' FROM EACH END AND A MAXIMUM OF 30' ON CENTER.
- PROVIDE RATE OF RISE HEAT DETECTORS IN ALL TOILETS.
- PROVIDE STROBES IN ALL TOILETS.
- PROVIDE RATE OF RISE HEAT DETECTORS IN ALL UTILITY ROOMS, STORAGE ROOMS, JANITOR CLOSETS, AND LOCKER ROOMS. SPACING SHALL BE PER NFPA 72.
- PROVIDE FIXED TEMPERATURE HEAT DETECTORS IN ATTICS, COCKLOFTS, FURNACE ROOMS, AND KITCHENS. SPACING SHALL BE PER NFPA 72.
- PROVIDE HORN/STROBES AS REQUIRED BY NFPA 72. SPACING AND SOUND LEVEL SHALL BE SUCH THAT THE AUDIBLE ALARM CAN BE EFFECTIVELY HEARD ABOVE THE AMBIENT NOISE LEVEL OBTAINED UNDER NORMAL OCCUPIED CONDITIONS.
- PROVIDE STROBES IN ALL OCCUPIED SPACES EXCEPT COMMON AREAS AS DEFINED IN THE AMERICAN WITH DISABILITIES ACT. SPACING SHALL BE PER NFPA 72.


GENERAL FIRE ALARM NOTES

- PROVIDE ALL MATERIAL AND EQUIPMENT AND PERFORM ALL LABOR REQUIRED TO INSTALL A COMPLETE AND OPERABLE FIRE ALARM SYSTEM DEVICES AS INDICATED ON THE DRAWINGS ARE SCHEMATIC IN NATURE. CONTRACTOR SHALL PROVIDE ANY ADDITIONAL WORK AS REQUIRED BY LOCAL AHJ AT NO ADDITIONAL COST TO THE OWNER.
- IT SHALL BE THE CONTRACTORS SOLE RESPONSIBILITY TO PROVIDE A FIRE ALARM SYSTEM IN FULL COMPLIANCE WITH THE LATEST EDITION OF (NFPA 72, WV STATE FIRE CODE, AND ADA).
- THIS BUILDING WILL BE FULLY SPRINKLED PER NFPA 13.
- SUPPLY A 120 VOLT CONNECTION AS REQUIRED AT ALL SYSTEMS EQUIPMENT.
- DEVICES SHOWN ARE APPROXIMATE LOCATIONS. FIELD VERIFY ACTUAL CONDITIONS.
- DO NOT SUPPORT RACEWAYS FROM PIPES DUCTS OR CEILING SUSPENSION SYSTEM.
- EXPOSED RACEWAY AND BLANK COVERS SHALL BE PAINTED TO MATCH EXISTING SURFACES.
- SURFACES DAMAGED BY THIS CONTRACTOR SHALL BE REPAIRED.
- WHERE SURFACES ARE REQUIRED TO BE PATCHED OR REPAIRED, SURFACE SHALL BE PAINTED TO MATCH ADJACENT SURFACE.
- ALL JUNCTION BOX COVERS IN FIRE ALARM RACEWAY SHALL BE PAINTED RED.
- MOUNTING HEIGHT OF FIRE ALARM STROBE SHALL BE 80" AFF.
- SYSTEM SHALL INTERFACE WITH HOOD SUPPRESSION SYSTEM PER NFPA.
- SYSTEM SHALL INTERFACE WITH SHUNT TRIP BREAKERS OR GAS VALVE FOR ALL EQUIPMENT LOCATED UNDER THE KITCHEN HOOD.

FIRE ALARM NOTE:
CONNECT NEW DEVICES INTO EXISTING HONEYWELL FIRE ALARM SYSTEM.

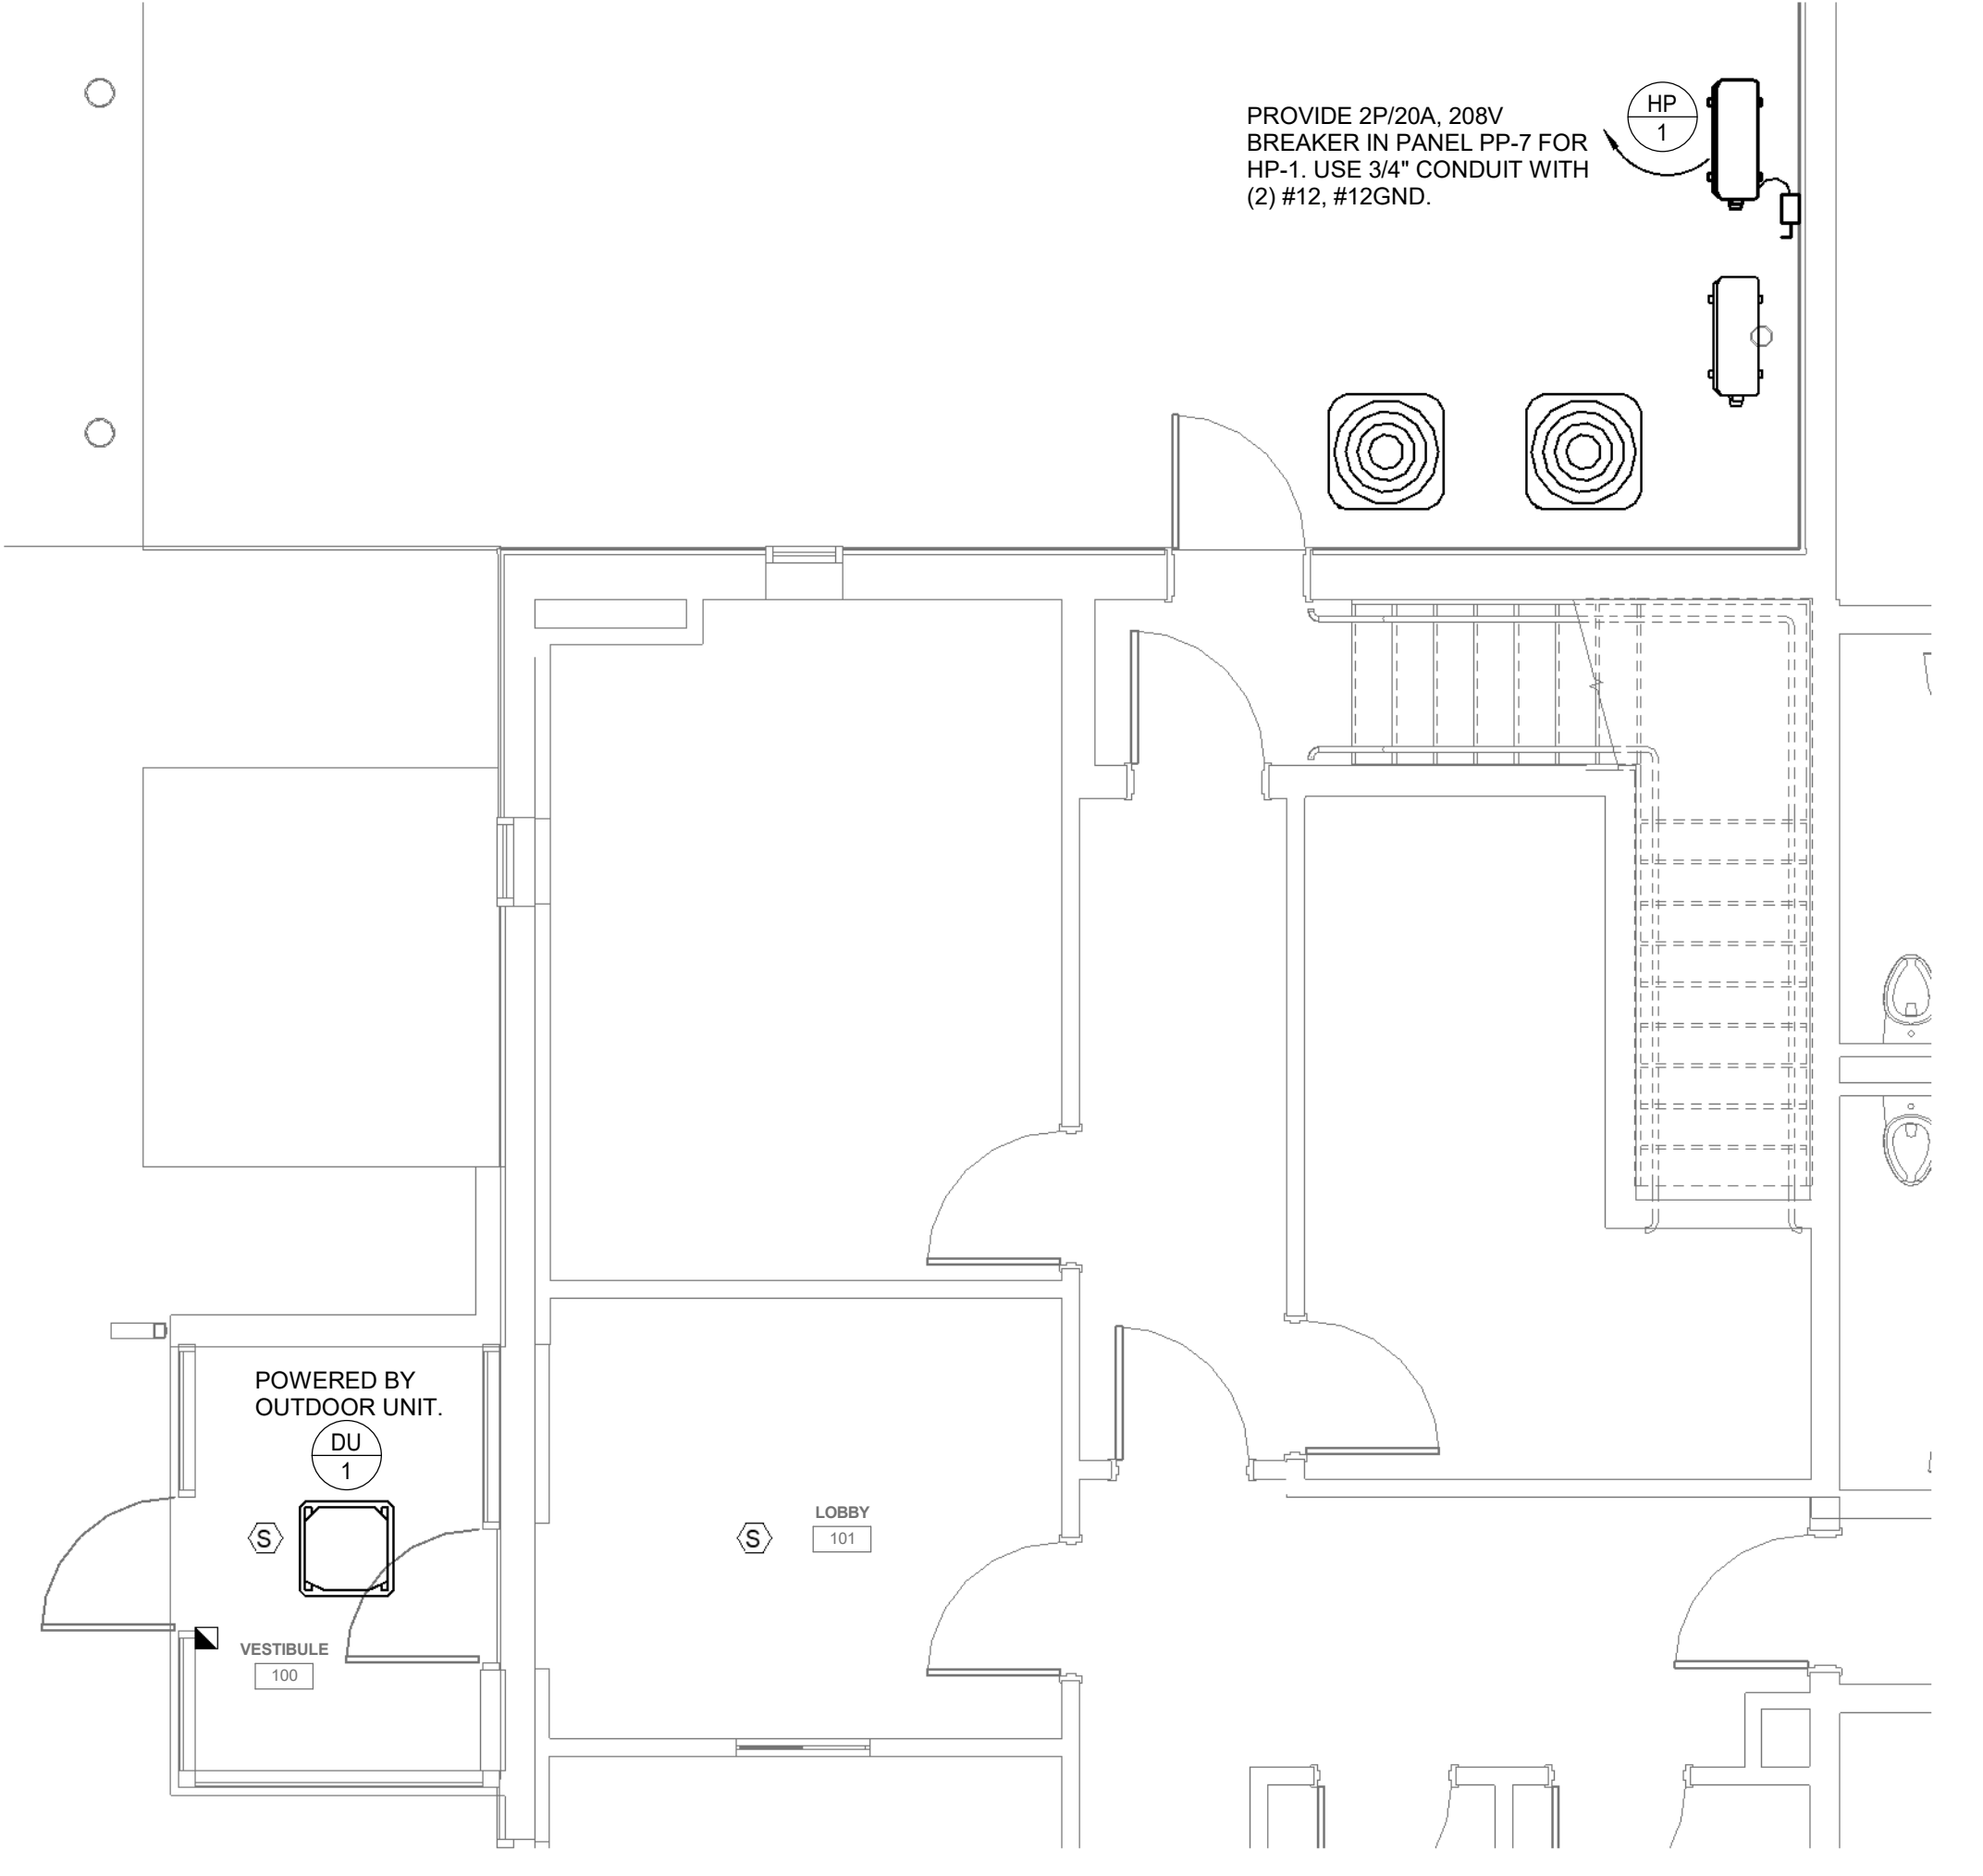

1 PARTIAL POWER PLAN
SCALE: 1/4" = 1'-0"

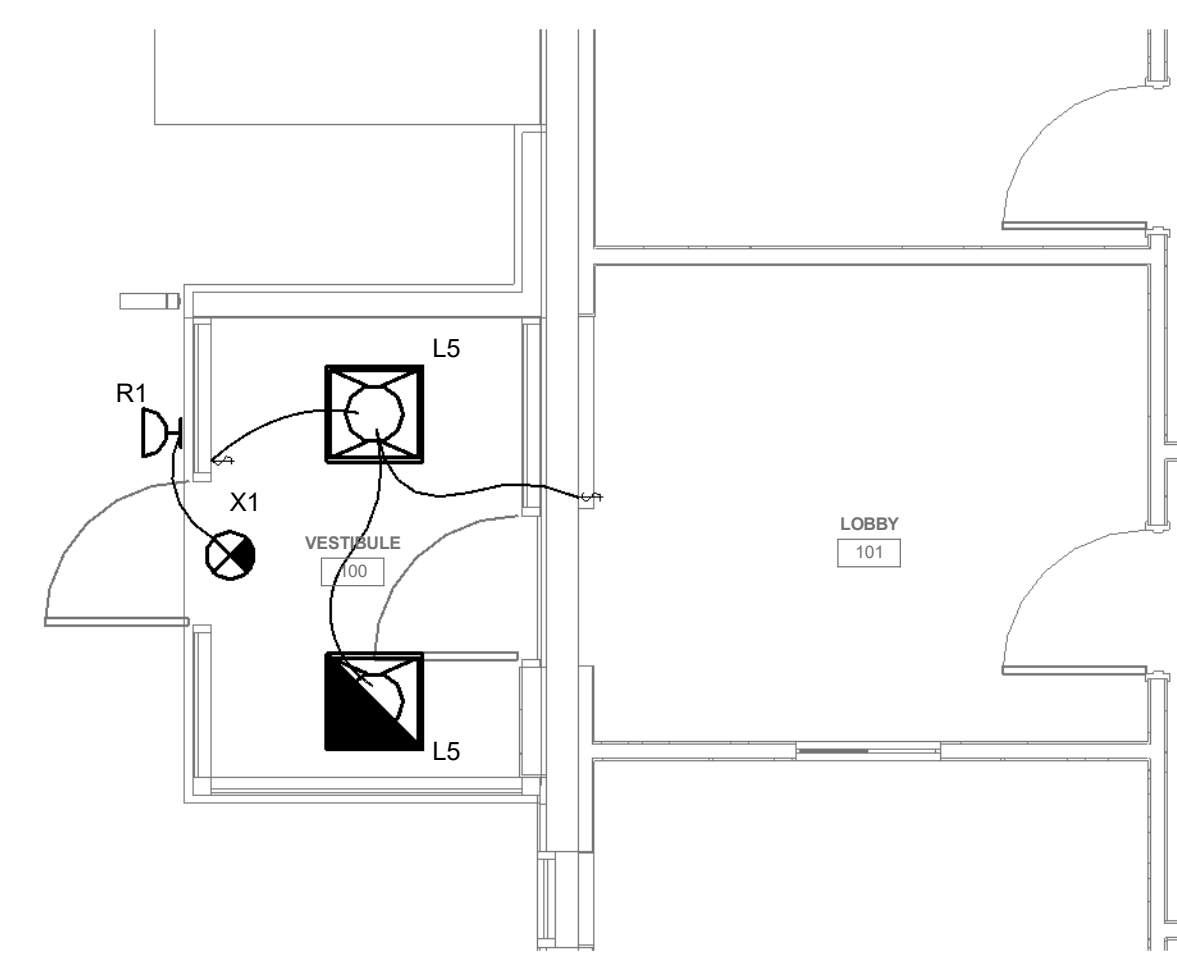

2 PARTIAL LIGHTING PLAN
SCALE: 1/4" = 1'-0"

SPRINKLER NOTE:
EXTEND SPRINKLER COVERAGE FROM EXISTING SCHOOL INTO NEW ADDITION. PROVIDE HYDRAULIC CALCULATIONS AND SHOP DRAWINGS FOR REVIEW.

EXISTING PANEL NOTE:
EXISTING PANELS ARE GE. FIELD CONFIRM AIC RATING PRIOR TO ORDERING NEW BREAKERS.

NOTE:
CONDUIT SHALL BE ROUTED CONCEALED WHERE EVER POSSIBLE. IF CONDUIT MUST BE EXPOSED, MOUNT FLUSH TO WALL AND PAINT TO MATCH ADJACENT SURFACE.

LIGHTING FIXTURE SCHEDULE

| MARK | LAMP | MOUNTING | MANUFACTURER | MODEL | DESCRIPTION | NOTES |
|------|------|----------|---------------------------|------------|--|-------|
| L5 | LED | RECESSED | LITHONIA COOPER COLUMBIA | 2X2CLXAL07 | 2X2 FLAT PANEL LED WHITE FRAME, SATIN WHITE LENS ELECTRONIC DRIVER | 120V |
| R1 | LED | Surface | LITHONIA COOPER COLUMBIA | ELA NX | EMERGENCY EGRESS WALL LIGHT | 6V |
| X1 | LED | UNIV | LITHONIA COOPER DAY-BRITE | LHQM | EXIT SIGN WHITE BODY RED LETTERS BATTERY REMOTE CAPABLE | 120V |

- NOTES:**
- VERIFY CEILING CONSTRUCTION TYPE WITH ARCHITECTURAL DRAWINGS TO DETERMINE WHETHER RECESSED LIGHTING FIXTURES SHALL BE FLANGE OR GRID TYPE MOUNTING.
 - DIRECTIONAL INDICATOR ON EXIT SIGNS SHALL COMPLY WITH NFPA 101 SECTION 5-10.4.1.2.
 - VERIFY VOLTAGE TO OPERATE FIXTURE WITH ELECTRICAL DRAWINGS.
 - LIGHT FIXTURES SHALL COME COMPLETE WITH NECESSARY MOUNTING HARDWARE.
 - ALL RECESSED FLUORESCENT LIGHT FIXTURES SHALL BE PAINTED AFTER FABRICATION.
 - ANY REQUEST FOR SUBSTITUTION TO THE LIGHTING FIXTURE SCHEDULE SHALL BE OF EQUAL OR HIGHER QUALITY AS DETERMINED BY THE ENGINEER. ANY PERSON REQUESTING TO SUBSTITUTE FIXTURES MUST SUBMIT IN BOUND FORM A COLLECTION OF THE MANUFACTURER'S CUT SHEETS TO BE REVIEWED BY THE ENGINEER A MINIMUM OF (TWENTY-ONE) 21 DAYS PRIOR TO BID. ACCEPTED SUBSTITUTIONS SHALL BE REFLECTED IN AN ADDENDUM.
 - SUPPLY HANGING BAR KITS WITH ALL RECESSED DOWN LIGHTS.
 - ALL OPEN RATED METAL HALIDE LIGHT FIXTURES TO HAVE OPEN RATED LAMPS AND SOCKETS.
 - EMERGENCY BATTERY PACK FOR FLUORESCENT LIGHT FIXTURES SHALL BE RATED TO SUPPLY A MINIMUM OF 900 INITIAL LUMENS.
 - WHERE LIGHT FIXTURES ARE SHOWN CONTROLLED BY TWO SWITCHES, FOR TWO LEVEL CONTROL, CONNECT THE OUTSIDE LAMPS TO ONE SWITCH AND THE INSIDE LAMP(S) TO THE OTHER SWITCH. PROVIDE FIXTURE WITH BALLASTS AS NECESSARY.